



**MEZZANINE LEVEL**  
NO SCALE

**LEGEND:**

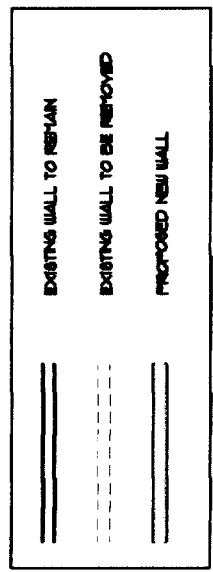


**LEGEND:**

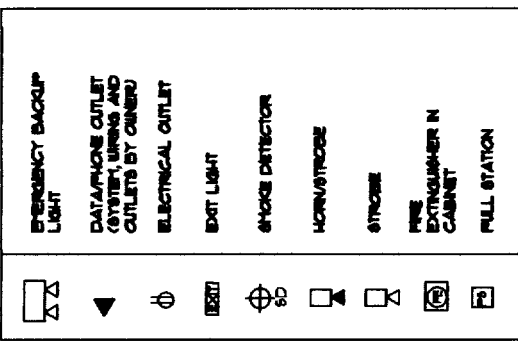

SMOKE DETECTORS AT TENANT'S SPACE REQUIRED PER NFPA 72. FULL STATIONS PER BUILDING FIRE ALARM SYSTEM.

3284  
10612

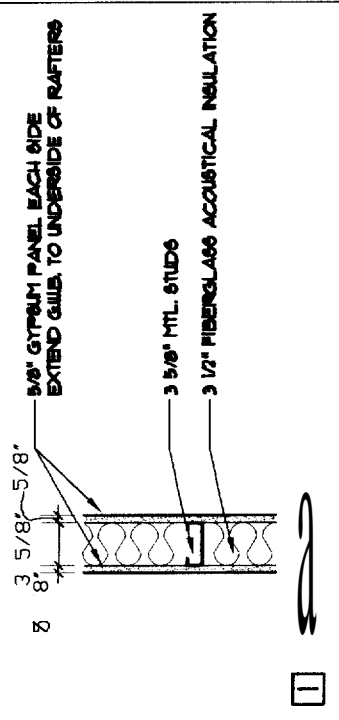

**PARTITION WALLS**