
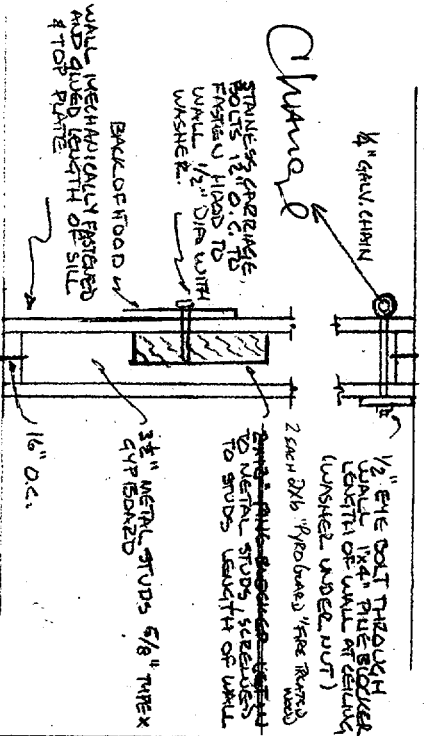


**SCOPE of Work:**



Work consists of replacement of two existing kitchen hoods with a larger hood at Back Bay Grill. The new hood will allow existing cooking surfaces to be located adjacent to each other for more efficient cooking use. Two hoods will be replaced and a new hood installed as shown on drawings. New hood ductwork will be connected to existing ductwork and exhaust fan system in use at present. Current hoods, 1,720 square inches filter, new hood, 1650 square inches. After removal of smaller hood and ductwork, duct will be patched appropriately to International Mechanical Codes standards, 2003 edition.

**Construction Notes:**

1. Exhaust hood to be provided and installed by Atlantic Restaurant Services, 34 Albion Road, Windham, Me 04062 per drawing.
2. Exhaust hood to be all stainless steel construction, not less than No. 18 gage, welded construction.
3. Hood to contain UL listed lights and aluminum baffle filters, approximately 19"x86".
4. Hood to meet NFPA 96 standards.
5. Hood and all associated work to meet International Mechanical Code, 2003 edition, Section 505.
6. Electrical work, gas piping work, fire suppression system to be performed by licensed individuals. See engineer's report.

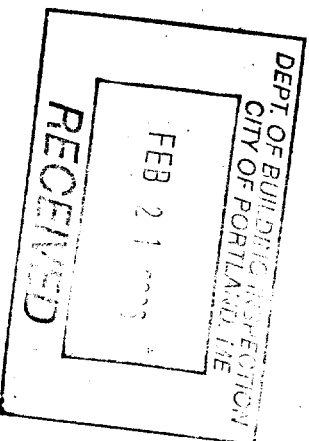

BACK BAY GRILL HOOD REPLACEMENT	
SCALE: AS NOTED	APPROVED BY:
DATE: 2/06	DRAWN BY: BWH
DRAWING NUMBER	

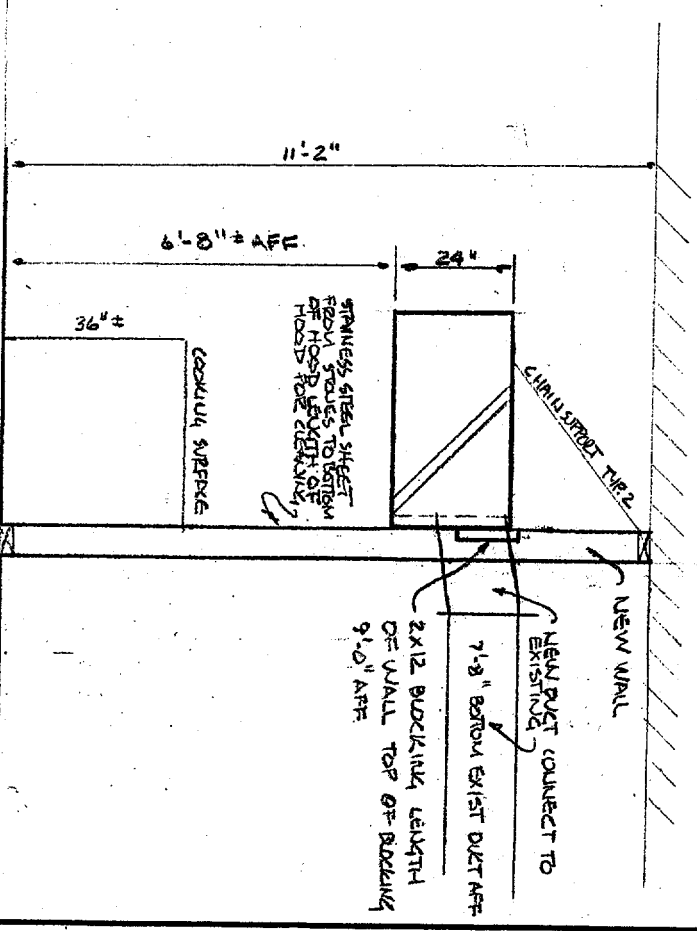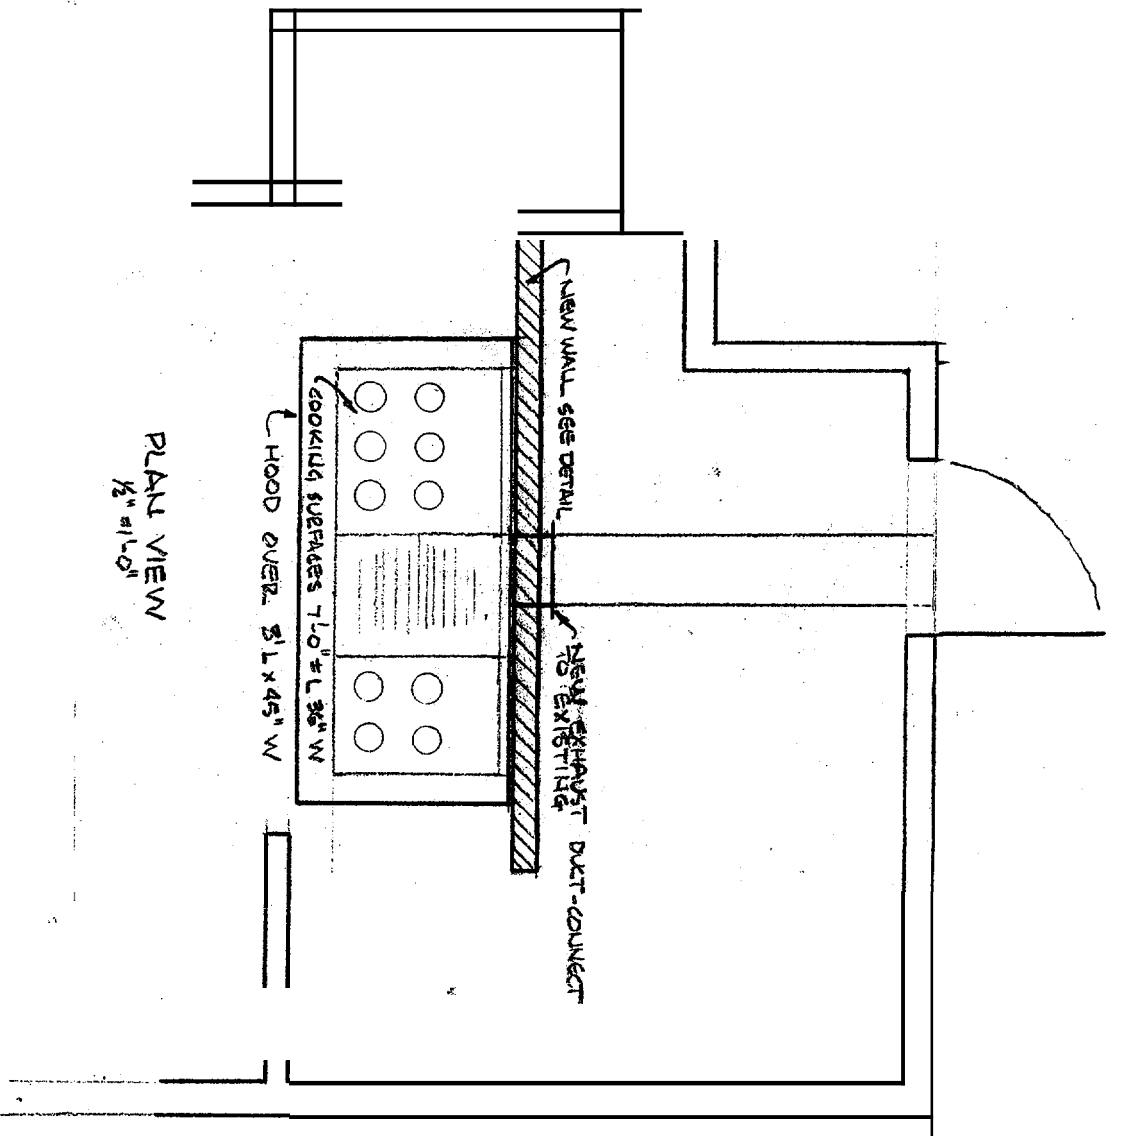

**Scope of work:**

Work consists of replacement of two existing kitchen hoods with a larger hood at Back Bay Grill. The new hood will allow existing cooking surfaces to be located adjacent to each other for more efficient cooking use. Two hoods will be replaced and a new hood installed as shown on drawings. New hood ductwork will be connected to existing ductwork and exhaust fan system in use at present. Current hoods, 1,720 square inches filter, new hood, 1650 square inches. After removal of smaller hood and ductwork, duct will be patched appropriately to International Mechanical Codes standards, 2003 edition.

**Construction Notes:**

1. Exhaust hood to be provided and installed by Atlantic Restaurant Services, 34 Albion Road, Windham, Me 04062 per drawing.
2. Exhaust hood to be all stainless steel construction, not less than No. 18 gage, welded construction.
3. Hood to contain UL listed lights and aluminum baffle filters, approximately 19"x86".
4. Hood to meet NFPA 96 standards.
5. Hood and all associated work to meet International Mechanical Code, 2003 edition, Section 506.
6. Electrical work, gas piping work, fire suppression system to be performed by licensed individuals. See engineer's report.



<b>BACK BAY GRILL HOOD REPLACEMENT</b>	
SCALE: AS NOTED	APPROVED BY:
DATE: 2/10/04	DRAWN BY: BUSH
DRAWING NUMBER	

