



COPYRIGHT: Reuse or reproduction of the contents of this document is not permitted without written permission of Ripcord Engineering, Inc.

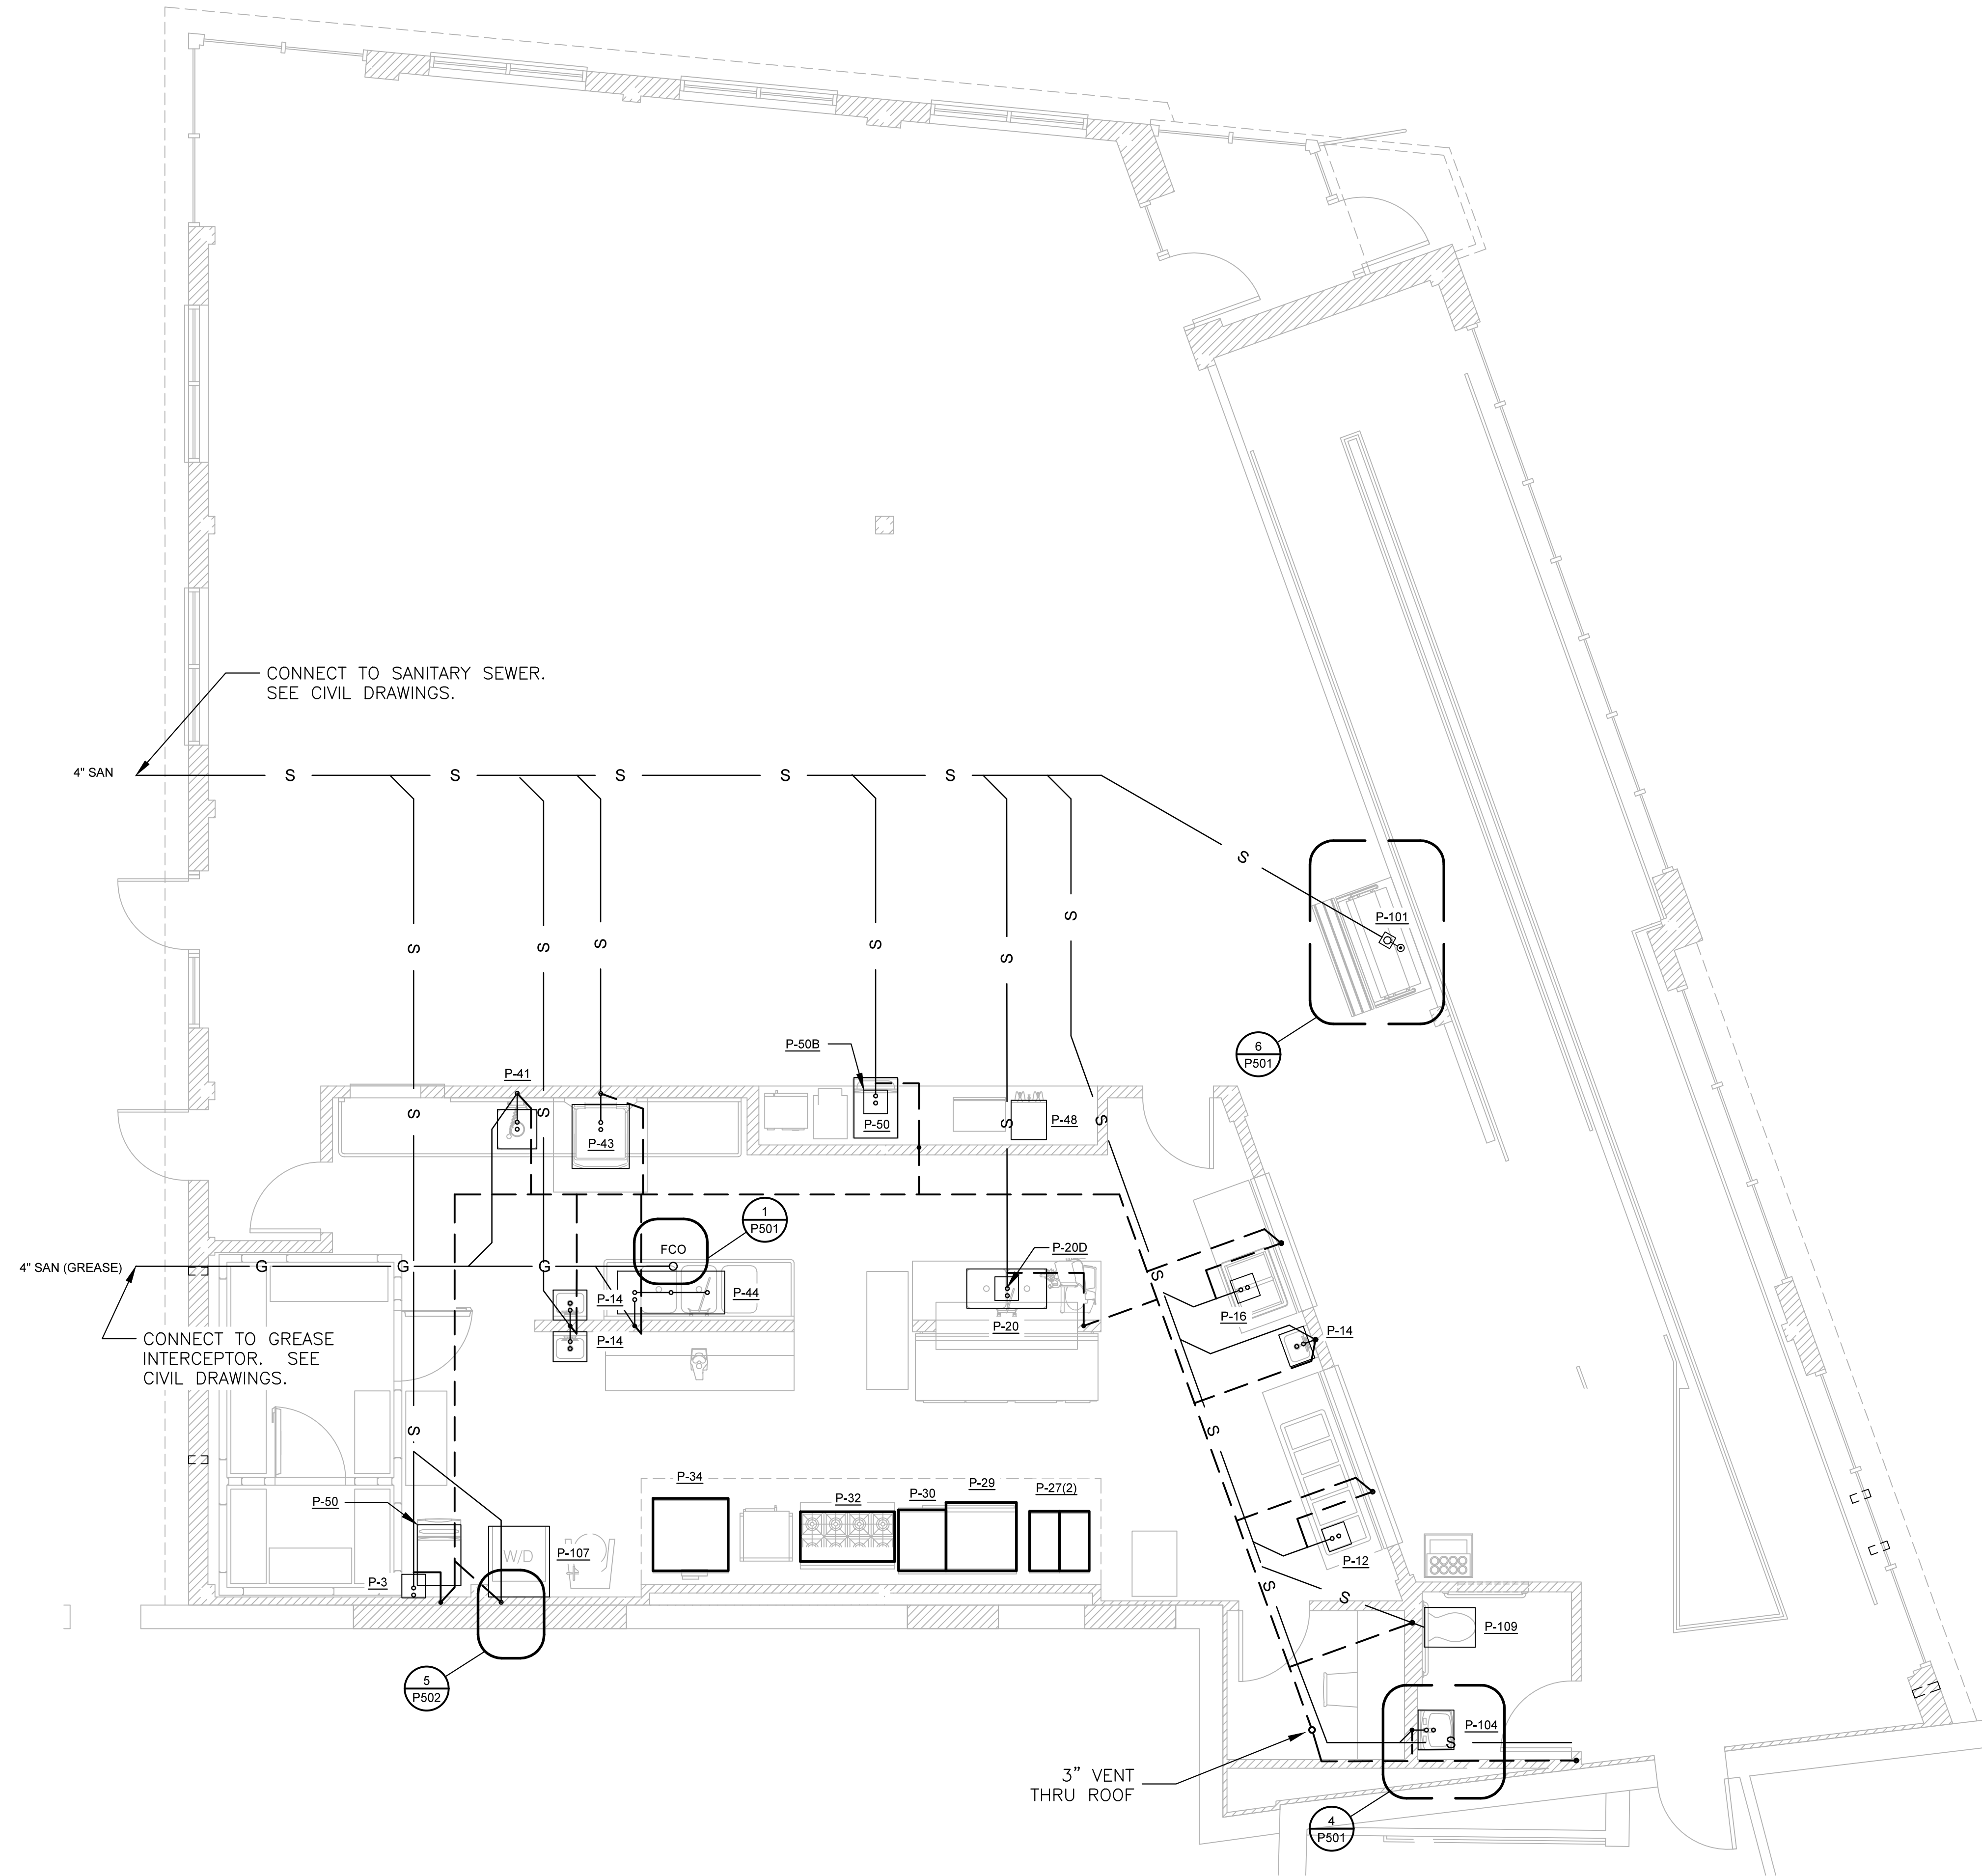

1 DINING HALL PLUMBING DWV PLAN  
1/8" = 1'0"

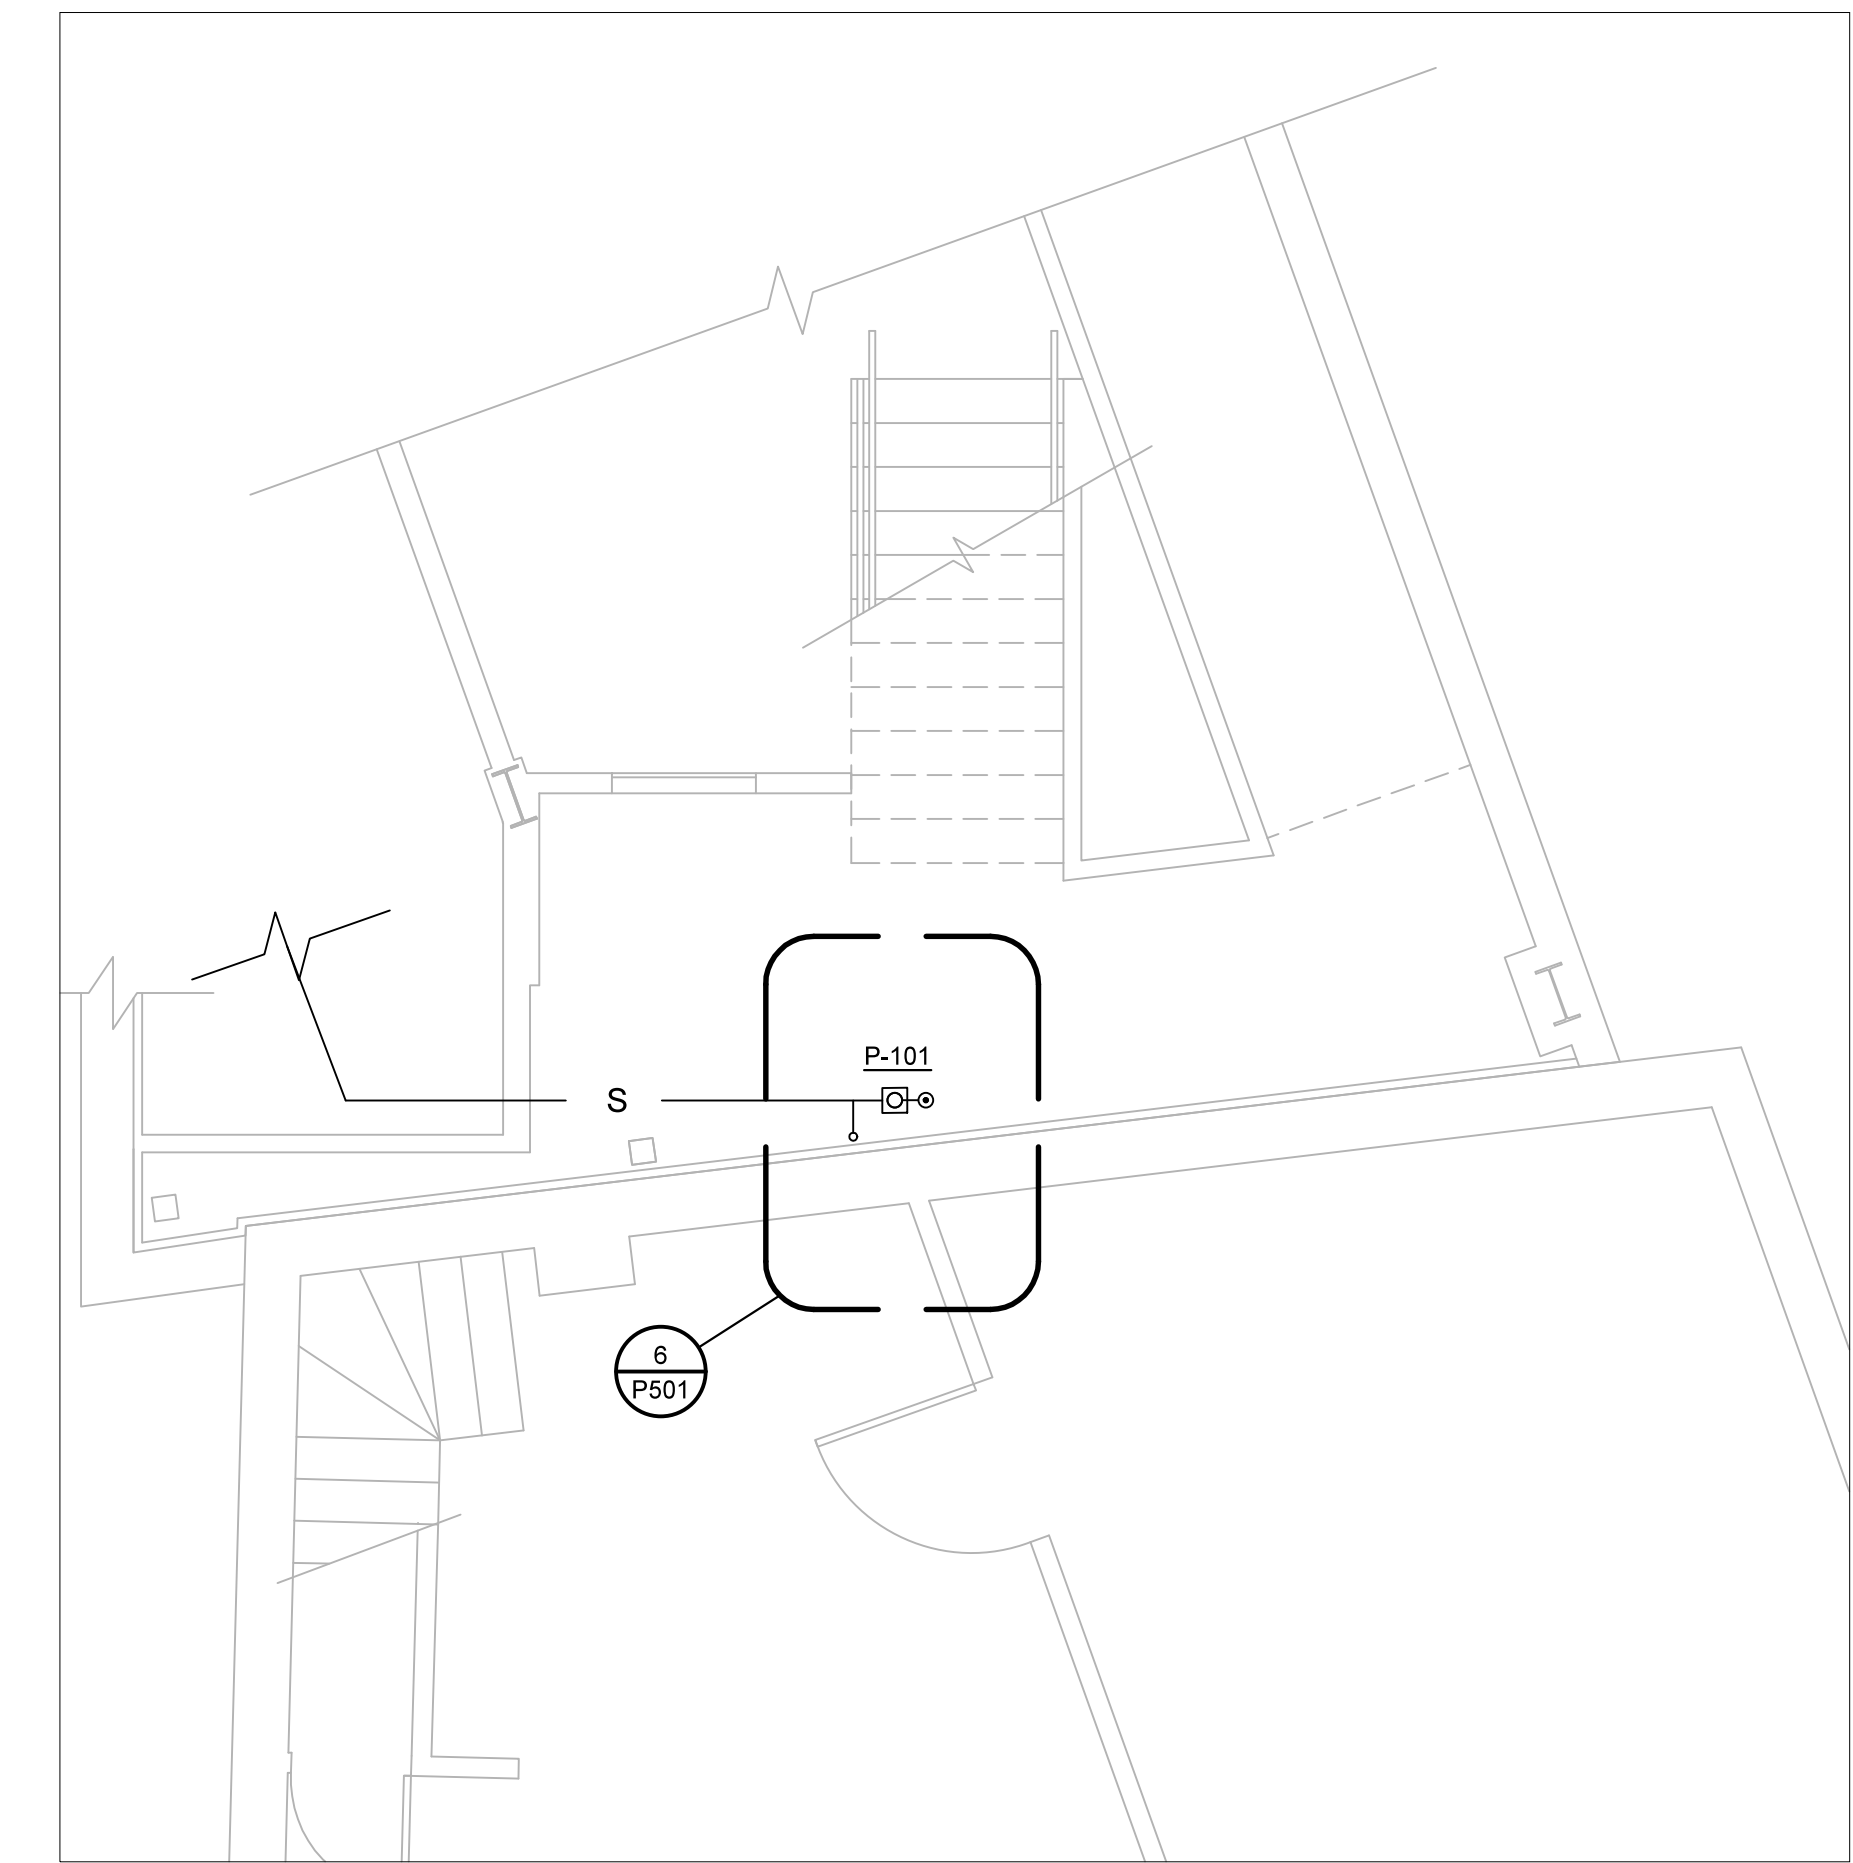

2 DINING HALL UNDER RAMP PLUMBING DWV PLAN  
1/8" = 1'0"

GENERAL NOTES

1. SEE DRAWING P400 FOR SANITARY AND VENT PIPING RISER DIAGRAM.
2. GENERAL CONTRACTOR TO PROVIDE ALL REQUIRED SLEEVES THROUGH BUILDING FOR REMOTE REFRIGERATION LINES.

REVISIONS

1	
2	
3	
4	
5	