

S Smoke Detector-replace

P Manual Pull St.-replace

Horn Horn/Strobe-replace

ADA ADA strobe-only

CS Ceiling -mounted Horn/Strobe

CRM Control Relay Module


M Municipal Box

FACP Fire Alarm Control Panel

FCPS Field Control / Power Supply

50'

Salvation Army 1st. Floor

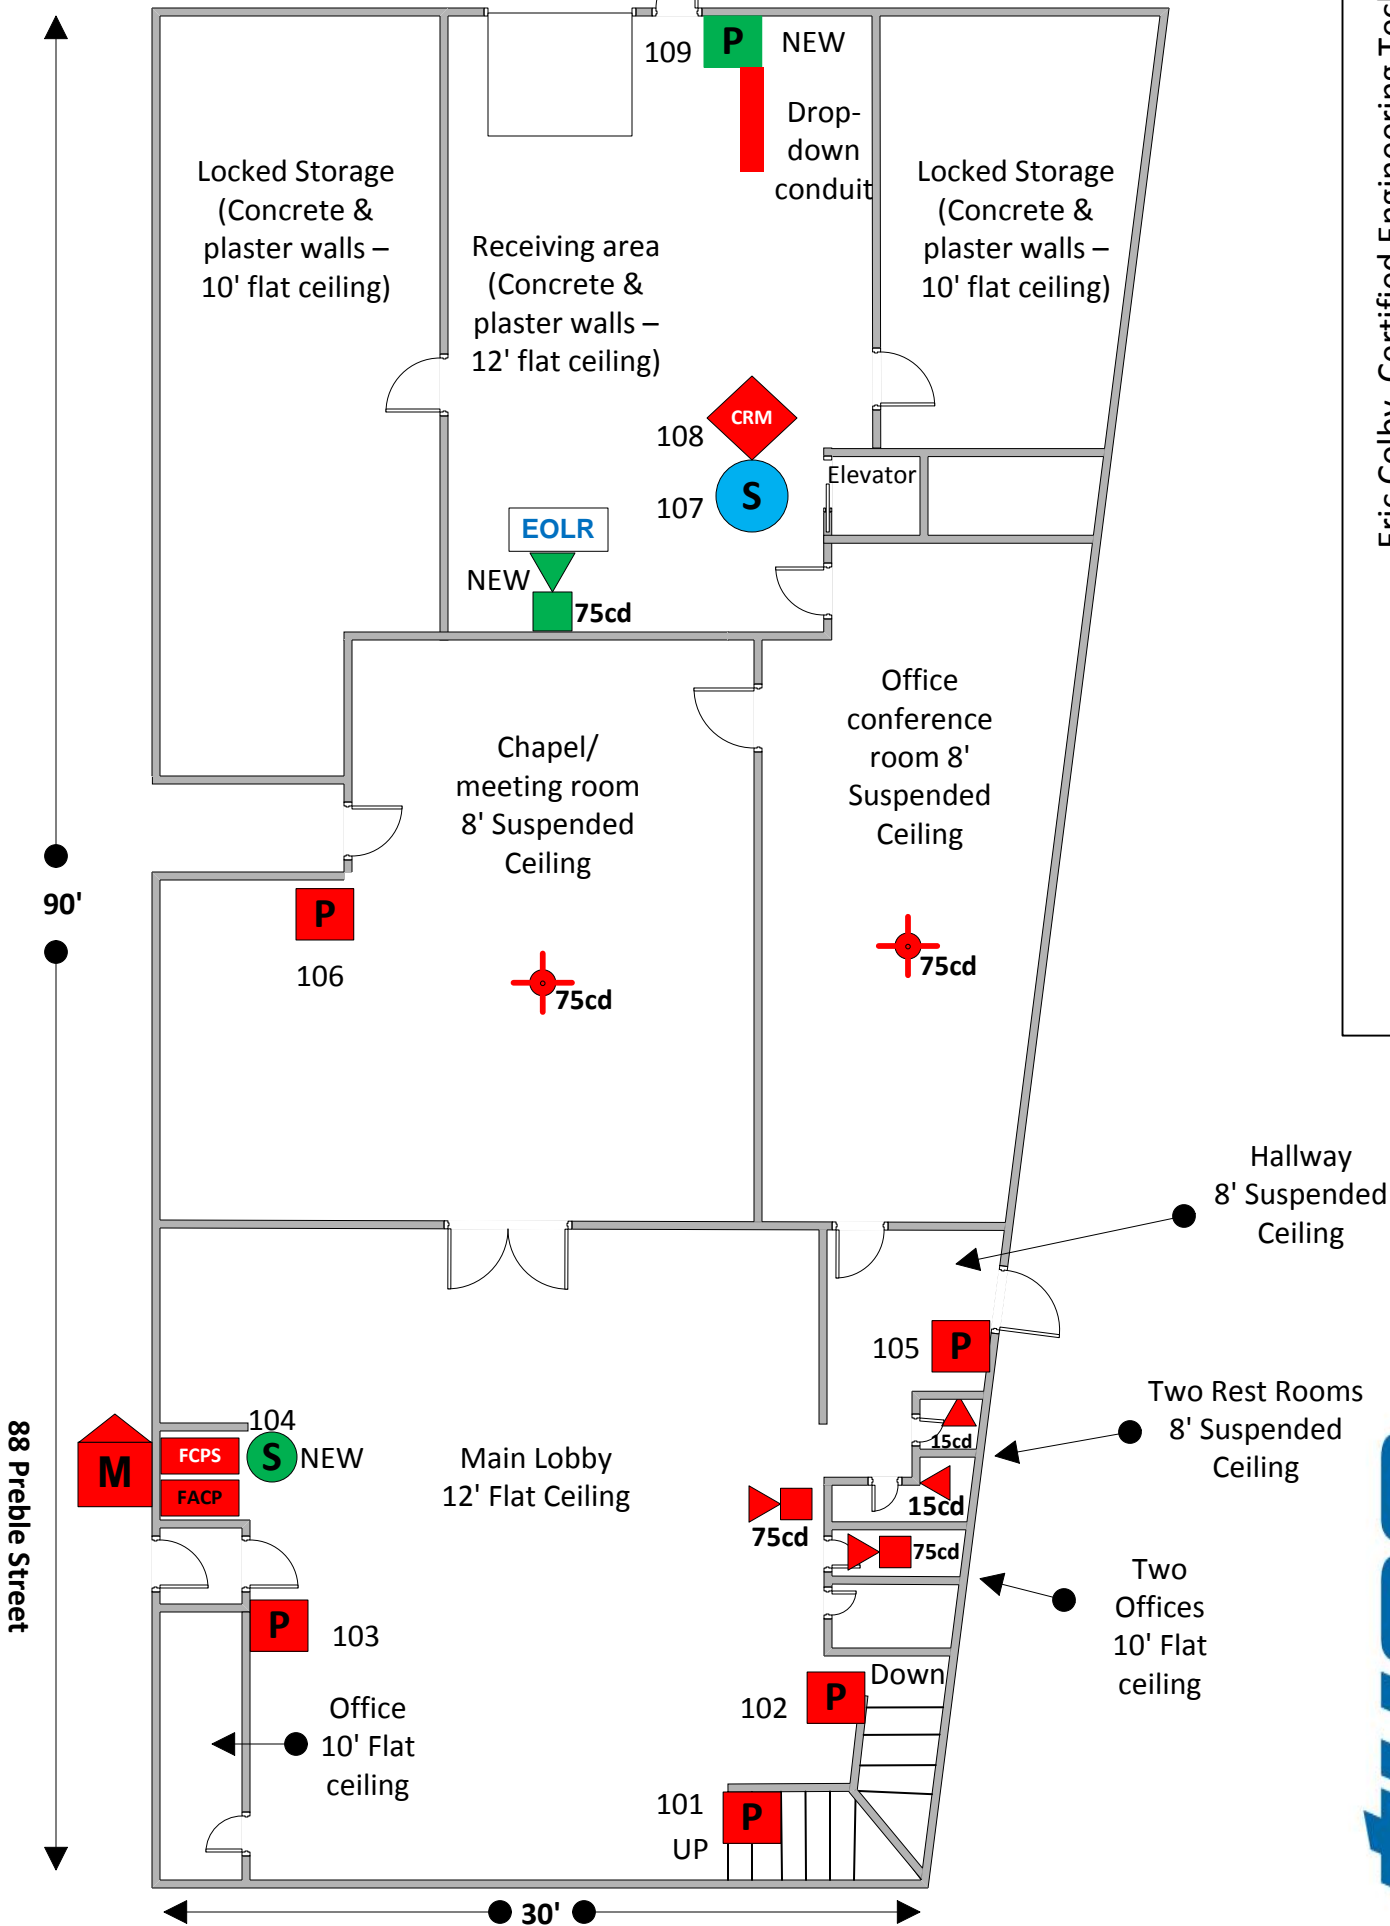

Eric Colby, Certified Engineering Technician, Level 3 NICET Cert. # 116800

Rev 0

5-1-2014

20 Thomas Drive Westbrook ME 04092

tyco
SimplexGrinnell