




Install Date: 2017
 Salvation Army Portland
 88 Preble Street
 Portland, ME 041021

Allstate Fire Equipment
 44 Garden Street
 Danvers, MA 01923
 Linc Mulno
 781-224-1001
 lmulno@lfpfire.com
 MACR 4612

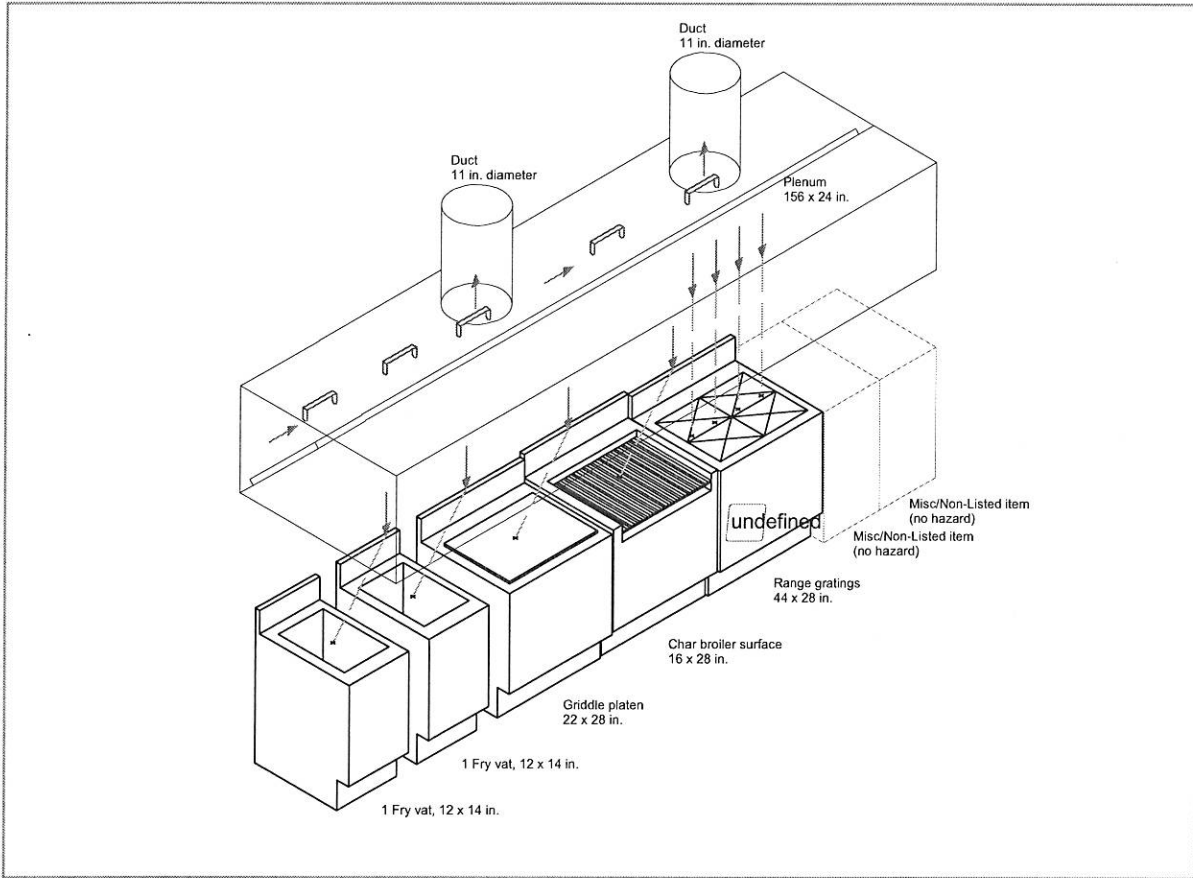

Flow Summary:

Coverage	Overall Dimensions	Nozzle	Flows	Nozzle Location
Hood: Single Bank	156 x 54 in.	1N x2	2	2-4 in. from filter face, center of height dimension, aimed down filter length.
Duct: Round	11 x 0 in.	1W	1	2-8 in. into center of duct opening, aimed up
Duct: Round	11 x 0 in.	1W	1	2-8 in. into center of duct opening, aimed up
Fryer: 1 vat	16 x 18 in.	3N	3	25-35 in., FRONT HALF of perimeter, aimed at center
Fryer: 1 vat	16 x 18 in.	3N	3	25-35 in., FRONT HALF of perimeter, aimed at center
Griddle	24 x 32 in.	1N	1	35-40 in., 0-2 in. inside perimeter, aimed at center
Char Broiler	18 x 32 in.	1N	1	15-40 in., along/within perimeter, aimed at center
Range: 2 burners	48 x 32 in.	1N x4	4	30-40 in., 0-10 in. from each burner centerline, aimed at midpoint
Total Flow Points			16	