

**EROSION AND SEDIMENT CONTROL PLAN**

THIS PLAN HAS BEEN DEVELOPED AS A STRATEGY TO CONTROL SOIL EROSION AND SEDIMENTATION DURING AND AFTER THE RE-DEVELOPMENT OF THE SCHLOTTERBECK AND FOSS BUILDING AT 117 PREBLE STREET IN PORTLAND, MAINE. THIS PLAN IS BASED ON THE MAINE EROSION AND SEDIMENTATION CONTROL HANDBOOK FOR CONSTRUCTION, BEST MANAGEMENT PRACTICES, MARCH, 2003.



**CITY OF PORTLAND  
APPROVED SITE PLAN**  
Subject to Conditions of Approval  
and Standard Conditions  
**DATE OF APPROVAL: 12.15.2015**

**PLANNER: Shukria Wiar**  
**PROJECT NO. 2015-174**

**A. PROPOSED DEVELOPMENT**

THE PROJECT CONSISTS OF THE RE-DEVELOPMENT OF AN EXISTING FIVE-STORY, 6,800 SQUARE FOOT BUILDING. THE BUILDING WILL INCLUDE 55 APARTMENT UNITS AND 2,000 S.F. OF COMMERCIAL OFFICE SPACE. THE 40,702 S.F. PARCEL CURRENTLY CONSISTS OF THE BUILDING AND A PAVED PARKING LOT AND A GRAVEL PARKING LOT; 73% OF THE EXISTING SITE IS IMPERVIOUS. THE PROPOSED IMPERVIOUS LOT IMPERVIOUS IS 27,300 S.F. OR 67% OF THE SITE.

**B. EROSION CONTROL PRACTICES/TEMPORARY MEASURES**

THE FOLLOWING TEMPORARY MEASURES TO CONTROL EROSION AND SEDIMENTATION SHALL BE UTILIZED:

EACH GROUND AREA, OPENED OR EXPOSED, WHETHER DIRECTLY OR INDIRECTLY DUE TO THE DEVELOPMENT, SHALL BE MINIMIZED AND SHALL BE STABILIZED WITHIN 15 DAYS OF INITIAL DISTURBANCE OF SOIL AND SHALL BE PERMANENTLY STABILIZED WITHIN SEVEN DAYS OF FINAL GRADING. THIS STATUTE APPLIES TO DISTURBED AREAS BEYOND THE LIMITS OF THE PROPOSED BUILDING. EXPOSED AREAS SHALL BE STABILIZED PRIOR TO A RAIN EVENT.

TEMPORARY SOIL STABILIZATION SHALL BE EITHER BY TEMPORARY MULCHING, TEMPORARY SEEDING, PERMANENT BASE GRAVEL, OR ASPHALT BINDER COURSE AS FOLLOWS:

**TEMPORARY SEEDING:** SEED SHALL BE AROOSTOOK RYE APPLIED AT 2.60#/1,000 SF. LIME SHALL BE AGRICULTURAL GROUND LIMESTONE APPLIED AT 1.36#/1,000 SF. FERTILIZER SHALL BE 10-10-10 CLASSIFICATION APPLIED AT 1.36#/1,000 SF. MULCH SHALL CONSIST OF HAY AND STRAW MULCH AND SPREAD EVENLY AT A RATE OF 70-90#/1,000 SF. TEMPORARY SEEDINGS SHALL ONLY BE MADE BETWEEN APRIL 15 AND OCTOBER 1, AND SHALL NOT BE PLACED OVER SNOW.

**TEMPORARY MULCHING:** MULCH SHALL CONSIST OF CHOPPED HAY OR STRAW MULCH AND SPREAD BY MECHANICAL BLOWER EVENLY AT A RATE OF 150-200#/1,000 SF. TEMPORARY MULCH SHALL BE REMOVED PRIOR TO PERMANENT SOIL STABILIZATION. MULCH MUST NOT BE PLACED OVER SNOW. SNOW SHALL BE REMOVED PRIOR TO MULCHING.

**PERMANENT BASE GRAVEL:** BASE GRAVEL UNDER PAVEMENT SHALL BE SUITABLE AS TEMPORARY SOIL STABILIZATION UNDER THE FOLLOWING CONDITIONS:  
a) SLOPES SHALL BE LESS THAN EIGHT PERCENT;  
b) GRAVEL SHALL MEET THE SPECIFICATIONS FOR BASE OR SUBBASE GRAVEL FOR THE PROPOSED COMPLETED PAVEMENT.

**C. EROSION CONTROL PRACTICES/PERMANENT MEASURES**

THE FOLLOWING PERMANENT MEASURES TO CONTROL EROSION AND SEDIMENTATION SHALL BE UTILIZED:

1. PERMANENT SEEDING SHALL BE PERFORMED DURING CONSTRUCTION OPERATIONS AS EACH DISTURBED AREA HAS BEEN BROUGHT TO FINISH GRADE. PERMANENT SEEDINGS SHALL BE MADE AS DORMANT SEEDING AFTER THE FIRST KILLING FROST. DORMANT SEEDING AND MULCH SHALL BE USED AT TWO TIMES THE PERMANENT SEEDING AND MULCHING RATE SHOWN BELOW FOR BOTH LAWN AS WELL AS EMBANKMENTS. SEED, LOAM, LIME, FERTILIZER AND MULCH ARE TO BE AS FOLLOWS:

**SEED:** THE SEED MIXTURE SHALL CONSIST OF SEED PROPORTIONED BY WEIGHT. ALL SEED SHALL BE FRESH, CLEAN, "NEW CROP" SEED. HARMLESS INERT MATTER AND WEED SEEDS SHALL BE PERMITTED UP TO ONE PERCENT OF THE GROSS WEIGHT OF EACH VARIETY OF SEED. ALL SEED SUPPLIED SHALL BE PACKED IN APPROVED CONTAINERS BEARING THE MANUFACTURER'S NAME AND ANALYSIS OF CONTENTS. THE FOLLOWING MATERIALS AND APPLICATION RATES SHALL BE REQUIRED FOR PERMANENT SEEDING:

LAWN:	
CREeping RED RESCUE:	0.69#/1,000 SF
KENTUCKY BLUEGRASS:	0.57#/1,000 SF
PERENNIAL RYEGRASS:	0.46#/1,000 SF
RETOP:	0.12#/1,000 SF
TOTAL:	1.84#/1,000 SF

**LOAM:** SHALL BE FREE OF GRASSES, ROOTS, LARGE STONE AND INORGANIC DEBRIS. PLACE LOAM AT FOUR INCHES MINIMUM DEPTH OVER ALL DISTURBED AREAS. FINAL GRADING OF ALL LAWN AREAS TO BE APPROVED BY LANDSCAPE ARCHITECT BEFORE SEEDING.

**LIME:** LIME SHALL BE AGRICULTURAL GROUND LIMESTONE AND APPLIED AS PER RECOMMENDATION OF A STATE COMMERCIAL SOIL TESTING LABORATORY. FERTILIZER: FERTILIZER SHALL BE 10-20-20 CLASSIFICATION AND APPLIED AS PER RECOMMENDATION OF A STATE COMMERCIAL SOIL TESTING LABORATORY.

**MULCH:** MULCH SHALL CONSIST OF HAY OR STRAW MULCH. MULCH SHALL BE SPREAD EVENLY AT A RATE OF TWO AND ONE HALF TONS PER ACRE OVER ALL SEEDING. AFTER APPLICATION, THE MULCH SHALL BE THOROUGHLY WETTED. IN STEEP AREAS, THE MULCH SHALL BE HELD IN PLACE BY THE USE OF JUTE EROSION CONTROL NETTING OR APPROVED ALTERNATIVE NETTING MATERIAL. NOTE: ALL EXPOSED SOIL MUST BE COVERED REGARDLESS OF MULCHING RATES SPECIFIED.

THE CONTRACTOR SHALL MAINTAIN THE SEEDED AND MULCHED AREAS UNTIL FINAL ACCEPTANCE OR THE WORK. MAINTENANCE SHALL CONSIST OF PROVIDING PROPER WATERING, PROTECTION AGAINST TRAFFIC AND REPAIRING ANY AREAS DAMAGED DUE TO WIND, WATER, EROSION, FIRE OR OTHER CAUSES. SUCH DAMAGED AREAS SHALL BE REPAIRED TO REESTABLISH THE CONDITION AND GRADE OF THE SOIL PRIOR TO SEEDING AND SHALL THEN BE REFERTILIZED, RESEEDED AND REMULCHED.

**D. WINTER CONDITIONS**

EXCAVATION AND EARTHWORK SHALL BE COMPLETED SUCH THAT NO MORE THAN 1 ACRE OF THE SITE IS WITHOUT STABILIZATION AT ANY ONE TIME. LIMIT THE EXPOSED AREA TO THOSE AREAS IN WHICH WORK IS EXPECTED TO BE UNDERTAKEN DURING THE PROCEEDING 15 DAYS AND THAT CAN BE MULCHED IN ONE DAY PRIOR TO ANY SNOW EVENT. HAY AND STRAW MULCH RATE SHALL BE A MINIMUM OF 150 LBS./1,000 S.F. (3 TONS/ACRE) AND SHALL BE PROPERLY ANCHORED. THE CONTRACTOR SHALL INSTALL ANY ADDED MEASURES WHICH MAY BE NECESSARY TO CONTROL EROSION/SEDIMENTATION FROM THE SITE, DEPENDENT UPON THE ACTUAL SITE AND WEATHER CONDITIONS. CONTINUATION OF EARTHWORK OPERATIONS ON ADDITIONAL AREAS SHALL NOT BEGIN UNTIL THE EXPOSED SOIL SURFACE ON THE AREA BEING WORKED HAS BEEN STABILIZED, IN ORDER TO MINIMIZE AREAS WITHOUT EROSION CONTROL PROTECTION.


**E. CONSTRUCTION SEQUENCE**

- THE GENERAL SEQUENCE OF WORK SHALL BE AS FOLLOWS:
1. INSTALL EROSION CONTROL DEVICES. (SILT FENCE, STABILIZED CONSTRUCTION ENTRANCE AND OR SEDIMENT BARRIER.)
  2. TEMPORARILY STABILIZE DISTURBED AREAS BY MULCHING ALL EXPOSED SOIL WITHIN 15 DAYS OF INITIAL DISTURBANCE.
  3. INSTALL STORMWATER SYSTEM.
  4. COMPLETE SITE CONSTRUCTION WORK;
  5. CONSTRUCT PAVED ACCESS AND PARKING AREAS;
  6. INSTALL PERMANENT VEGETATION ON ALL EXPOSED AREAS WITHIN 15 DAYS OF FINAL GRADING; AND
  7. PERFORM CONTINUING MAINTENANCE ON ALL EROSION AND SEDIMENTATION CONTROL DEVICES AND MEASURES.

**F. SITE INSPECTION & MAINTENANCE**


WEEKLY INSPECTIONS, AS WELL AS ROUTINE INSPECTIONS FOLLOWING RAINFALLS OF 0.5" OVER A CONSECUTIVE 24-HOUR PERIOD, SHALL BE CONDUCTED BY THE SITE CONTRACTOR OF ALL TEMPORARY AND PERMANENT EROSION CONTROL DEVICES UNTIL FINAL ACCEPTANCE OF THE PROJECT. NECESSARY REPAIRS SHALL BE MADE TO CORRECT UNDERMINING OR DETERIORATION. FINAL ACCEPTANCE SHALL INCLUDE A SITE INSPECTION TO VERIFY THE STABILITY OF ALL DISTURBED AREAS AND SLOPES, UNTIL FINAL INSPECTION, ALL EROSION AND SEDIMENTATION CONTROL MEASURES SHALL IMMEDIATELY BE CLEANED, AND REPAIRED BY THE SITE CONTRACTOR AFTER STORM EVENTS. DISPOSAL OF ALL TEMPORARY EROSION CONTROL DEVICES SHALL BE THE RESPONSIBILITY OF THE SITE CONTRACTOR.

CONTINUED TEMPORARY MAINTENANCE AND LONG TERM PROVISIONS FOR PERMANENT MAINTENANCE OF ALL EROSION AND SEDIMENTATION CONTROL FACILITIES AFTER ACCEPTANCE OF THE PROJECT SHALL BE THE RESPONSIBILITY OF THE SCHLOTTERBECK BLOCK LLC.

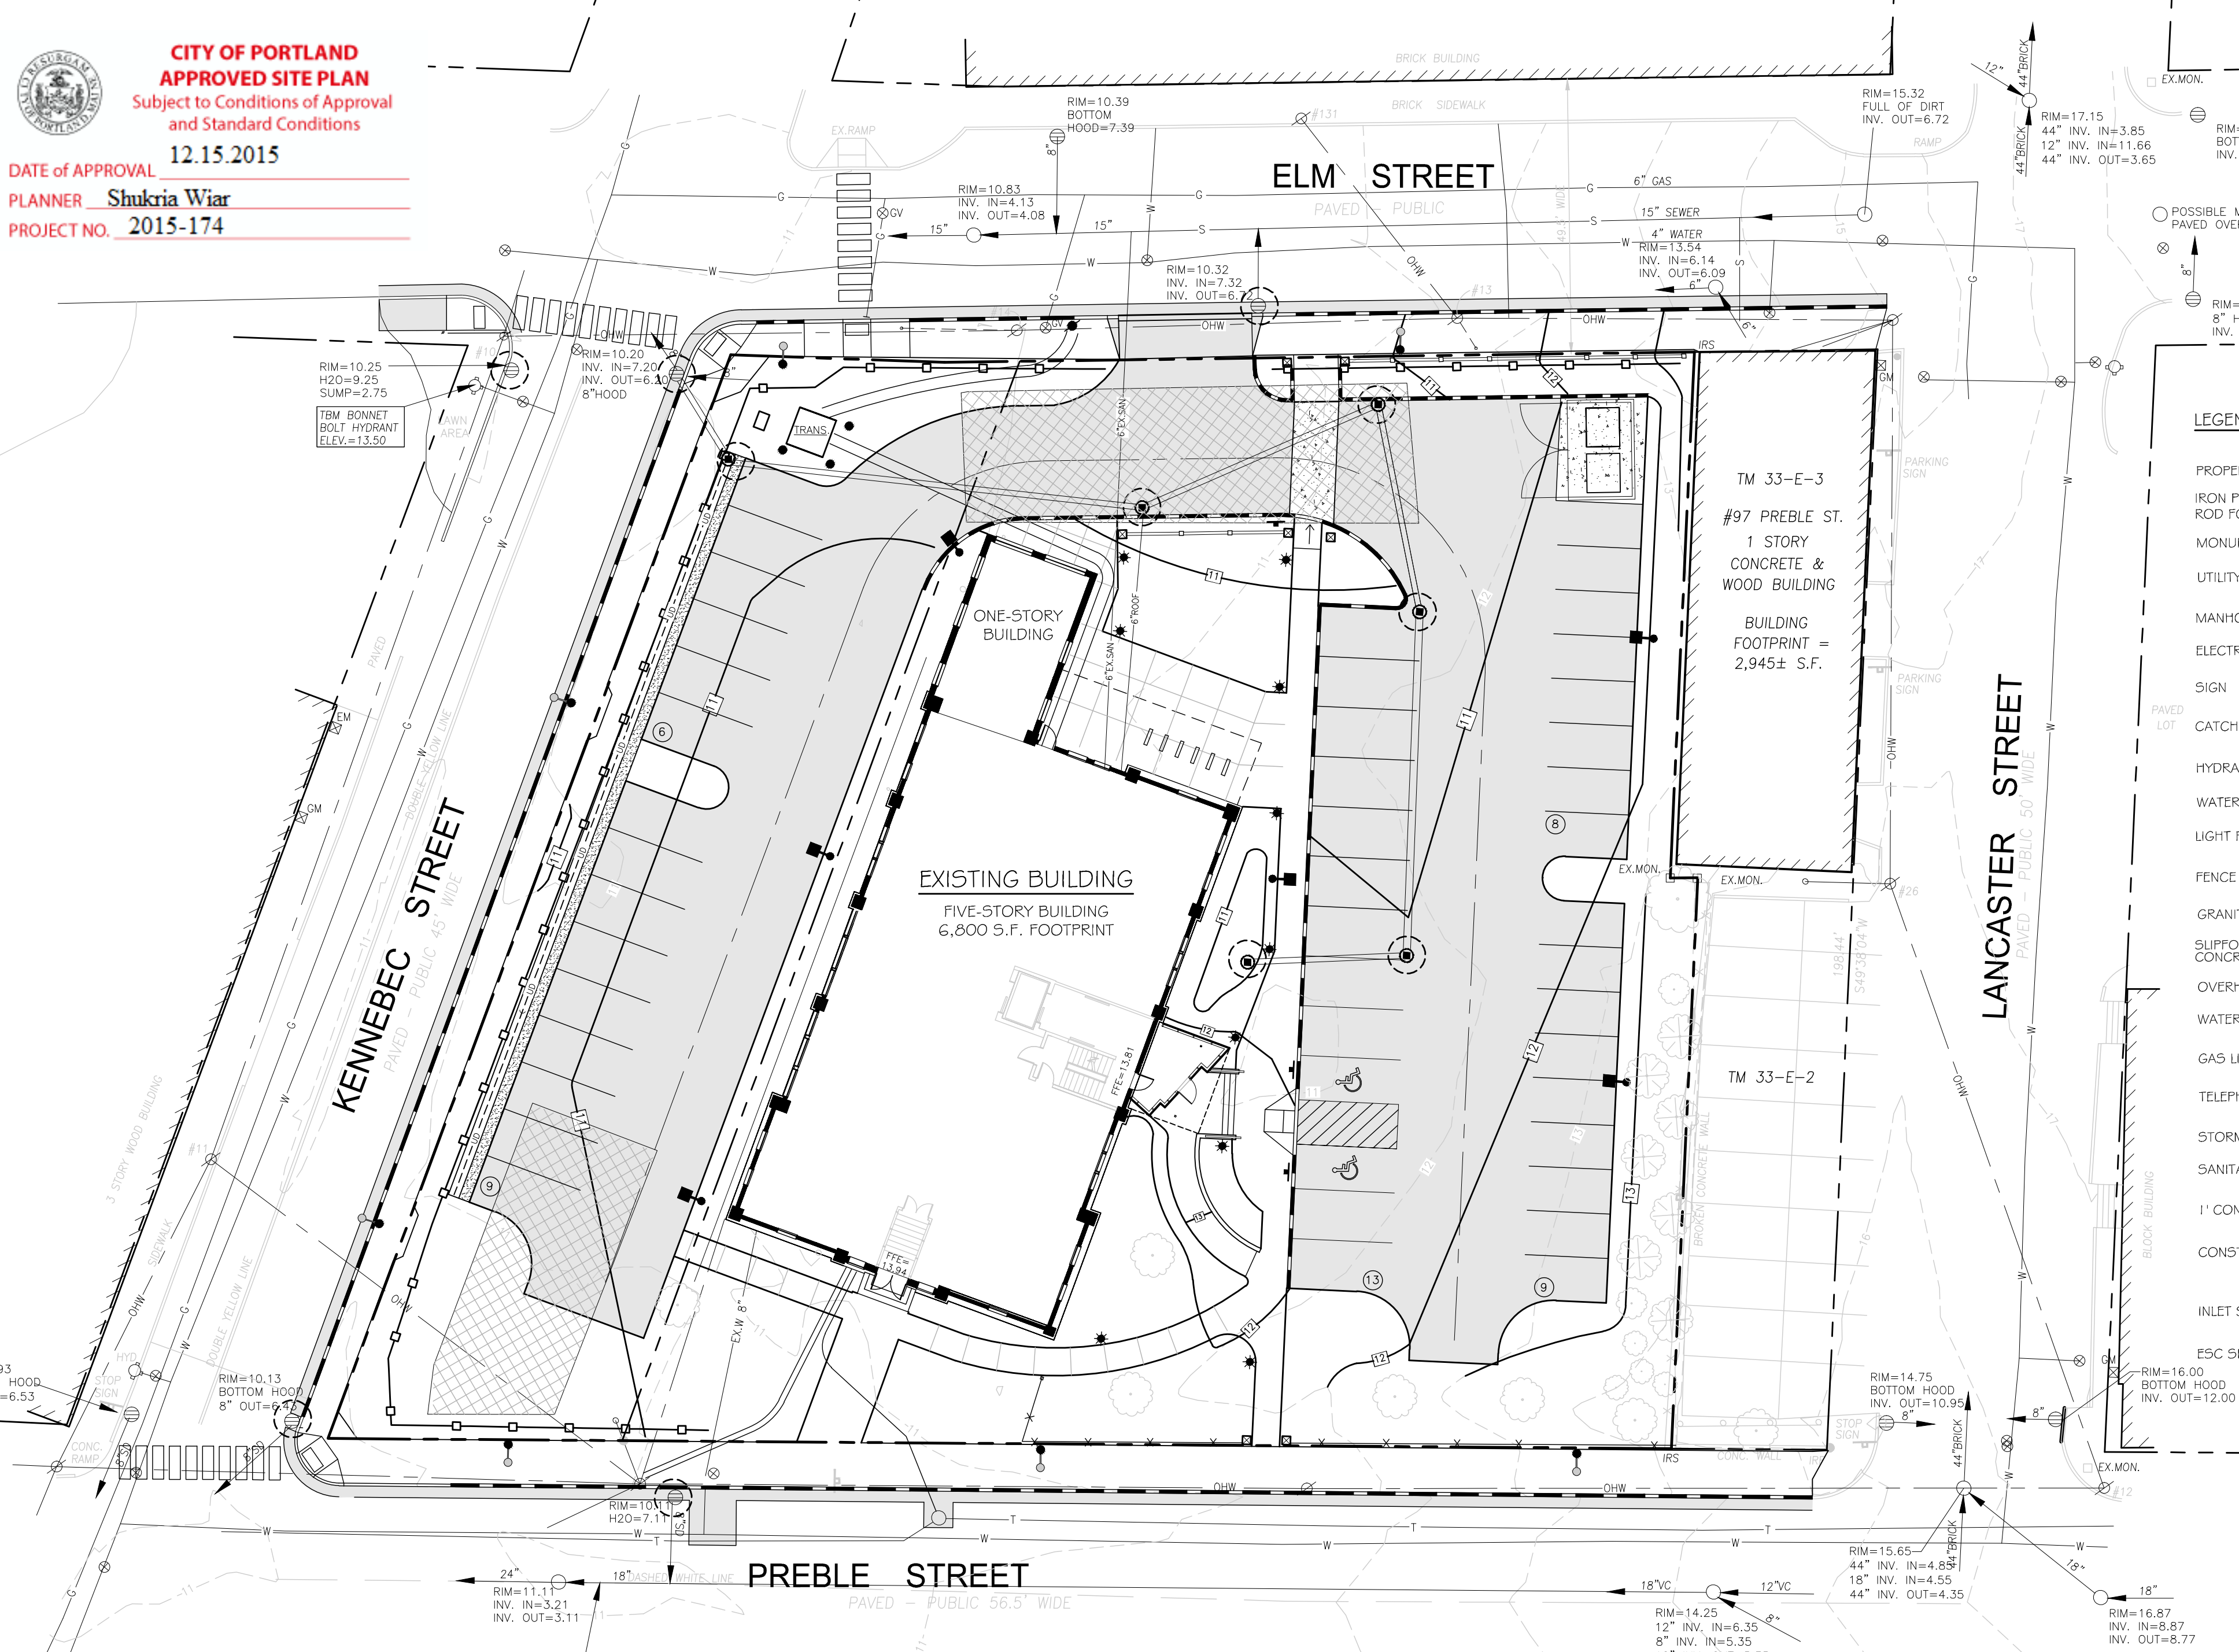


**LEGEND**


	EXISTING	PROPOSED
PROPERTY LINE	[Symbol]	[Symbol]
IRON PIPE OR ROD FOUND	[Symbol]	[Symbol]
MONUMENT FOUND	[Symbol]	[Symbol]
UTILITY POLE	[Symbol]	[Symbol]
MANHOLE	[Symbol]	[Symbol]
ELECTRIC/GAS METER	[Symbol]	[Symbol]
SIGN	[Symbol]	[Symbol]
CATCH BASIN	[Symbol]	[Symbol]
HYDRANT	[Symbol]	[Symbol]
WATER VALVE	[Symbol]	[Symbol]
LIGHT POLE	[Symbol]	[Symbol]
FENCE	[Symbol]	[Symbol]
GRANITE CURB	[Symbol]	[Symbol]
SURFORM CONCRETE CURB	[Symbol]	[Symbol]
OVERHEAD WIRES	[Symbol]	[Symbol]
WATER LINE	[Symbol]	[Symbol]
GAS LINE	[Symbol]	[Symbol]
TELEPHONE	[Symbol]	[Symbol]
STORM DRAIN	[Symbol]	[Symbol]
SANITARY SEWER	[Symbol]	[Symbol]
1' CONTOUR	[Symbol]	[Symbol]
CONSTRUCTION ENTRANCE	[Symbol]	[Symbol]
INLET SEDIMENT CONTROL DEVICE	[Symbol]	[Symbol]
ESC SILT FENCE	[Symbol]	[Symbol]

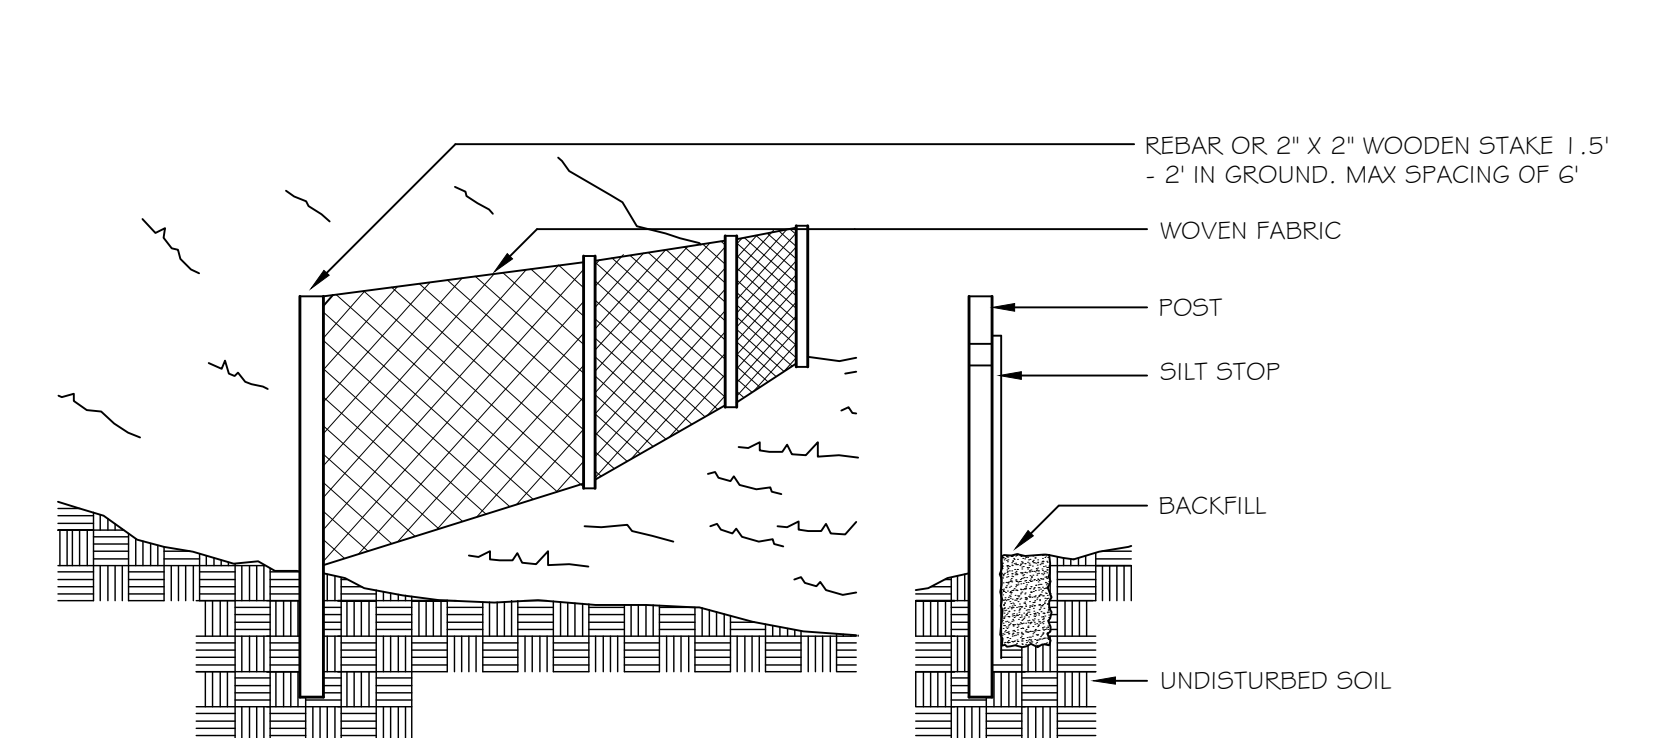

1. SILT FENCE TO BE INSTALLED PARALLEL TO EXISTING CONTOURS DOWNSLOPE FROM AREAS OF SOIL DISTURBANCE.
2. SILT FENCE TO BE SECURELY ATTACHED TO THE UPSLOPE SIDE OF THE SUPPORTING STAKES.
3. BOTTOM 4 TO 6 INCHES OF SILT FENCE TO BE BURIED IN SLOPE AND BACKFILLED WITH COMPACTED SOIL.
4. INSPECTION SHALL BE MADE AFTER EVERY RAINFALL WITH REMOVAL OF EXCESSIVE SEDIMENT AND REPAIR OF THE FENCE ACCOMPLISHED PROMPTLY.
5. SILT FENCE AND ACCUMULATED SEDIMENT SHALL BE REMOVED AS SOON AS PERMANENT EROSION CONTROL MEASURES HAVE BEEN ESTABLISHED.

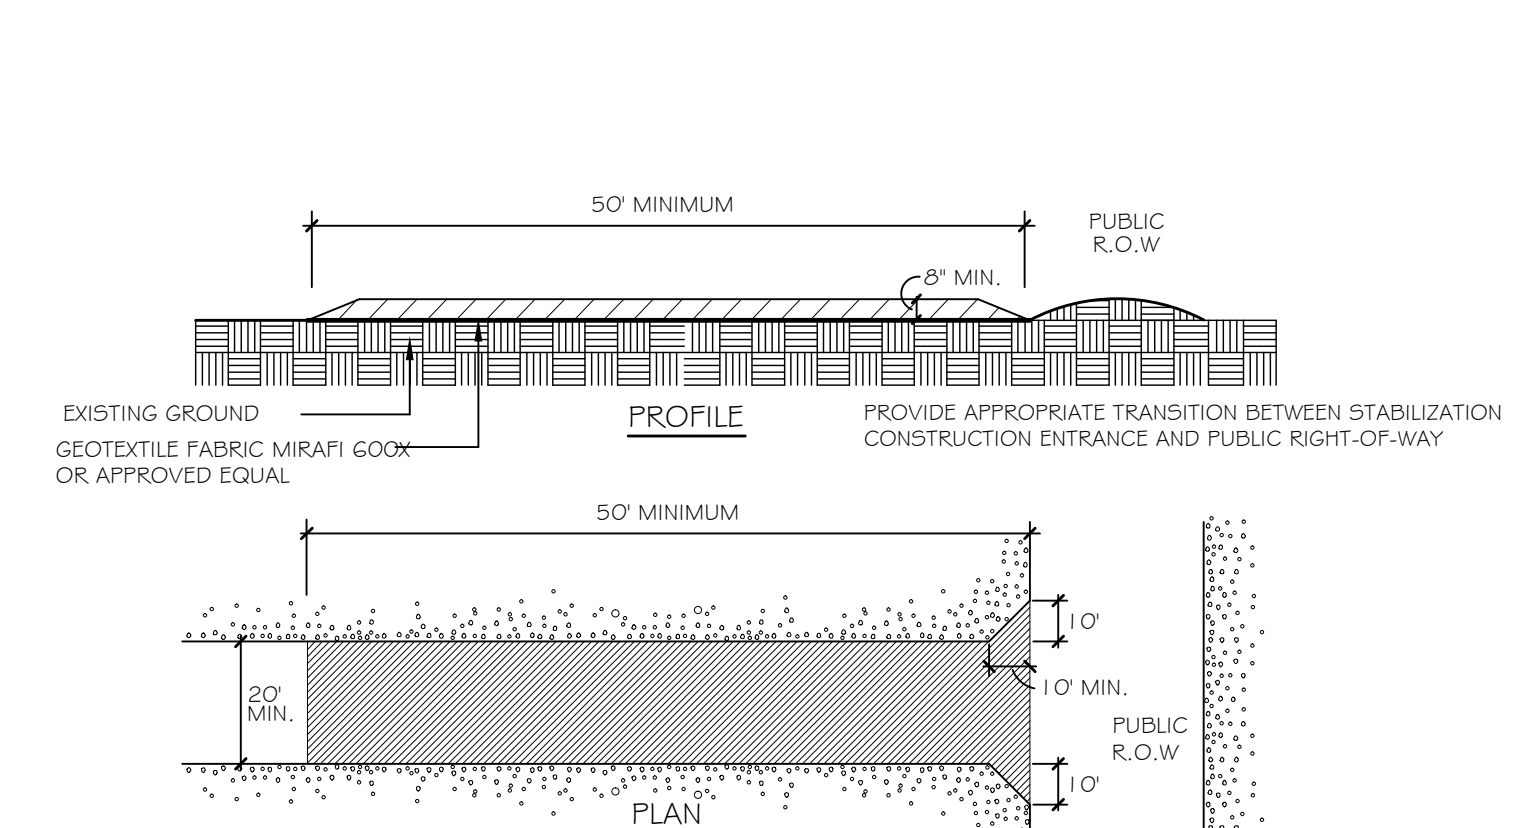

- CONSTRUCTION SPECIFICATIONS:**
1. "STONE SIZE": ASTM DESIGNATION M 43, SIZE NO. 2 (2.5" TO 1.5"). USE CRUSHED STONE.
  2. LENGTH: AS EFFECTIVE, BUT NOT LESS THAN 50 FEET.
  3. THICKNESS: NOT LESS THAN EIGHT (8) INCHES.
  4. WIDTH: NOT LESS THAN FULL WIDTH OF ALL POINT OF INGRESS OR EGRESS.
  5. WASHING: WHEN NECESSARY, WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHT-OF-WAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE WHICH DRAINS INTO AN APPROVED SEDIMENT TRAP OR SEDIMENT BASIN. ALL SEDIMENT SHALL BE PREVENTED FROM ENTERING ANY STORM DRAIN, DITCH, OR WATERCOURSE THROUGH THE USE OF SAND BAGS, GRAVEL, BOARDS OR OTHER APPROVED METHODS.
  6. MAINTENANCE: THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHT-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONES AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED, OR TRACKED ONTO PUBLIC RIGHT-OF-WAY MUST BE REMOVED IMMEDIATELY.

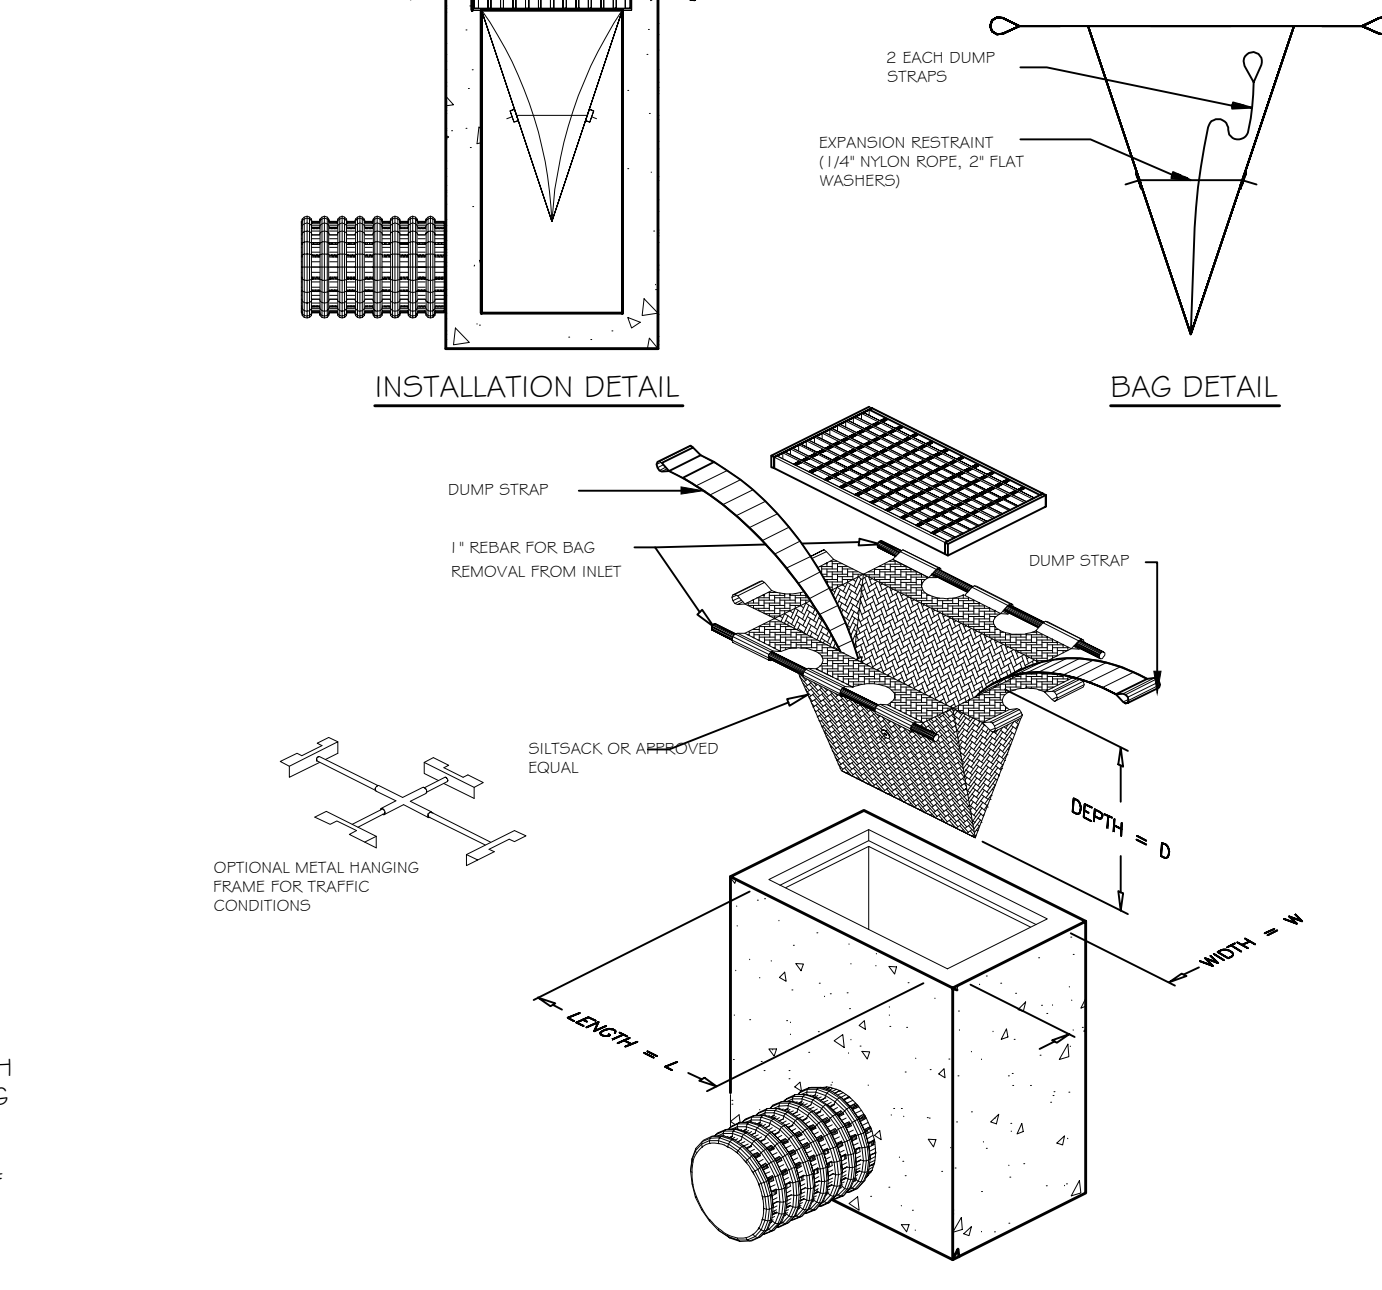

1 SILT FENCE NOT TO SCALE

2 STABILIZED CONSTRUCTION ENTRANCE NOT TO SCALE

3 INLET SEDIMENT CONTROL DEVICE NOT TO SCALE

Prepared For:  
Owner and Applicant:  
**SCHLOTTERBECK BLOCK L.L.C.**  
104 Grant Street  
Portland, Maine 04101  
Tel.: 207-650-8979

Prepared By:  
**MITCHELL & ASSOCIATES**  
Landscape Architects  
70 Center Street  
Portland, Maine 04101  
Tel.: 207-774-4427

**RANSOM CONSULTING ENGINEERS**  
400 Commercial Street # 4  
Portland, Maine 04101  
Phone: 207-772-2891

**GODUTI-THOMAS ARCHITECTS**  
44 Oak Street # 2  
Portland, Maine 04101  
Phone: 207-775-3184

**The Schlotterbeck Block**  
Portland, Maine  
117 Preble Street


Date: **OCTOBER 5, 2015**

Issued For:

- Revisions:
- DEC. 1, 2015: REVISED PER STAFF REVIEW COMMENTS
  - DEC. 10, 2015: REVISED PER STAFF REVIEW COMMENTS
  - FEB. 25, 2016: REVISED PER CONDITIONS OF APPROVAL

Reproduction or reuse of this document without the expressed written consent of Mitchell & Associates is prohibited. © 2016

Title:  
**EROSION AND SEDIMENT CONTROL PLAN**

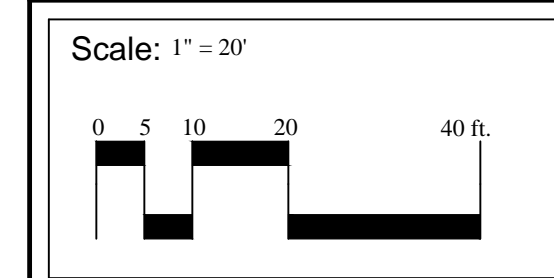

North: [Symbol]

Sheet No.: **L4.0**