

© 2016 RYAN SENATORE ARCHITECTURE

**ADDITION TO BAYSIDE BOWL**  
**ALDER STREET**  
**PORTLAND, MAINE**

**RSA**  
 RYAN SENATORE ARCHITECTURE  
 565 CONGRESS STREET  
 PORTLAND, MAINE 04101  
 207-650-6414  
 senatorearchitecture.com


CONSULTANTS:  
 STRUCTURAL: Structural Integrity  
 77 Oak Street  
 Portland, ME 04101  
 207-774-4614

REVISIONS:  
 1 REVISION #1 - 03/11/16


DATE: JANUARY 29, 2016  
 PROJECT No. 1452  
 DRAWN BY: JPF / RRT / RJS  
 CHECKED BY: RJS  
 SCALE: AS NOTED

SHEET TITLE:  
**WINDOW SCHEDULE**

**A7-0**

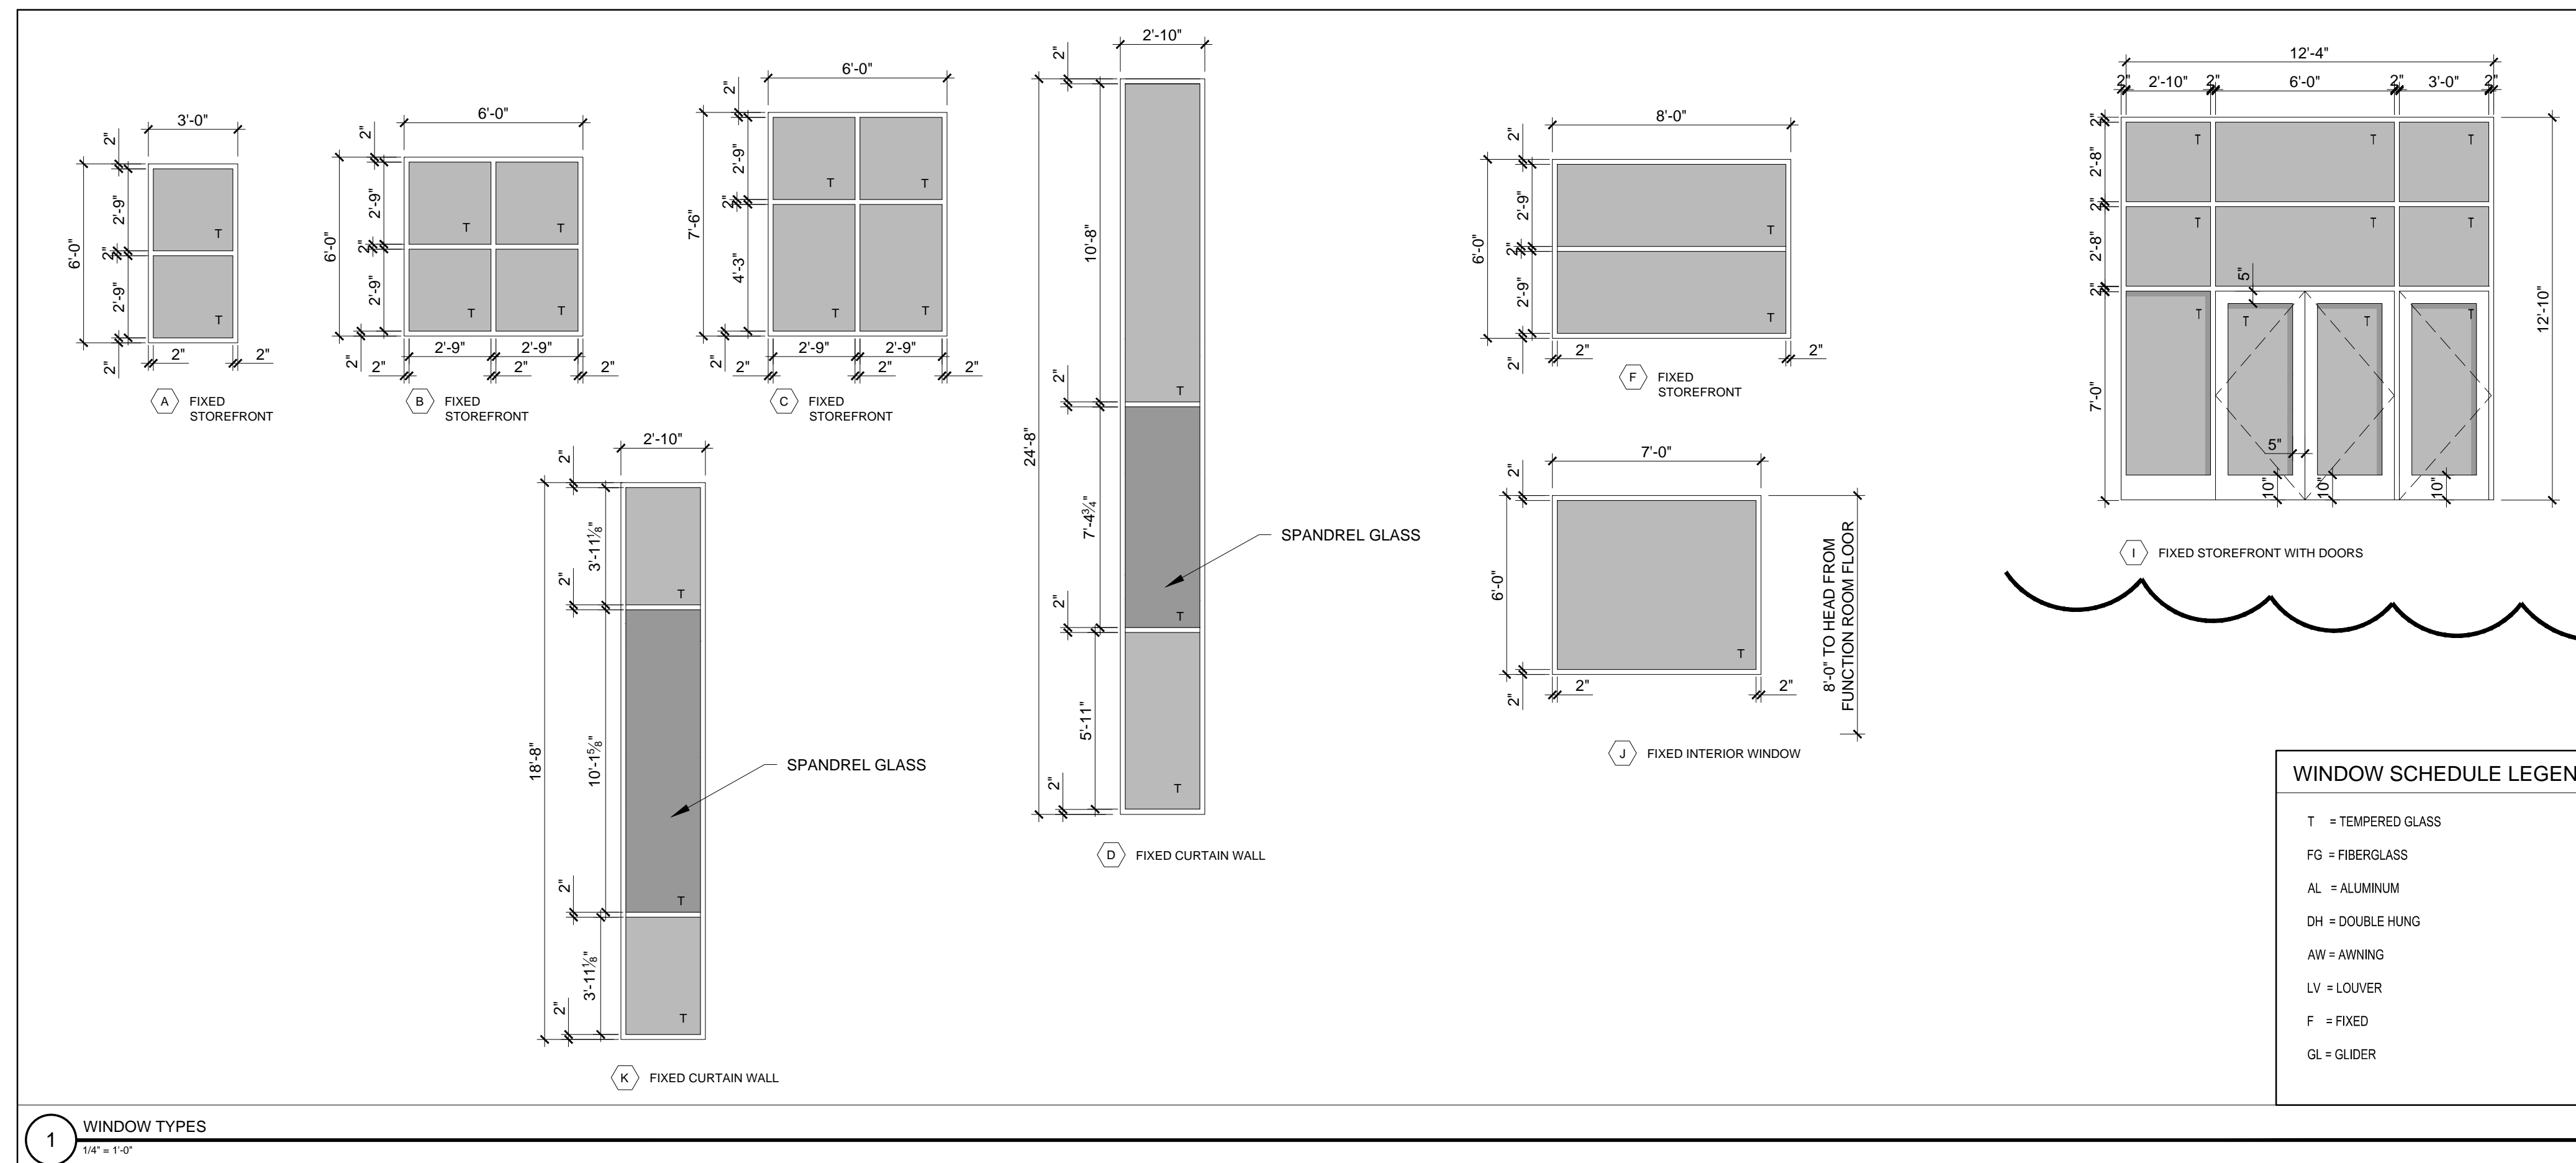

WINDOW SCHEDULE										
KEY	ACTION	ROUGH * OPENING (WxH) VIF	R.O. HEAD HEIGHT FROM SUB FLOOR	DETAILS			MATERIAL	FINISH	REMARKS	FOR THERMED GLASS LOCATIONS SEE WINDOW ELEVATION TYPES FOR MASONRY OPENING DIMENSIONS COORDINATE COURSING WITH EXTERIOR ELEVATION SHEETS AND PLAN AND SECTION DETAIL SHEETS
				HEAD	JAMB	SILL				
A	F	3'-0-1/2" X 6'-0-1/2"	-	-	-	-	AL	PTD	THERMALLY BROKEN STOREFRONT WITH SUB SILL, TEMPERED INSULATED GLAZING UNITS	
B	F	6'-0-1/2" X 6'-0-1/2"	-	-	-	-	AL	PTD	THERMALLY BROKEN STOREFRONT WITH SUB SILL, TEMPERED INSULATED GLAZING UNITS	
C	F	6'-0-1/2" X 7'-6-1/2"	-	-	-	-	AL	PTD	THERMALLY BROKEN STOREFRONT WITH SUB SILL, TEMPERED INSULATED GLAZING UNITS	
D	F	2'-10-1/2" X 24'-8-1/2"	-	-	-	-	AL	PTD	THERMALLY BROKEN CURTAINWALL WITH SUB SILL, SPANDREL GLASS, TEMPERED INSULATED GLAZING UNITS	
F	F	8'-0-1/2" X 6'-0-1/2"	-	-	-	-	AL	PTD	THERMALLY BROKEN STOREFRONT WITH SUB SILL, TEMPERED INSULATED GLAZING UNITS	
I	F	12'-4-1/2" X 12'-10-1/2"	-	-	-	-	AL	PTD	THERMALLY BROKEN STOREFRONT WITH SUB SILL, TEMPERED INSULATED GLAZING UNITS	
J	F	7'-0-1/2" X 6'-0-1/2"	-	-	-	-	AL	PTD	INTERIOR WINDOW, TEMPERED INSULATED GLAZING UNITS	
K	F	2'-10-1/2" X 18'-8-1/2"	-	-	-	-	AL	PTD	THERMALLY BROKEN CURTAINWALL WITH SUB SILL, SPANDREL GLASS, TEMPERED INSULATED GLAZING UNITS	

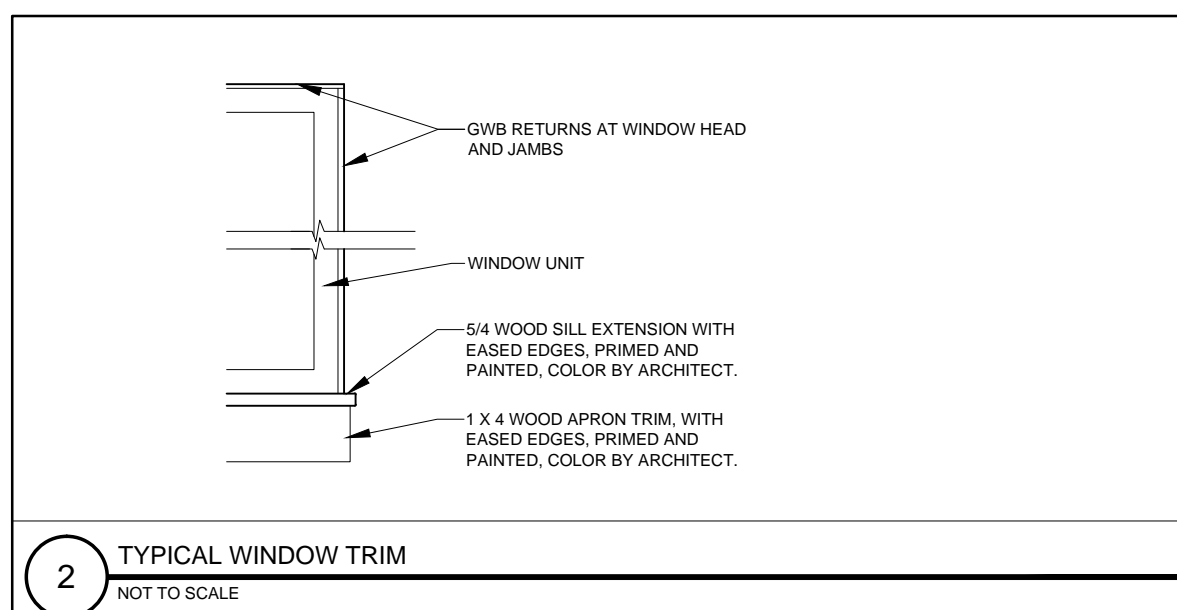

- WINDOW NOTES:
- COORDINATE AND ADJUST ROUGH OPENING DIMENSIONS TO ACCOMMODATE SILL PAN FLASHING SYSTEM
  - ALL WINDOW UNITS AND MULTI-WINDOW UNIT COMBINATIONS TO MEET OR EXCEED DP-50 RATINGS FOR BOTH STRUCTURAL AND WATER
  - PROVIDE MULL REINFORCING AT ALL MULTI-UNIT WINDOWS AS REQUIRED TO ACHIEVE DP-50 RATING, WITH INSTALLATION BRACKETS
  - ALL GLAZING LOCATED WITHIN 18" OF FINISHED FLOOR TO BE TEMPERED GLASS
  - ALL EXTERIOR GLAZING TO BE INSULATED
  - FRAME ALL OPENINGS WITH ELEVATIONS
  - SEAL WINDOW TO ROUGH OPENING WITH LOW EXPANDING FOAMINSULATION - SEE DETAILS

2 TYPICAL WINDOW TRIM  
 NOT TO SCALE

1 WINDOW TYPES  
 1/4" = 1'-0"