


120 VAC SECTION ONLY,
LINE VOLTAGE WIRING SHALL NOT
ENTER THE LOW VOLTAGE SECTION.

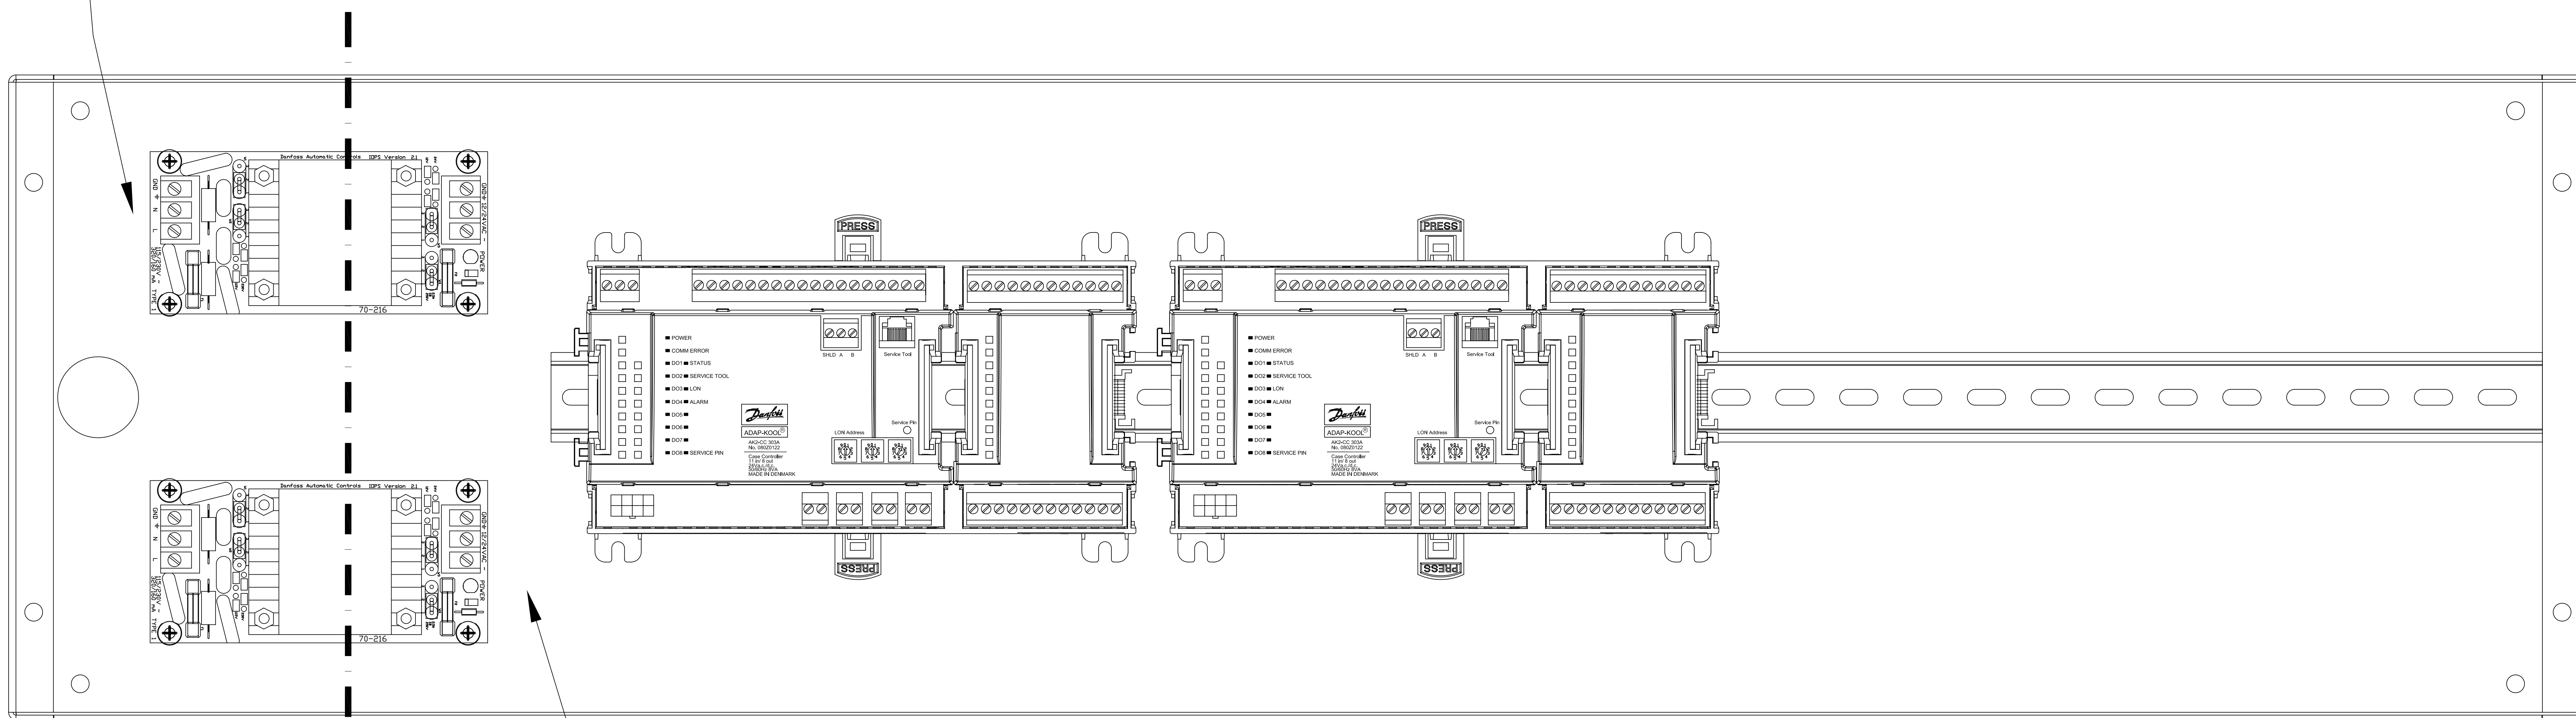

LOW & 120 VAC VOLTAGE
WIRING NOT TO CROSS
THIS LINE.

LOW VOLTAGE SECTION ONLY
LOW VOLTAGE WIRING SHALL NOT
ENTER THE LINE VOLTAGE SECTION.

TYPICAL ENCLOSURE CABINET
HB-3C SHOWN FOR REFERENCE

NOTE:
ALL WORK DONE MUST CONFORM TO THE SCOPE
OF WORK AS OUTLINED UNDER MODULE #1 IN THE
WORKBOOK.

Scale	Design	Drawn	Checked	cad file	date
NTS	J. Berini	J. Berini	J. Berini	BAS4.DWG	10/24/11

PROJECT TITLE	No REVISIONS	DATE	BY	No REVISIONS	DATE	BY
HVAC & REFRIGERATION INPUT / OUTPUT STORE # 8351						

PROJECT TITLE	No REVISIONS	DATE	BY	No REVISIONS	DATE	BY
HANNAFORD FOOD & DRUG FOREST AVE. PORTLAND, ME.						

SHEET TITLE	proj no.
B4	