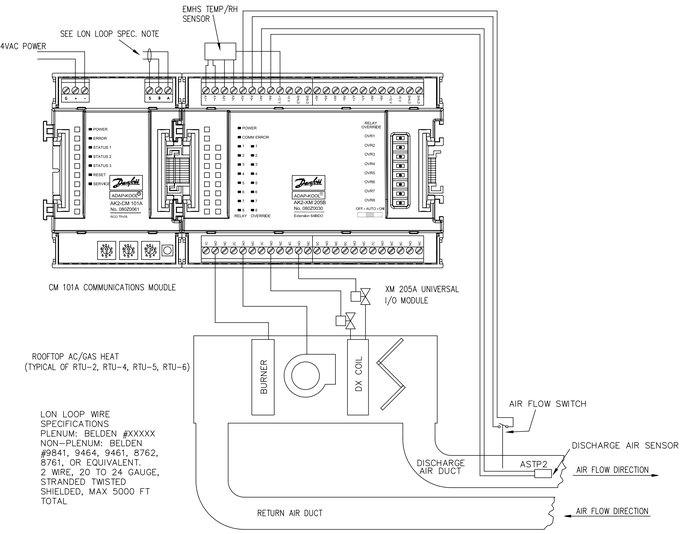

AK2 I/O MODULE WIRING AND LOCATION OVERVIEW@ RTU

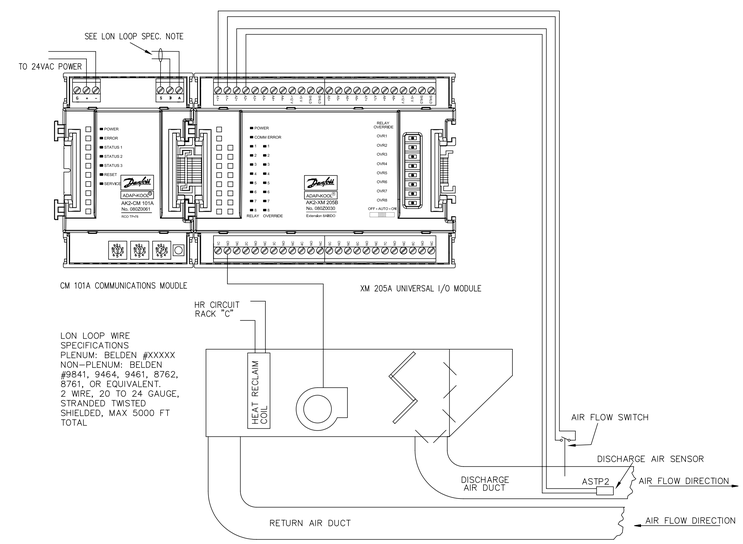

AK2 I/O MODULE WIRING AND LOCATION OVERVIEW@ RTAH-1 & 2. (HEATING ONLY)

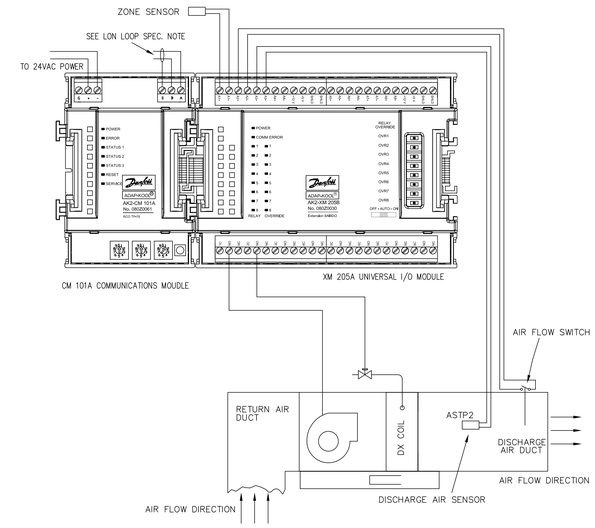

AK2 I/O MODULE WIRING AND LOCATION OVERVIEW@ FC

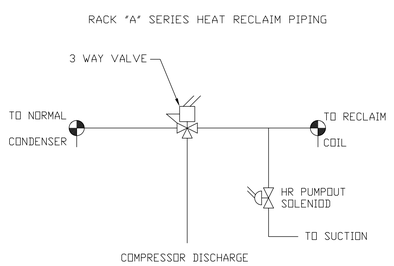

RACK "A" SERIES HEAT RECLAIM PIPING

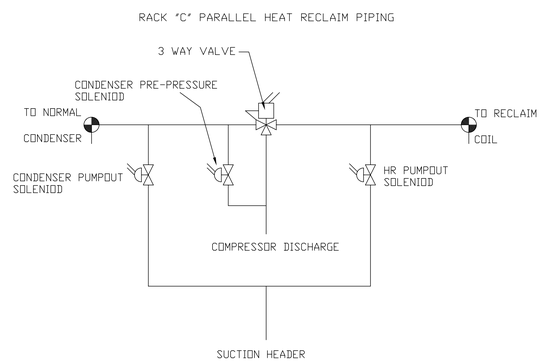

RACK "C" PARALLEL HEAT RECLAIM PIPING

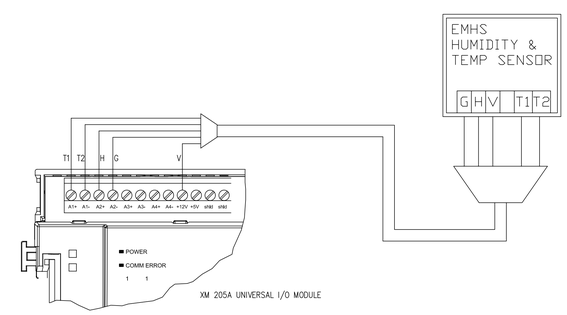

TEMP / RELATIVE HUMIDITY SENSOR WIRING - ZONE (INDOOR)

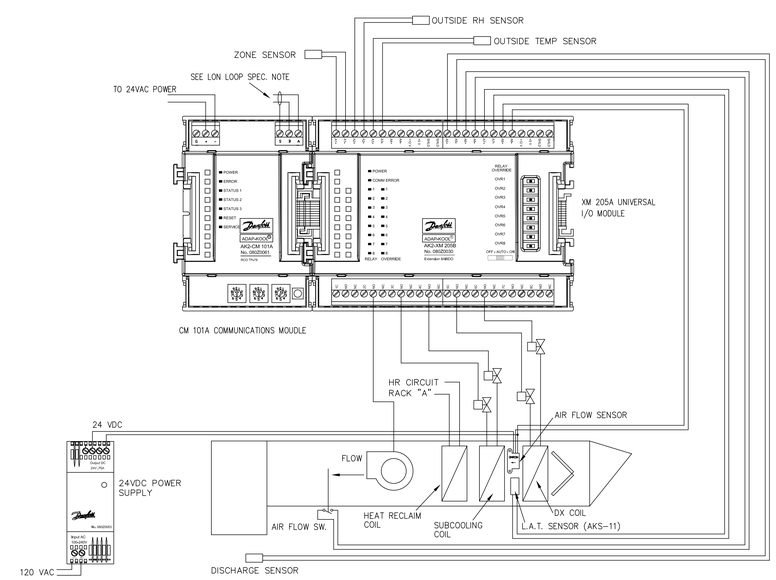

AK2 I/O MODULE RTW-1 SENSOR AND OUTPUT WIRING DETAIL

No	REVISIONS	DATE	BY

No	REVISIONS	DATE	BY

PROJECT TITLE: HANNAFORD FOOD & DRUG, FOREST AVE., PORTLAND, ME.

SHEET TITLE: HVAC DETAILS, STORE# 8351

scale	NTS
design	J. Benini
drawn	J. Benini
checked	
cad file:	BAS7.DWG
date	10/24/11

SHEET B7

proj no.