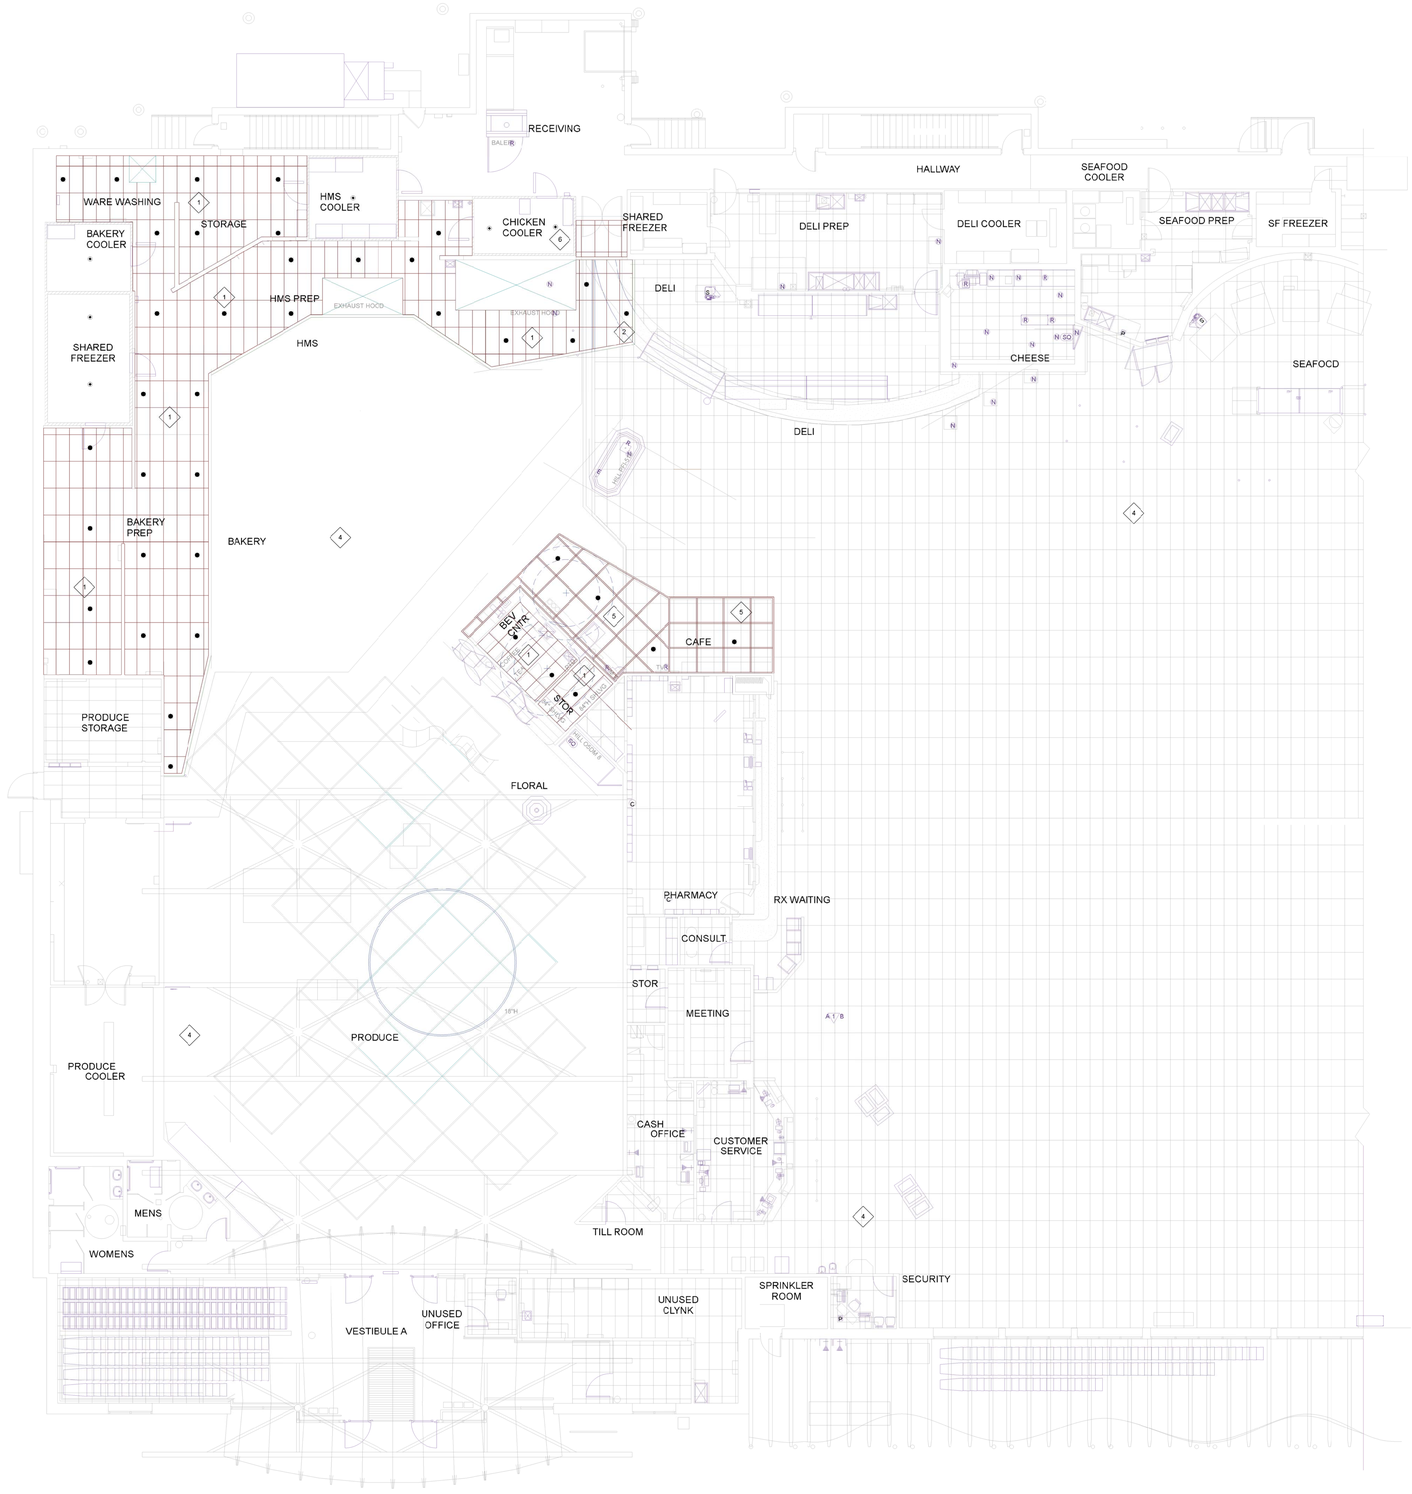

FIRE PROTECTION SPRINKLER SCOPE OF WORK

1. ADD NEW CONCEALED PENDENT SPRINKLER FROM EXISTING BRANCH LINES
2. ADJUST SPRINKLER LOCATION FOR SOFFIT
3. DEMO EXISTING SPRINKLERS FROM EXISTING CEILING ABOVE NEW CEILING
4. EXISTING SPRINKLER COVERAGE TO REMAIN
5. RELOCATE 3 SPRINKLERS FOR NEW GRATE TIGHT TO CEILING
6. INSTALL NEW DRY PENDENT FROM EXISTING BRANCHLINES

INSTALLING CONTRACTOR TO COORDINATE FINAL LOCATION OF SPRINKLER WITH LIGHTS, DIFFUSERS AND RETURNS ALONG WITH OTHER COMPONENTS IN REFLECTED CEILING

PLAN NORTH

W E S

REVISIONS

NO	DESCRIPTION	BY	DATE
1	SUBMITTED FOR REVIEW	CP	6-01-15
2	ISSUE FOR CONSTRUCTION	CP	8-20-15

MISC.

P.E.

SIERRA FIRE SERVICES, INC.
NAPLES, ME | JUPITER, FL
561-346-5850
info@sierra-fire.com

Hannaford Bros. Co.

HANNAFORD
STORE # 8248

295 FORREST AVE
PORTLAND, ME. 04101

FIRE PROTECTION PLAN

APPROVAL	LOCAL FIRE DEPT
DRAWN BY	CHP
SCALE	1/8" = 1'-0"
DATE	6-10-15
REV DATE	

FP 3