


HIGH TECH FIRE PROTECTION

PO BOX 156 • MINOT, ME 04258-0156

PHONE: (207)998-2551 • FAX: (207)998-4187

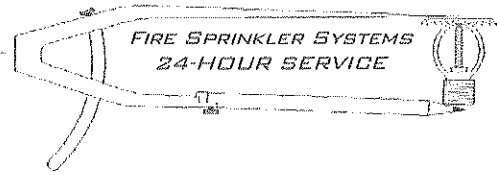

NFPA Letter of Compliance

Date: June 7, 2018

To: Landry & French Construction

From: Ed Pennell

Re: Sprinkler System Compliance Letter for Phase 8 of Verrill Dana

High Tech Fire Protection has retrofitted an existing NFPA 13 sprinkler system for Verrill Dana Phase 8 at 1 Portland Square Portland, ME. This system is in accordance with contract #101216-1. High Tech Fire Protection hereby guarantees our area of work, design, materials and workmanship to meet the requirements necessary for an approved retrofitted NFPA 13 Automatic Fire Sprinkler System per State and local authority.

Sincerely,
Ed Pennell
High Tech Fire Protection
207-998-2551
EPennell@htfp.me

*Specializing in Commercial and Residential Fire Sprinkler Systems
Design • Installation • Inspection • Service*



Advancing security, life safety, and communications.

SYSTEM RECORD OF COMPLETION

Form Completion Date: 5/30/2018 Supplemental Pages Attached: 1

1. PROPERTY INFORMATION

Name of property: One Portland Square -- Verrill Dana Floor 7
Address: 1 Portland Square, Portland, Maine
Description of property:
Name of property representative:
Address:
Phone: Fax: E-mail:

2. INSTALLATION, SERVICE, TESTING, AND MONITORING INFORMATION

Installation contractor: Deblois Electric
Address:
Phone: Fax: E-mail:
Service organization: Norris Inc
Address: 2257 W. Broadway, South Portland, Maine
Phone: 883-3473 Fax: E-mail:
Testing organization: Norris Inc
Address: 2257 W. Broadway, South Portland, Maine
Phone: 883-3473 Fax: E-mail:
Effective date for test and inspection contract:
Monitoring organization: HSMC and Portland Fire
Address:
Phone: Fax: E-mail:
Account number: 202-6099 Phone line 1: Phone line 2:
Means of transmission: Digital Communicator and AES Masterbox
Entity to which alarms are retransmitted: Portland Fire Phone: 874-8576

3. DOCUMENTATION

On-site location of the required record documents and site-specific software:

4. DESCRIPTION OF SYSTEM OR SERVICE

This is a: [X] Modification to existing system Permit number:
NEPA 72 edition:

4.1 Control Unit

Manufacturer: Notifier (Existing) Model number: NFS2-640

4.2 Software and Firmware

Firmware revision number: 25.0

4.3 Alarm Verification

[X] This system does not incorporate alarm verification.

Number of devices subject to alarm verification: Alarm verification set for seconds



Advancing security, life safety, and communications.

SYSTEM RECORD OF COMPLETION (continued)

5. SYSTEM POWER

5.1 Control Unit

5.1.1 Primary Power

Input voltage of control panel: 120 VAC (Existing) Control panel amps: 8
 Overcurrent protection: Type: _____ Amps: _____
 Branch circuit disconnecting means location: _____ Number: _____

5.1.2 Secondary Power

Type of secondary power: Batteries – Sealed Lead Acid (Existing)
 Location, if remote from the plant: Above ceiling by FACP
 Calculated capacity of secondary power to drive the system:
 In standby mode (hours): 24 In alarm mode (minutes): 5

5.2 Control Unit

- This system does not have power extender panels
- Power extender panels are listed on supplementary sheet A

6. CIRCUITS AND PATHWAYS

Pathway Type	Dual Media Pathway	Separate Pathway	Class	Survivability Level
Signaling Line	1 (Add to existing)		B	0
Device Power				
Initiating Device				
Notification Appliance (Strobe)	1 (Add to existing)		B	0
Other (specify): Speaker Circuit	1		B	0

7. REMOTE ANNUNCIATORS

Type	Location

8. INITIATING DEVICES

Type	Quantity	Addressable or Conventional	Alarm or Supervisory	Sensing Technology
Manual Pull Stations	3	Addressable	Alarm	
Smoke Detectors	25	Addressable	Alarm	Photo Electric
Duct Smoke Detectors				
Heat Detectors				
Gas Detectors				
Waterflow Switches				
Tamper Switches				

