
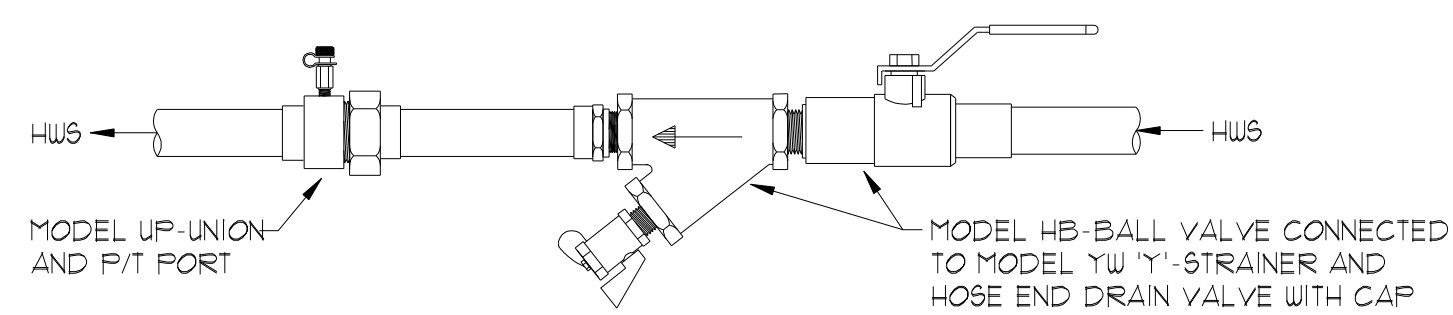



AUTOFLOW VALVE PIPING SCHEMATIC W/ 2-WAY VALVE

NTS
 MODEL NUMBERS BASED ON FLOW DESIGN, INC.
 NOTE - APPLY DETAIL TO ALL ZONE VALVES INDICATED ON DWGS.

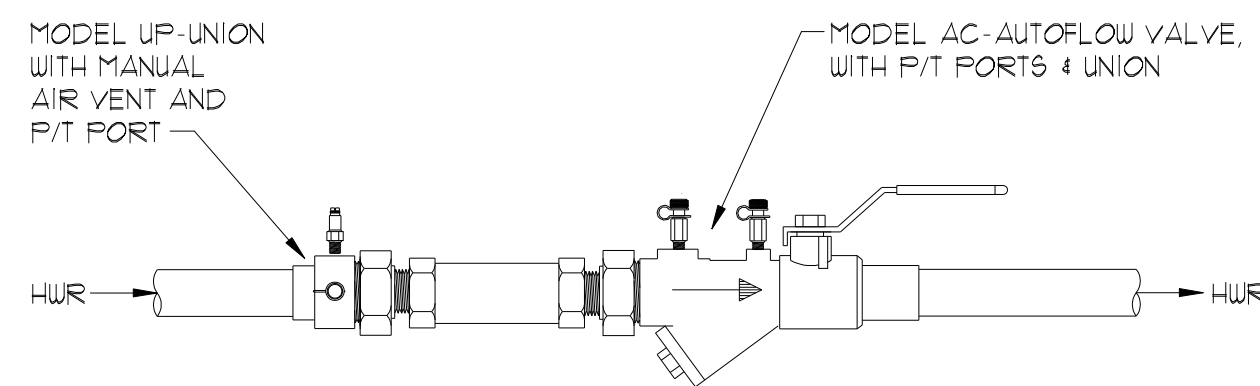

AUTOFLOW VALVE PIPING SCHEMATIC W/ NO CONTROL VALVE


NTS
 MODEL NUMBERS BASED ON FLOW DESIGN, INC.
 NOTE - APPLY DETAIL TO UNIT HEATERS & CABINET UNIT HEATERS AS INDICATED ON DWGS.

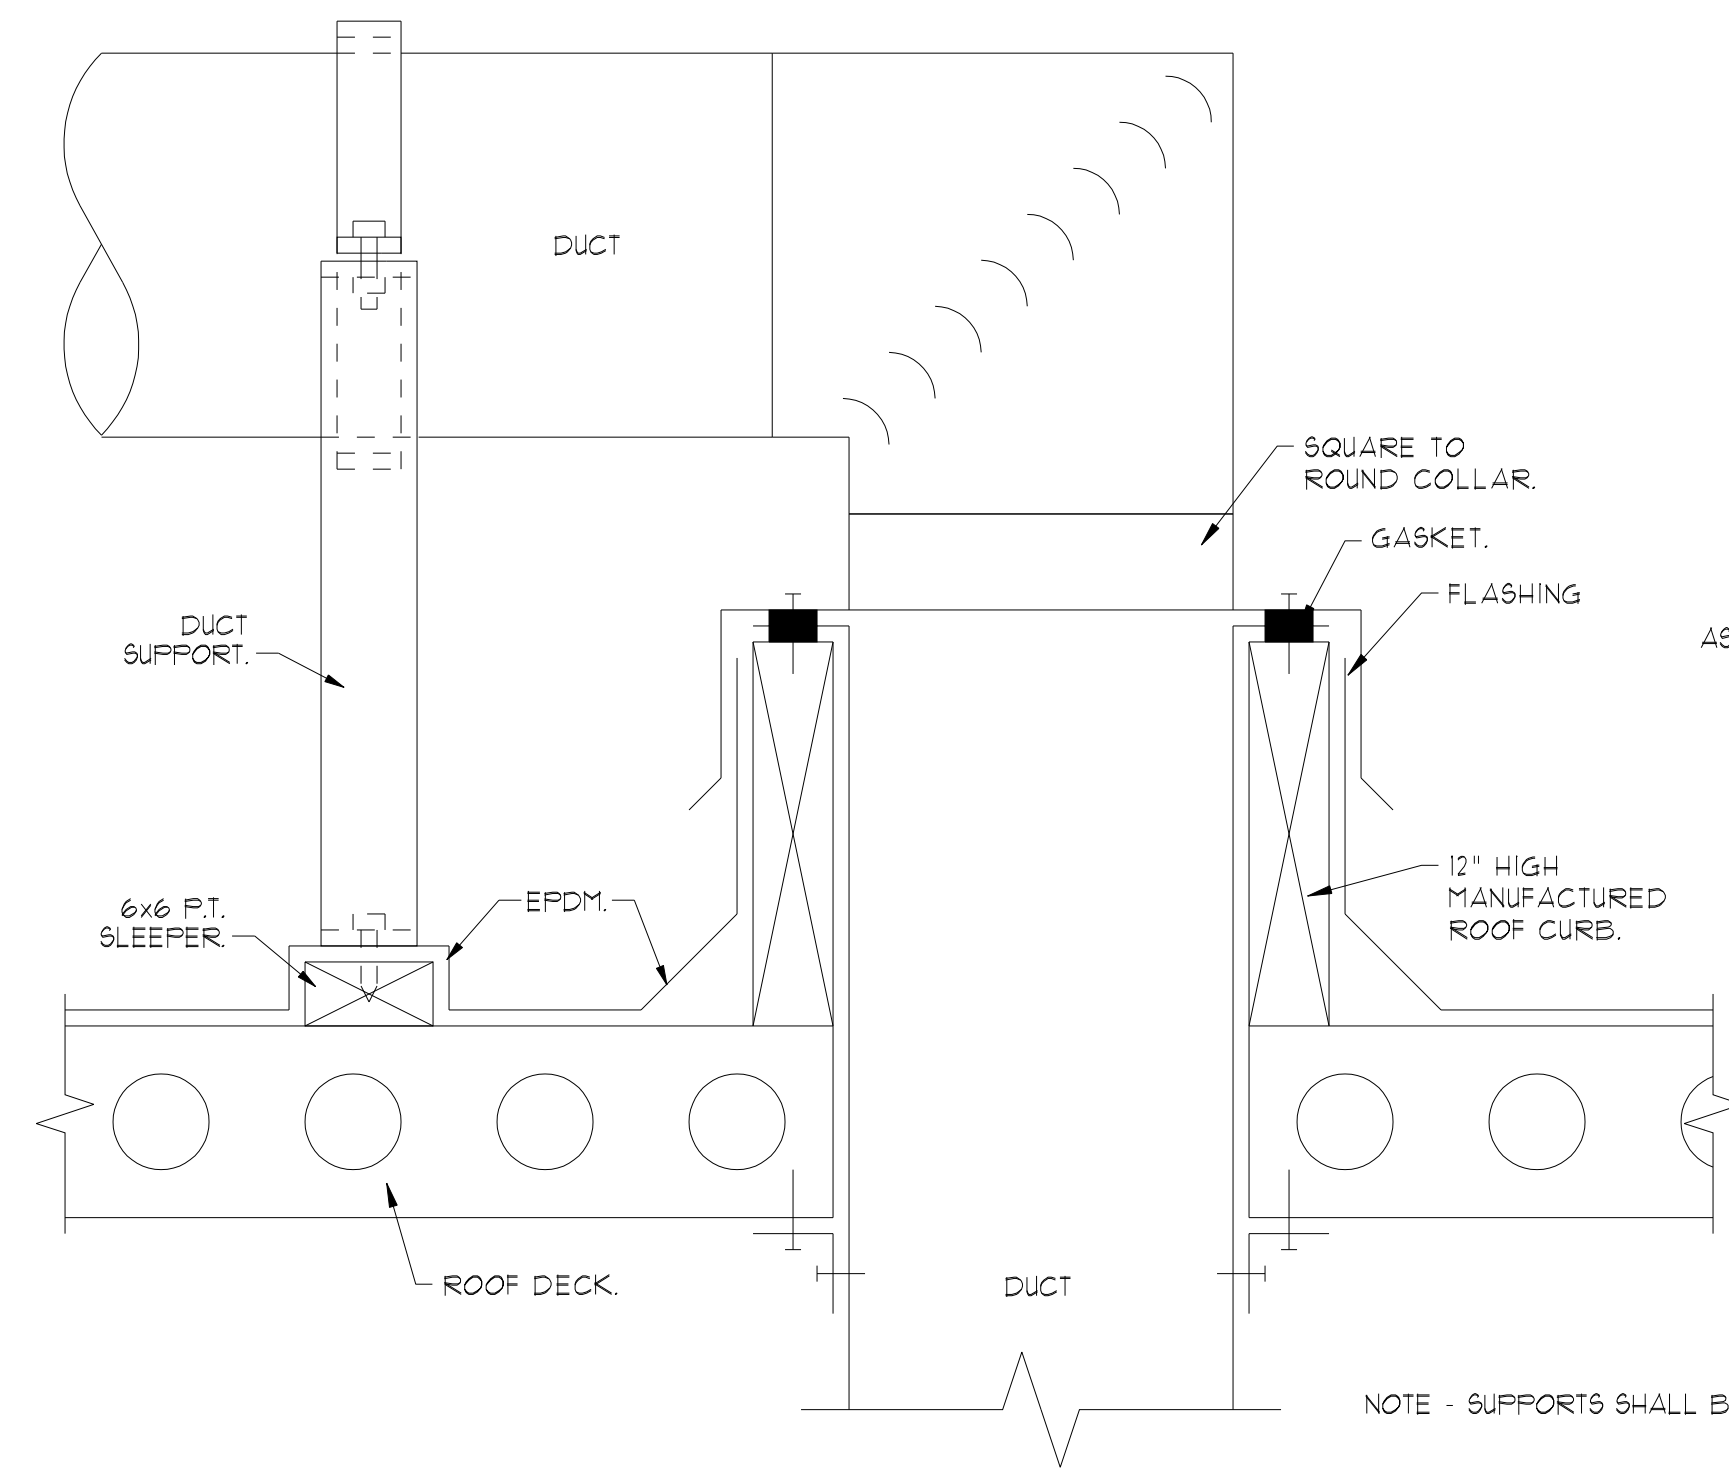

ROOF DUCTWORK SUPPORT DETAIL


NTS

NOTE - SUPPORTS SHALL BE CONSTRUCTED OF GALVANIZED STEEL WITH STAINLESS STEEL FASTENERS

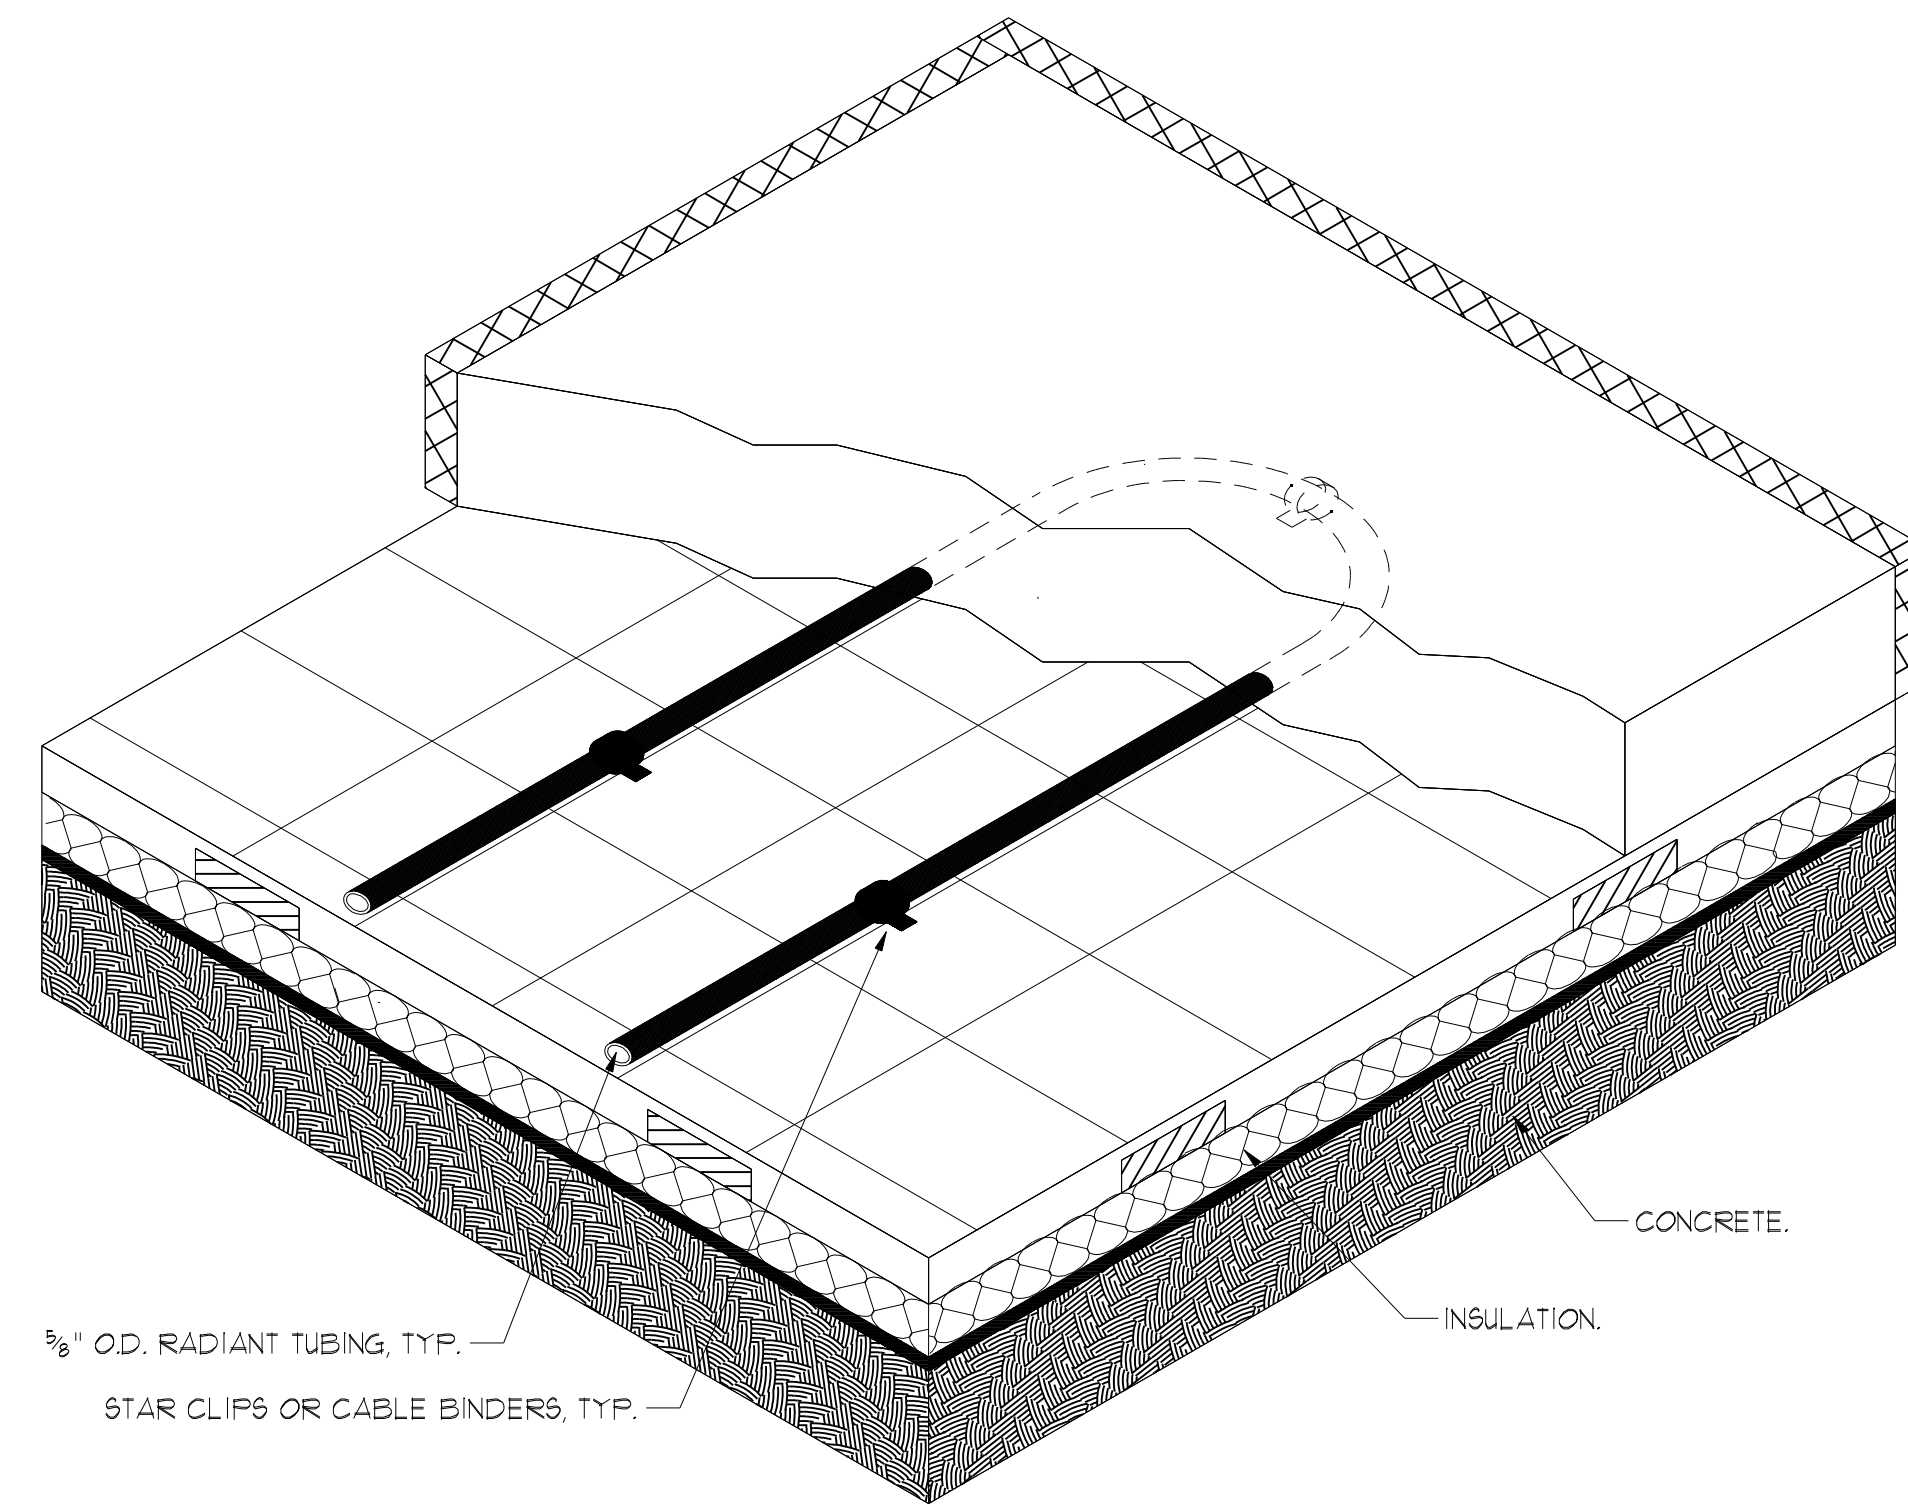


RADIANT PIPING SECTIONS

NTS
 NOTE - SEE ARCHITECTURAL & STRUCTURAL DRAWINGS FOR SLAB DETAILS.

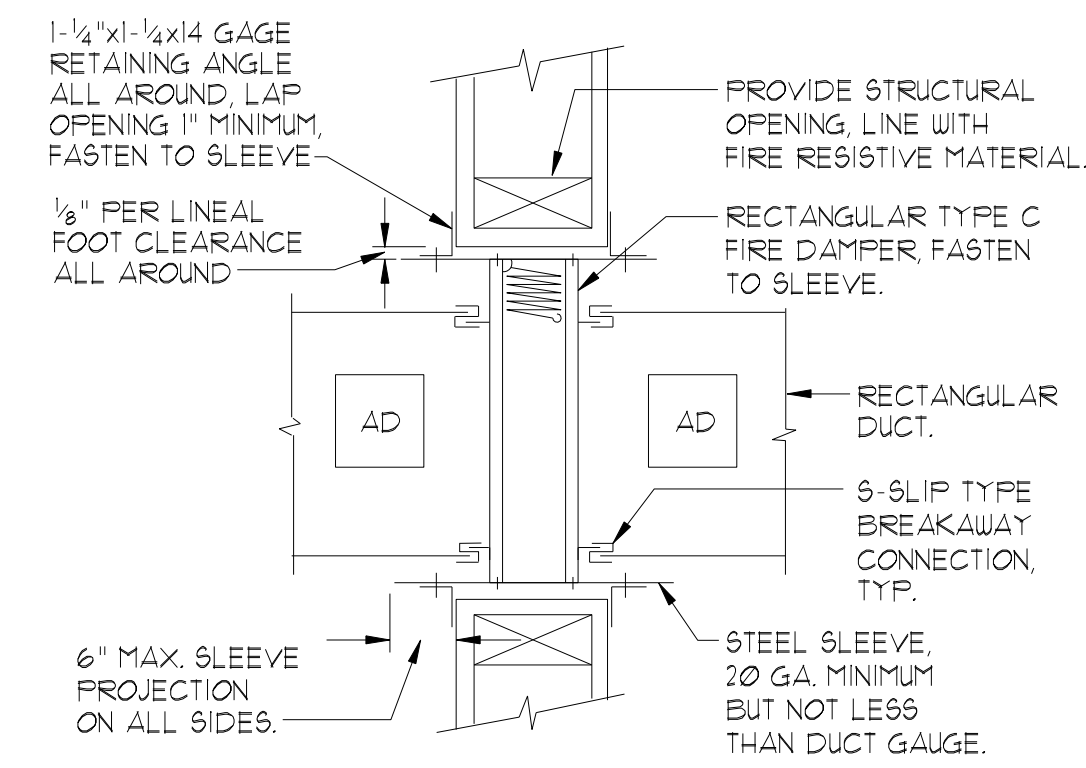



RECTANGULAR FIRE DAMPER INSTALLATION DETAIL

NTS

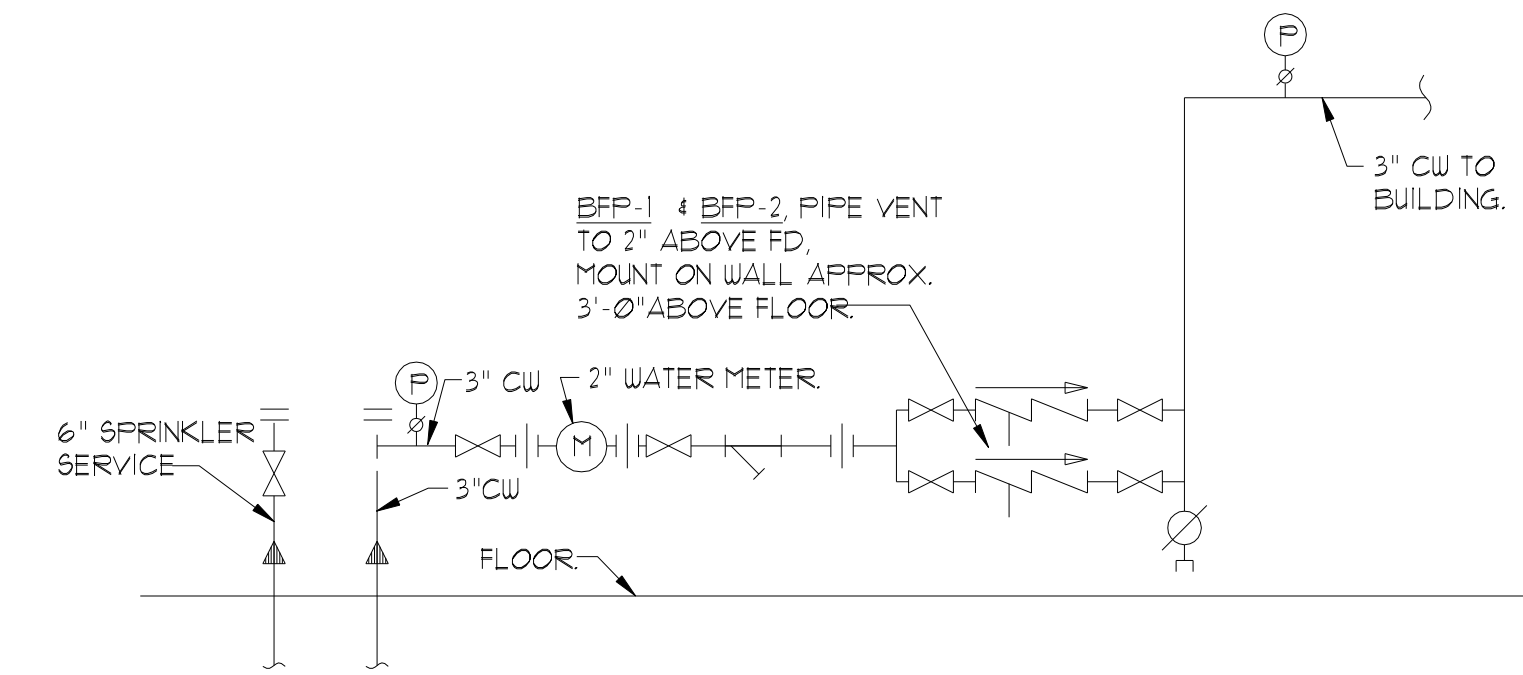

WATER ENTRANCE DETAIL

NTS

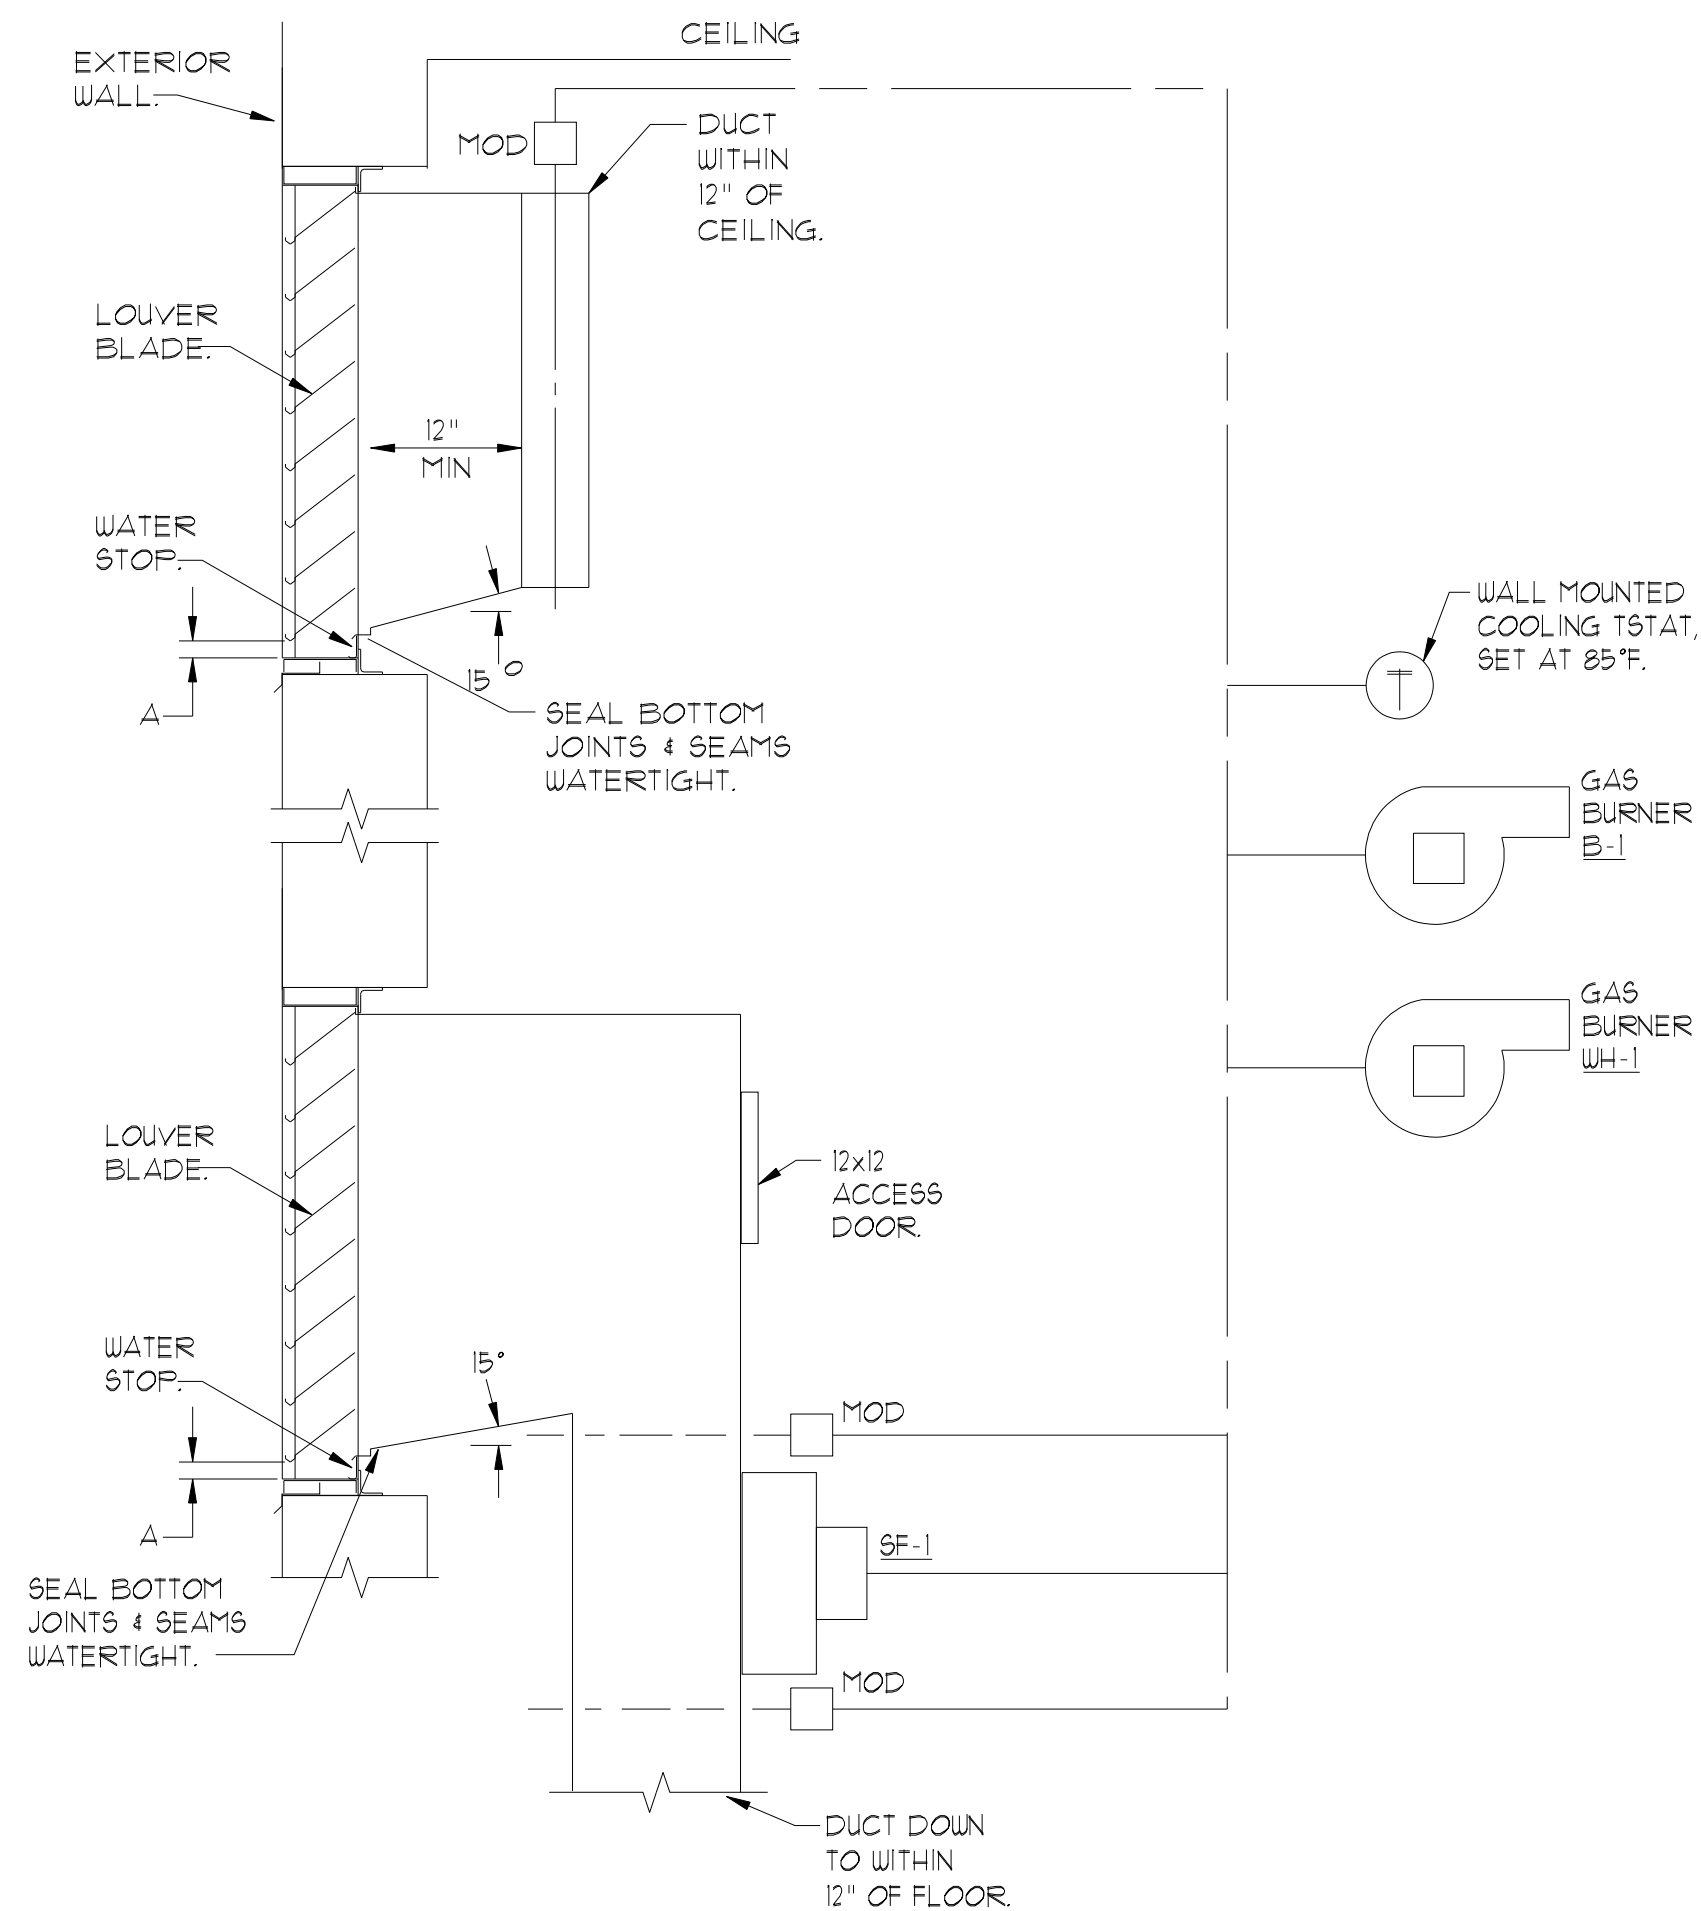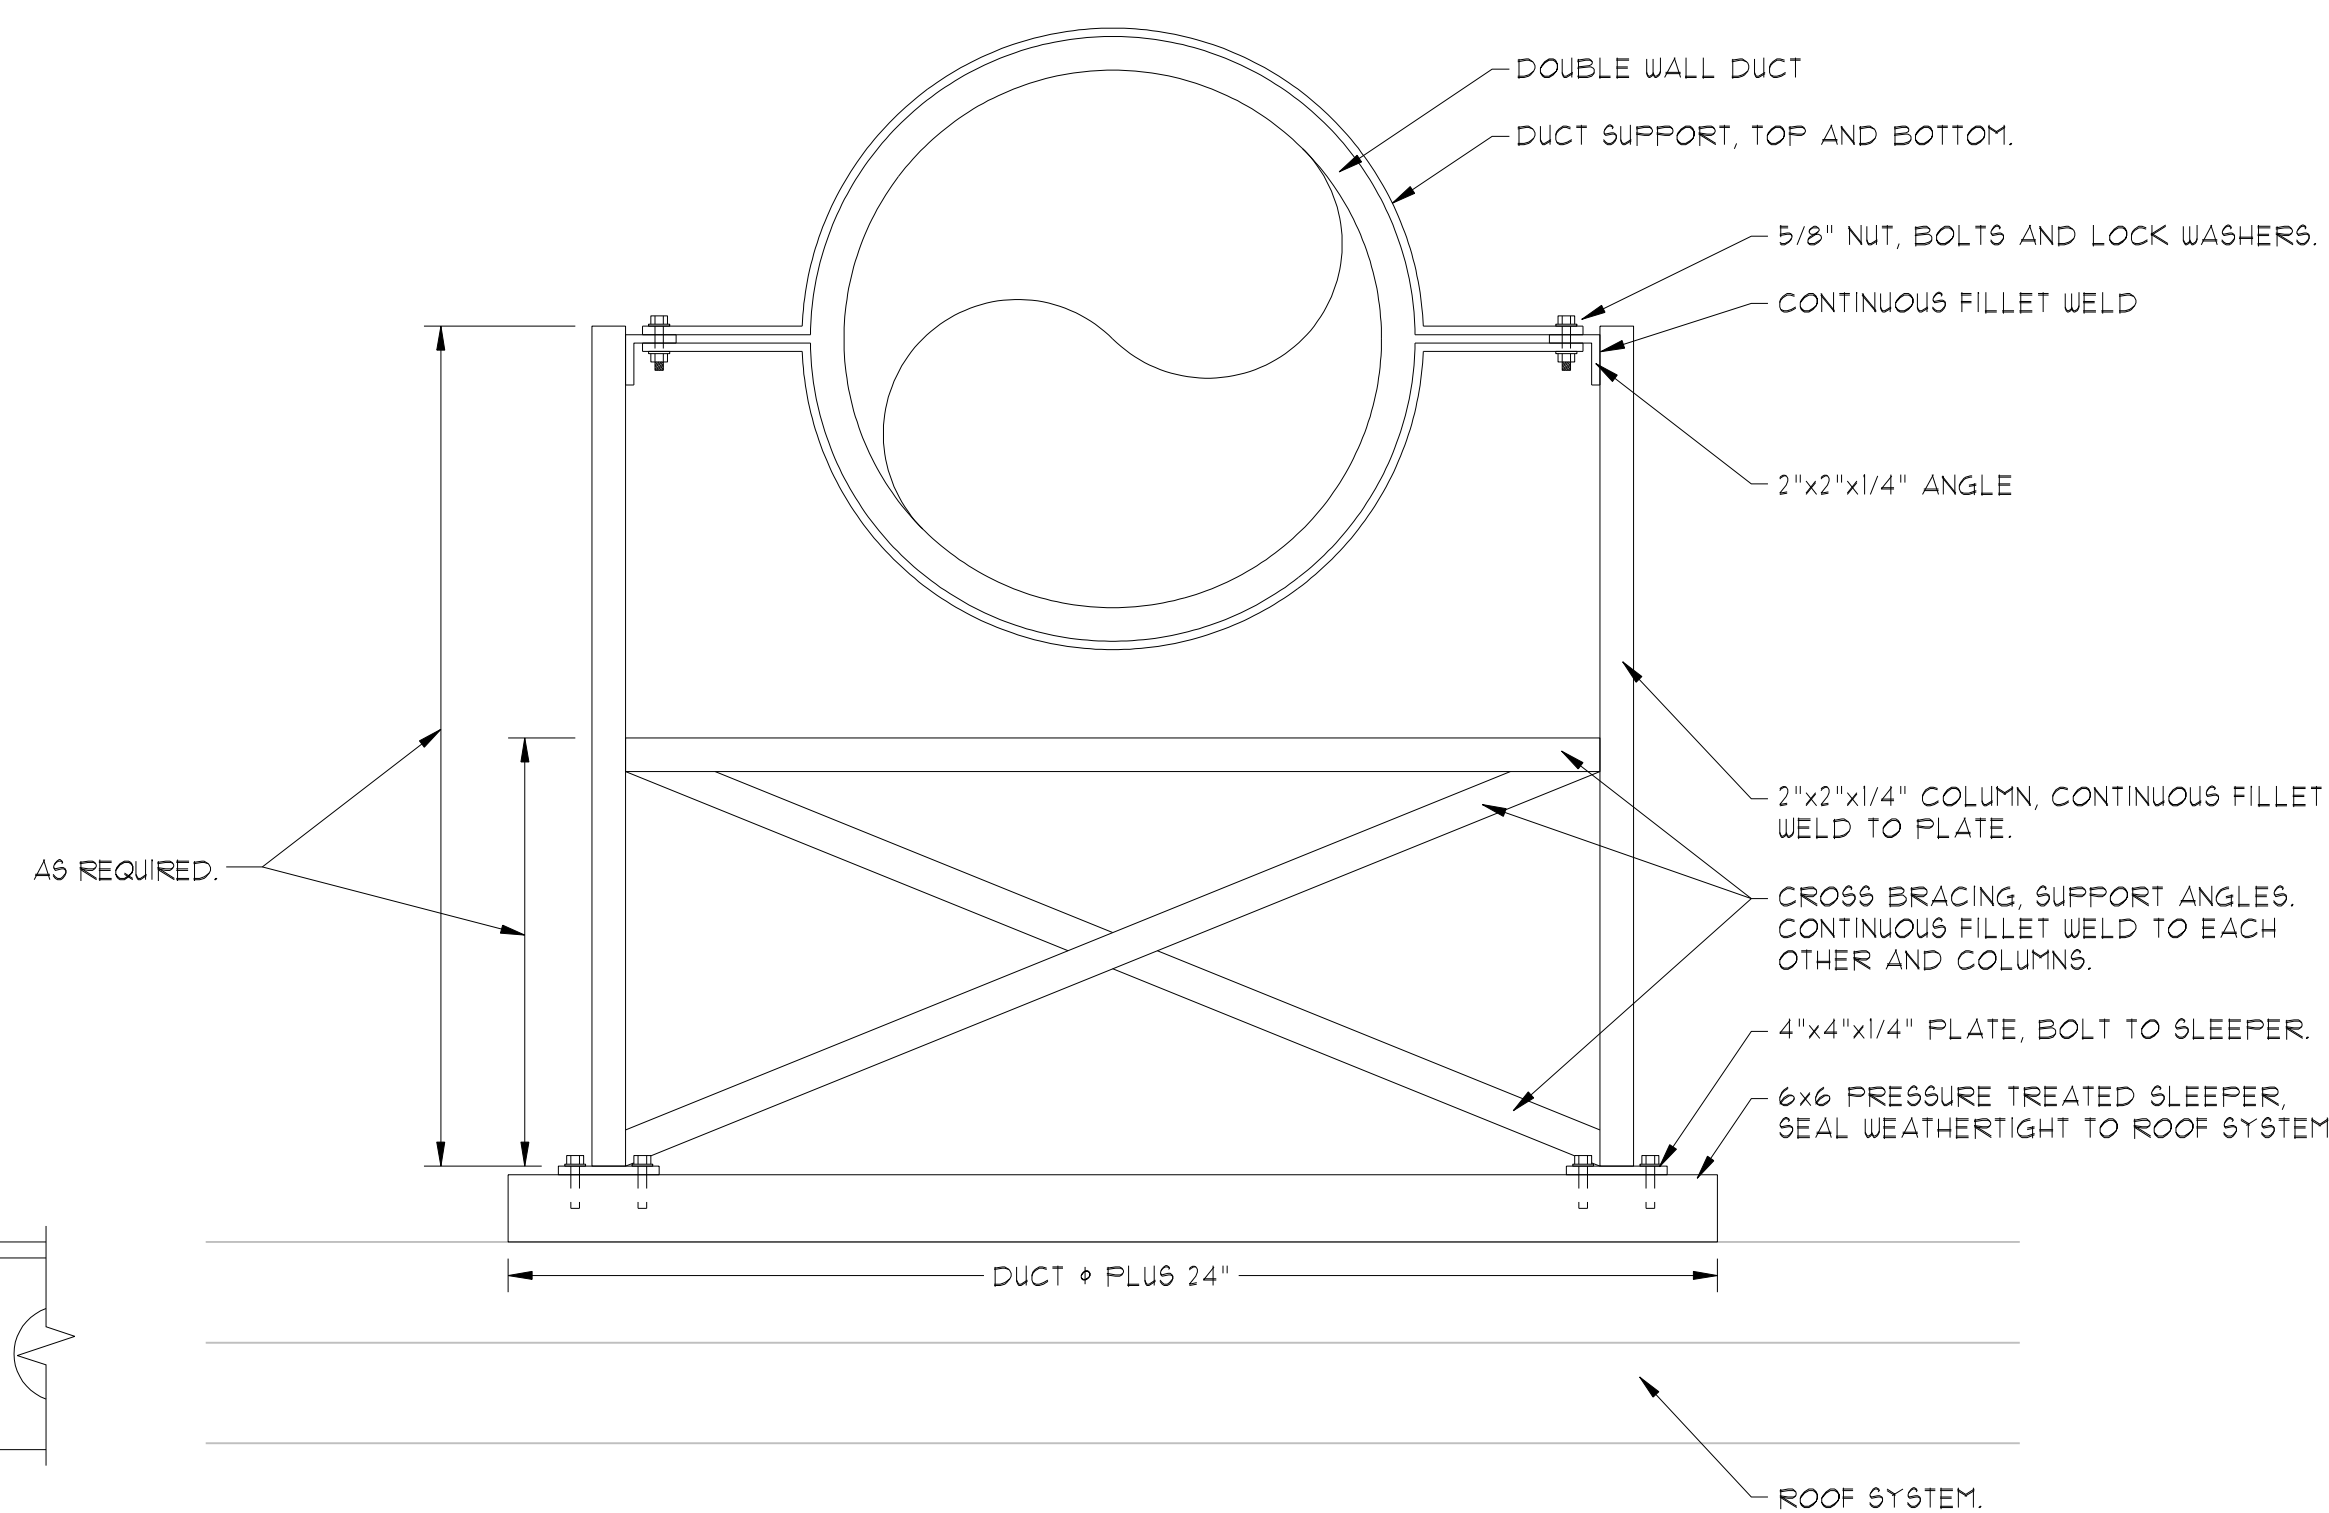

COMBUSTION AIR INTAKE DETAIL

NTS

NOTES
 1. IF DIMENSION "A" IS LESS THAN 1 INCH, SEE MODIFIED LOUVER DETAIL THIS SHEET.
 2. ALL DAMPERS SHALL OPEN FOR COMBUSTION AIR. LOWER DAMPER ON DOWNWARD DUCT SHALL CLOSE AND SF-1 SHALL ENERGIZE WHEN TEMPERATURE RISES ABOVE SETPOINT.

- ▲
- ▲
- ▲
- ▲
- ▲
- ▲