

GENERAL NOTES:

- The notes on the drawings are not intended to replace specifications. See specifications for requirements in addition to general notes.
- Structural drawings shall be used in conjunction with job specifications and architectural, mechanical, electrical, plumbing, and site drawings. Consult, these drawings for locations and dimensions of openings, chases, inserts, reglets, sleeves, depressions, and other details not shown on structural drawings.
- All dimensions and conditions must be verified in the field. Any discrepancies shall be brought to the attention of the engineer before proceeding with the affected part of the work. Do not scale plans.
- The structure is designed to be self supporting and stable after the erection is complete. It is the contractor's sole responsibility to determine erection procedures and sequencing to ensure the safety of the building and its components during construction. This includes the addition of necessary shoring, sheeting temporary bracing, guys or tiedowns. Such material shall remain the property of the contractor after completion of the project.
- Sections and details shown on any structural drawings shall be considered typical for similar conditions.
- All applicable federal, state, and municipal regulations shall be followed, including the federal department of labor occupational safety and health act.

DESIGN LOADS & DESIGN CRITERIA:

- Building code: International Building Code (IBC 2003)
- Design Live Loads:
  - Roof ..... 50 PSF plus drift
  - Lobby ..... 100 PSF
  - Stairs & Exist Ways ..... 100 PSF
- Design wind loads are based on exposure B Using 100 mph basic wind speed.
- Seismic Design Utilizes the following design criteria:
  - Building framing system: Braced framing w/ masonry shear walls.
  - $S_{DS} = 0.296$
  - $S_{DI} = 0.113$
  - Seismic design category: "C"
  - Response modification factor (R): "2"
  - Deflection amplification factor (Cd): "2"

FOUNDATION NOTES:

- Foundations have been designed to conform with recommendations provided in the geotechnical report provided by Sebago Technics, Inc. dated September 17, 2004 titled "Report on Subsurface and Foundation Investigation". Two reports have been submitted.
- Foundation preparation and excavation shall conform with the recommendations provided in the geotechnical report.
- Bottoms of exterior strip and spread footings shall be founded a minimum of 4'-6" below finished grade.
- Interior spread footings and exterior strip footings shall be founded on native soil, compacted structural fill or bedrock.
- Slabs-on-grade shall bear on a minimum of 6" thickness of compacted structural fill. If loose or undesirable fills are encountered at the slab subgrade level, they shall be over excavated to the surface of the natural soil and replaced with structural fill. Refer to drawings and specifications for vapor barrier requirements.
- Structural fill shall be used at all locations below footings and slabs and adjacent to the foundation walls. Prior to placement of structural fill, remove all topsoil and other unsuitable material. Compacted structural fill shall consist of clean granular material free of organics, loam, trash, snow, ice, frozen soil or any other objectionable material. It shall be well graded within the following limits:

SCREEN OR SIEVE SIZE	PERCENT FINER BY WEIGHT
6 INCH	100
#4	30-90
#10	10-50
#200	0-8

- Structural foundation backfill shall be placed in layers not exceeding 6 inches in loose measure and compacted by self-propelled compaction equipment at approximate optimum moisture content to a dry density of at least 95% of the maximum in place dry density as determined by the modified proctor test (ASTM D-1557).
- Open excavations shall be adequately braced or properly benched.
- Backfill both sides of foundation walls simultaneously.
- Provide 4'-0" of compacted structural fill beneath all Entrances.

CONCRETE NOTES:

- All concrete work shall conform to ACI 318-89.
- Concrete strength at 28 days shall be:
  - 4,000 Psi for footings, walls & piers.
  - 3,500 Psi for slabs-on-grade.
  - 3,500 Psi for 2" concrete topping.
- All concrete shall be air entrained per the specifications.
- Concrete shall not be placed in water or on frozen ground.
- Provide PVC sleeves where pipes pass through concrete walls or slabs.
- Reinforcing bars shall conform to ASTM A615 Grade 60 deformed bars, and shall be detailed, fabricated and erected in accordance with ACI 315-Latest edition.
- Welded wire fabric shall be provided in flat sheets.
- Fiber reinforced concrete shall conform to ASTM C-1116.
- Complete shop drawings and schedules of all reinforcing steel shall be prepared by the contractor and submitted to the engineer for review prior to commencement of that portion of the work. All accessories must be shown on the shop drawings. Submit (2) blue line prints and (1) reproducible (sepia) to the Architect.
- Splices of reinforcing bars shall be in accordance with ACI 318-Latest Edition or as shown on the drawings. Splices of WWF shall be 6" minimum.
- Concrete finishes: See specifications and Architectural drawings for additional information.
- Anchor bolts shall conform to ASTM A307 unless noted otherwise on plan.
- Provide control/construction joints in foundation walls at a maximum spacing of 15 ft. from any corner or 20 ft. along length of wall. At control joints, discontinue every other horizontal bar. At construction joints all reinforcing shall be continuous through the joint.
- The general contractor shall be responsible for coordination of Door bondout locations, slab depressions & bondout locations with Architectural, Mechanical Electrical & Plumbing drawings as necessary to properly install each specific item.

STRUCTURAL STEEL NOTES:

- Structural steel fabrication, erection, and connection design shall conform to AISC "Specification for the design, fabrication, and erection of structural steel"-Ninth edition.
- Structural steel:
  - Structural steel shall conform to ASTM A-36.
  - Structural tubing shall conform to ASTM A-500 GR.B.
- Design connections for the reactions shown on the drawings or the maximum end reaction that can be produced by a laterally supported uniformly loaded beam for each given beam size and span.
- Field connections shall be bolted using 3/4" diameter ASTM A325 high strength bolts except where field welding is indicated on the drawings.
- All welding shall conform to AWS D1.1-Latest edition. Welding electrodes shall be E70XX.
- Provide galvanized steel lintels where shown on the drawings. Refer to the lintel schedule on drawing S3.1 for lintel sizes.

MASONRY NOTES:

- All hollow load bearing concrete masonry units shall be ASTM C90 grade N, type I standard weight standard blocks including stretchers & corner blocks unless noted otherwise.
- All load bearing concrete masonry units shall conform to ASTM C90 grade N, type I standard weight standard blocks including stretchers & corner blocks.
- Masonry prism strength (f'm) shall be 1,500 psi.
- Mortar shall conform to ASTM Specification C270, type M or S.
- Concrete masonry units shall be laid in running bond.
- Wall penetrations shall be coordinated with the Architect and Owners vendors/designers and shall be field located.
- Provide joint reinforcing per drawings & specifications in all concrete masonry unit construction.
- All masonry reinforcement shall be spliced 48 bar diameters.
- Reinforcing bars shall conform to ASTM A615 grade 60 deformed bars and shall be detailed, fabricated and placed in accordance with ACI 315-Latest Edition.
- Masonry walls which support structural members shall have cells grouted solid full height under bearing with 2-#6 minimum vertical reinforcing bar in each cell UNO on plan..
- Bond beams shall be filled with grout capable of achieving 3000 psi compressive strength at 28 days. Reinforcing shall be supported prior to placing concrete to provide a minimum 1/2" clearance around all bars.
- Cells of masonry units containing vertical reinforcing shall be filled with grout Unless otherwise noted. Maximum grout lift without cleanouts and inspection shall be 4'-0". Support all vertical bars in units as shown on the drawings.
- Provide precast lintels for all masonry openings on the exterior wall. Refer to lintel schedule for lintel sizes and architectural drawings for precast lintel sizes.

LIGHT GAGE METAL FRAMING:

General:

- Acceptable light gage Manufacturer: See Specifications
- The extent of the work for the exterior metal stud roof system is detailed on the Architectural drawings. These notes shall be worked in conjunction with those drawings and the specifications.
- The following specifications and publications shall be followed.
  - American iron and steel institute cold form design manual, specification for the design of cold form steel structural members latest edition.
  - American society for testing and materials (ASTM).
  - American institute of steel construction Manual of Steel Construction - 9TH Edition.
- Fabrication of light gage steel shall conform with requirements of ASTM A446 with the following minimum yield points (Fy):
  - 16 gage. and heavier - Fy = 50,000 psi (Grade D)
  - 18 gage. - Fy = 33,000 Psi (Grade A)
  - 20 gage. - Fy = 33,000 PSI (Grade A)
- Manufacturer of studs, runners, tracks and other framing members shall comply with ASTM C955.
- Framing components and accessories shall be galvanized per ASTM A525 minimum G90 coating.
- Screws and other attachment devices shall have a protective coating equivalent to cadmium or zinc plating and shall comply with ASTM A165 Type NS. self tapping screws shall be of the minimum diameter as indicated on the design drawings for each specific attachment detail. Penetration through joined materials shall not be less than three exposed threads.
- Standard steel shapes, plates, etc. shall conform to the material and finish specifications under Division 5.

Exterior Wall System:

- Provide channel shaped studs, joists, runners, tracks, blocking, clip angles, shoes, reinforcements, fasteners and other accessories recommended by the manufacturer for a complete framing system.
- The exterior wall framing subcontractor shall submit shop drawings and design calculations as specified in the previous mentioned specifications and publications. These drawings shall illustrate the design of the steel stud exterior wall framing and sheathing including steel lintels, heads, jams etc. and all structural steel stiffening and bracing.
- The design wind pressure shall be as indicated in International Building Code (IBC 2003).
- Welding of framing components will be permitted only where indicated on structural drawings or as approved by the Engineer of Record.
- Field cutting of holes in steel framing members shall not be permitted.
- Touch up all steel bared by welding with zinc rich paint.
- Splices of axially loaded members shall not be permitted.
- Wire tying of members is not permitted.
- Complete bearing on supports shall be maintained for studs in axially loaded assemblies.

REQUIRED SUBMITTALS & TESTING

For each submittal, submit (5) copies and (1) reproducible sepia to the Architect

- Concrete reinforcing, concrete mix design & testing. (03300): Submit complete shop drawings and schedules of all reinforcing steel. Drawings shall be prepared by the contractor and submitted to the engineer for review prior to commencement of that portion of the work. All accessories, schedules, bend types etc. shall be shown on the shop drawings. Compressive Strength Tests: ASTM C39; prepare one set for each 100 cubic yards or fraction thereof, of each concrete class placed in any one day or for each 5,000 square feet of surface area placed; test 1 specimen at 7 days, 2 specimens at 28 days, and reserve 1 specimen for later testing if required.
- Structural Steel: Submit detailed drawings, including complete details and schedules for fabrication and assembly of structural steel members, procedures and diagrams. Including details of cuts, copes, connections, camber, holes and other pertinent data.

Indicate welds by standard AWS symbols, and show size, length, and type of each weld.

Provide setting drawings, templates and directions for installation of anchor bolts and other anchorages to be installed by others.

- Metal Deck: Submit shop drawings, prepared under the supervision of a professional engineer licenced to practice in the State of Maine, showing timber species, sizes and stress grade of lumber to be used; pitch, span, camber, configuration, and spacing for each type of truss required; type size, material, finish, design value and location of metal connector plates; including bearing and anchorage details.

- Light Gage Stee Framing: Submit shop drawings and calculations, prepared under the supervision of a professional engineer licenced to practice in the State of Maine. Shop drawings shall including but not be limited to member sizes, spacing and steel yield stress.

Engineers Stamp: Provide a final set of shop drawings which have been signed and stamped by a structural engineer licensed to practice in the State of Maine if the submittal is for Arch/Eor review only.




CWS Architects

Architecture  
Space Planning  
Value Design

434 Cumberland Avenue  
Portland, ME 04101

Phone: (207)774-4444  
Fax: (207)774-4016

www.CWSarch.com

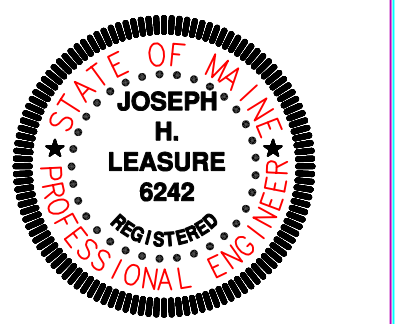

Greater Portland YMCA

c/o Cumberland County YMCA  
70 Forest Ave Portland, ME 04101

(207) 874-1111

Client

YMCA  
HIGH STREET  
ENTRY

High Street - Portland, Maine

Project No: 25050

Drawing Title:  
GENERAL NOTES

Scale: FULL

Date: 05-11-2005

Revisions:

- A ISSUE FOR PERMITTING ONLY
- △
- △
- △
- △
- △

Drawing Number:

S0.1

FOR PERMITTING ONLY