

DIAGRAM SYMBOL	LEGEND DESCRIPTION
---	POWER WIRE
---	CONTROL WIRE
---	REF. PIPE

CONT.No. _____ PAGE _____


CITY MULTI SYSTEM SCHEMATIC DWG.

Additional refrigerant charge is needed depending on the size and length of extended piping. Please refer the amount of pre-charge and the formula of calculation which is mentioned on the data book.
 1.25mm²(16 AWG) : 1.25mm²(16 AWG) or more. 0.75mm²(20 AWG) : between 0.5mm²(24 AWG) and 0.75mm²(20 AWG).

NOTE

THE BASIS OF DESIGN FOR THE MULTI-SPLIT HEAT PUMP SYSTEMS INDICATED IS MITSUBISHI. THE INSTALLATION REQUIREMENTS, INCLUDING ELECTRICAL WORK, MAY VARY BETWEEN MANUFACTURERS. MECHANICAL CONTRACTOR SHALL COORDINATE ALL WIRING REQUIREMENTS OF THE H.P. SYSTEMS WITH ELECTRICAL CONTRACTOR AND SYSTEMS MANUFACTURER.

PIPING LIST		
SYMBOL	BRANCH PIPE MODEL NAME	SYMBOL LIQUID PIPE/GAS PIPE SIZE
P1	3/8	5/8
P2	1/4	1/2
P3	1/4	3/8

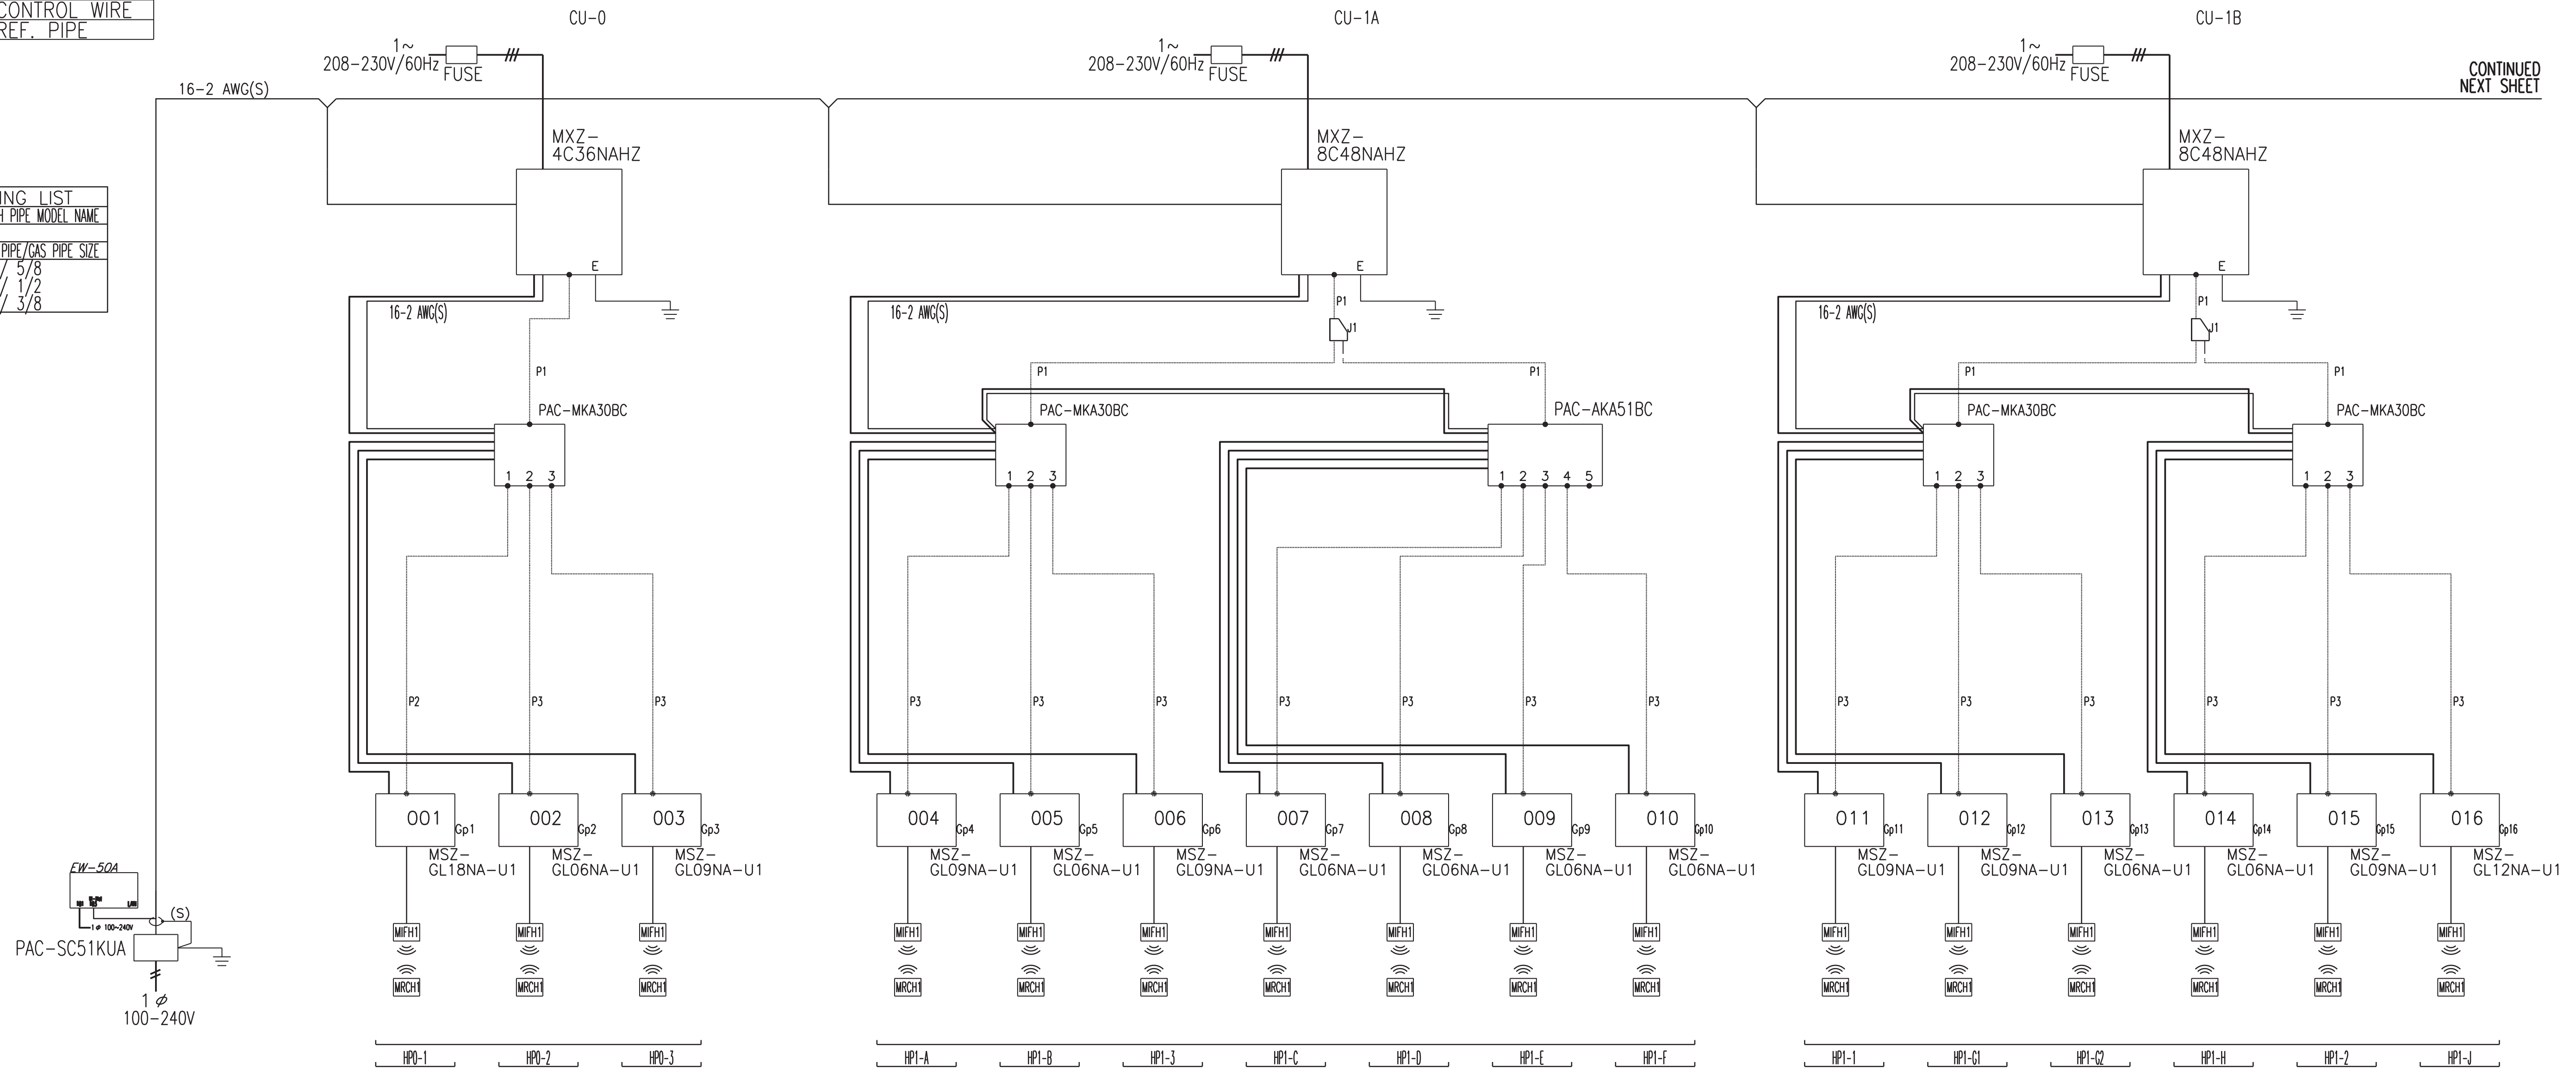

CONTINUED NEXT SHEET

REMARKS



ALPHAarchitects
 17 CHESTNUT STREET
 PORTLAND, ME 04101
 PHONE: 207.761.9500
 FAX: 207.761.9595
 design@alphaarchitects.com



BENNETT
 ENGINEERING
 MECHANICAL • ELECTRICAL
 (207) 865-9475

Station 415
 415 Cumberland Avenue
 Portland, ME. 04101

JOB: 16110

ISSUE DATE	
PRELIM	01-17-16
SFMO	-
CD's	-
REV. 1	-
REV. 2	-
PRINT	09-30-16

MECHANICAL DETAILS

M4.4

FOR PERMIT 09-30-16