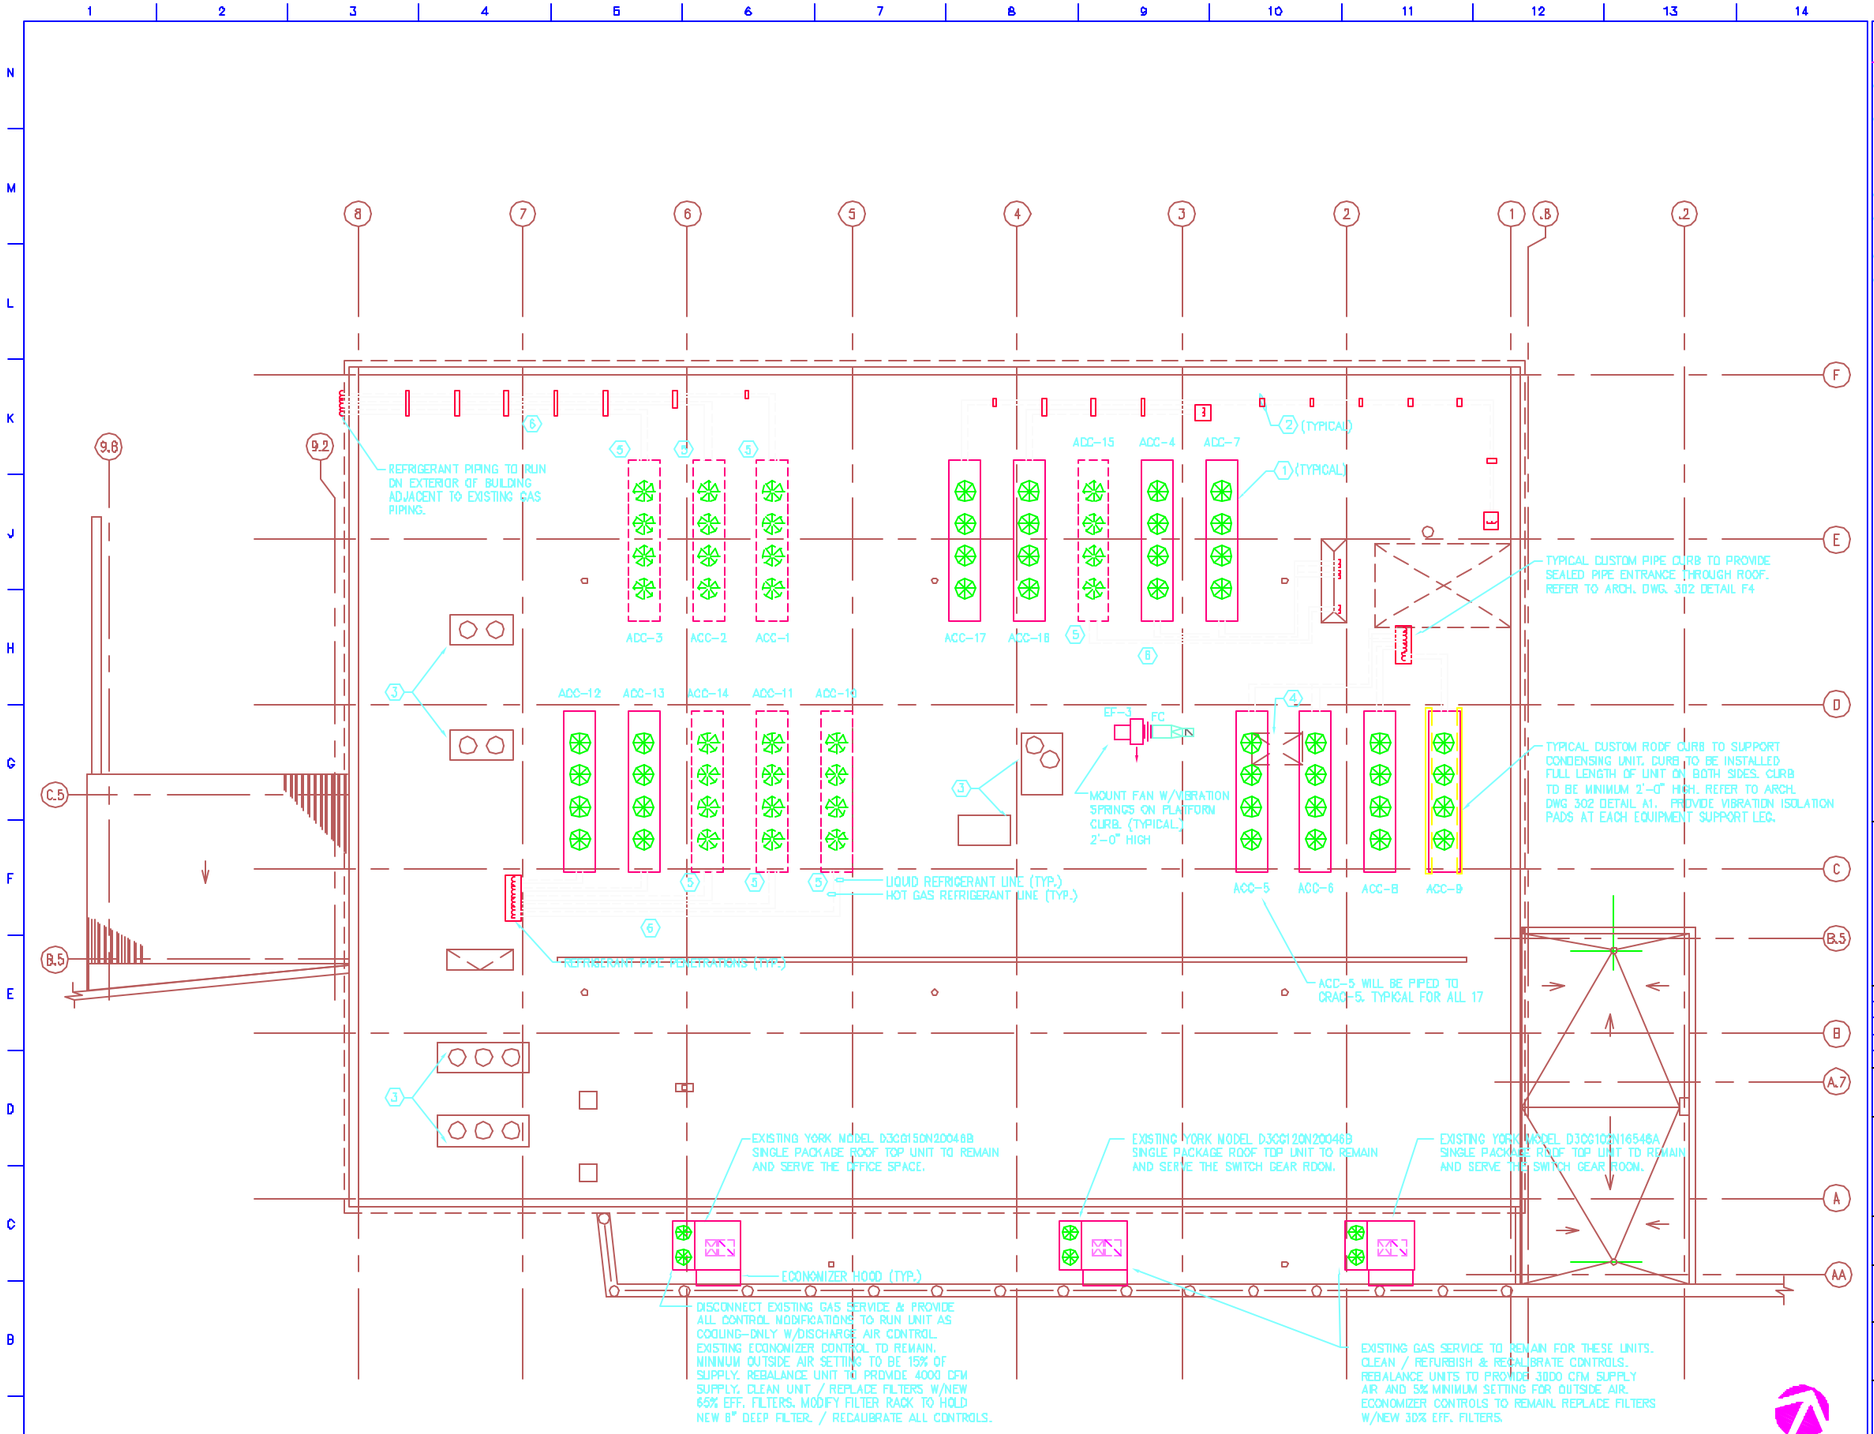

GENERAL NOTES

1. INSTALL HEAT REJECTION EQUIPMENT IN ACCORDANCE WITH MANUFACTURER RECOMMENDATION.
2. REFRIGERANT PIPING TO BE SUPPORTED EVERY 8 FEET. OR PER MANUFACTURERS RECOMMENDATION. PROVIDE PIPE ROLLER SUPPORTS AS MANUFACTURED BY "CUSTOM-CURB" MODEL CPRS-1. MINIMUM HEIGHT 8" ABOVE ROOF.
3. EXISTING EQUIPMENT TO REMAIN.
4. EXISTING ROOFTOP AC UNIT TO BE REMOVED WITH ALL ASSOCIATED PIPING, CONTROLS, ETC.
5. FUTURE ROOF TOP CONDENSING UNITS.
6. ALL REFRIGERANT PIPING AND CURBS FOR FUTURE UNITS SHALL BE FULLY INSTALLED.

P:\2001\5501001.00\Tbk\HP1ogo.gif

no.	revisions/submissions	date
0	FOR CONSTRUCTION	7/13/01

0 1" 2" 3"

Einhorn Yaffee Prescott
ARCHITECTURE & ENGINEERING, P.C.
WORCESTER SCHOOL SERVICE
WORTH, NH 08083
87.388-1665
ALBANY, NY
ICE BOX, EY
LOS ANGELES, CA.
SHIRE PLANS, EY
BURLINGTON, MA
BOSTON, MA

CommTel Data Center
380 Cumberland Avenue
Portland, Maine

drawing title
HVAC ROOF PLAN

seal	designed by JML	project no. 5501001.00
	drawn by JML	CAD file no. P:\2000\5501001\HVAC
	checked by WOK	drawing no. H203
	date 07/13/01	
	scale 1/8"=1'-0"	___of___

A1 HVAC ROOF PLAN
1/8"=1'-0"
CTL-ABDR