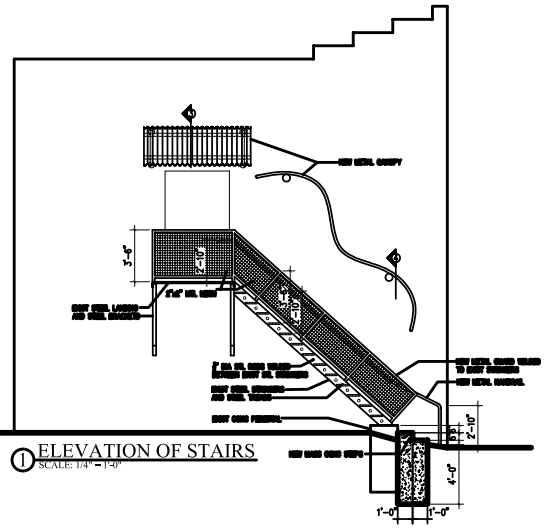

1 ELEVATION OF STAIRS
SCALE: 1/4" = 1'-0"

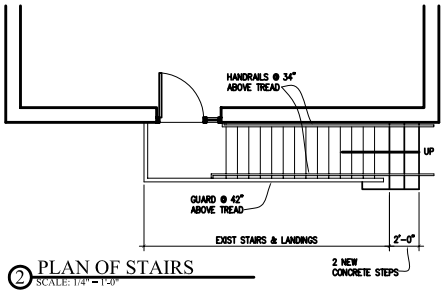

2 PLAN OF STAIRS
SCALE: 1/4" = 1'-0"

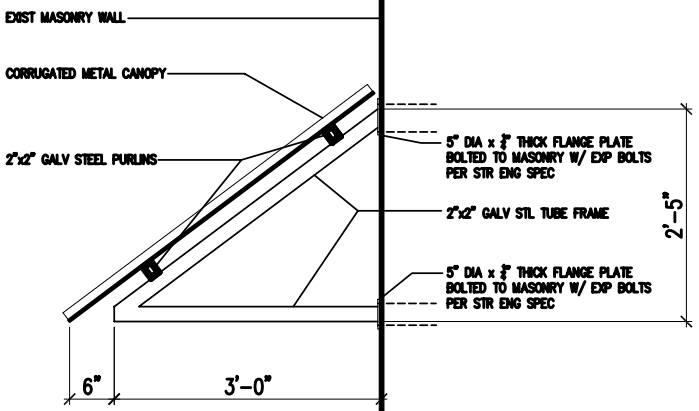

3 CANOPY DETAIL
SCALE: 1 1/2" = 1'-0"

5 WALL & FLOOR TYPES
SCALE: NTS

W1

GA FILE NO. WP 1021 GENERIC 1 HOUR FIRE
50 to 54 STC SOUND
GYPSUM WALLBOARD, STEEL STUDS
One layer 5/8" type X plain or predecorated gypsum wallboard applied parallel to ONE SIDE of 6" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 24" adhesive beads at intermediate studs.
OPPOSITE SIDE: Base layer 5/8" type X gypsum wallboard applied parallel to studs with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs. Face layer 5/8" type X plain or predecorated gypsum wallboard applied parallel to studs with 1 1/4" Type S drywall screws 8" o.c. at vertical joints and 24" adhesive beads at intermediate studs.
Joints staggered 24" each layer and side. Sound tested with 3 1/2" glass fiber insulation friction fit in stud space and all layers were attached without adhesive. (NLB)



Thickness: 6"
Limiting Height: Refer to Section IV
Approx. Weight: 7 psf
Fire Test: GA WP 65, 12-8-88
Sound Test: RAL TL88-58, 2-10-88

W2

UNRATED,
GYPSUM WALLBOARD, STEEL STUDS



W3

1 HOUR FIRE
NBS BMS Report 92, Table 32
METAL LATH, CEMENT PLASTER
Portland cement/sanded/sand ckeese mix 4½:1:7 spray applied
in multiple layers 1½" thick to both sides of No. 6, 4"x4" welded wire lath.

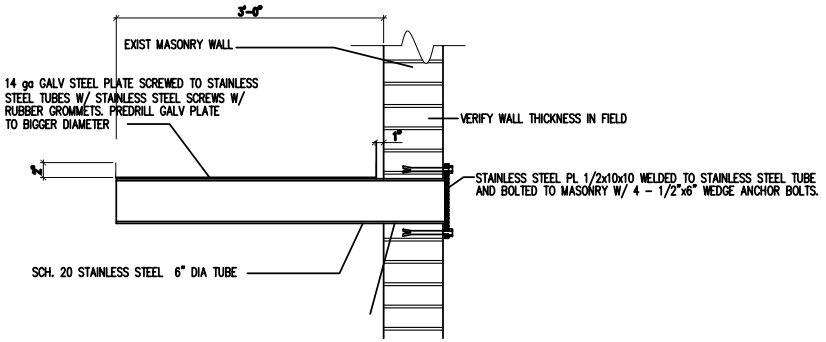

4 CANOPY DETAIL
SCALE: 1 1/2" = 1'-0"

F1

GA FILE NO. FC 5240 GENERIC 1 HOUR FIRE
50 to 53 STC SOUND
WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS
One layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. with 1" type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 24" long with screws 12" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 16" o.c. with 1 1/4" Type W drywall screws. Wood joists supporting 1" nominal T & G wood subfloor and 1" nominal wood finish floor, or 19/32" plywood finished floor with long edges T & G and 19/32" interior plywood with exterior glue subfloor perpendicular to joists with joints staggered.

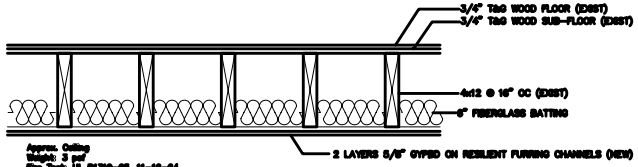

Approx. Ceiling
Weight: 3 psf
Fire Test: UL R1310-65, 11-10-64,
UL Design L514
Sound Test: CK 6512-S, 7, 4-10-65
82 & Test: 39 (57 C & F)
CK 6512-S, 4-10-65

OWNER:

ARCHETYPE, P.A.
ARCHITECTS
48 Union Wharf Portland, Maine 04101
(207) 772-6022 Fax (207) 772-4056

Project:
73 OAK ST
OAK ST
PORTLAND, ME

Scale AS NOTED
Date JAN 11, 2006
Revisions:

REAR STAIRS

A-2