


511 Congress St 5th floor

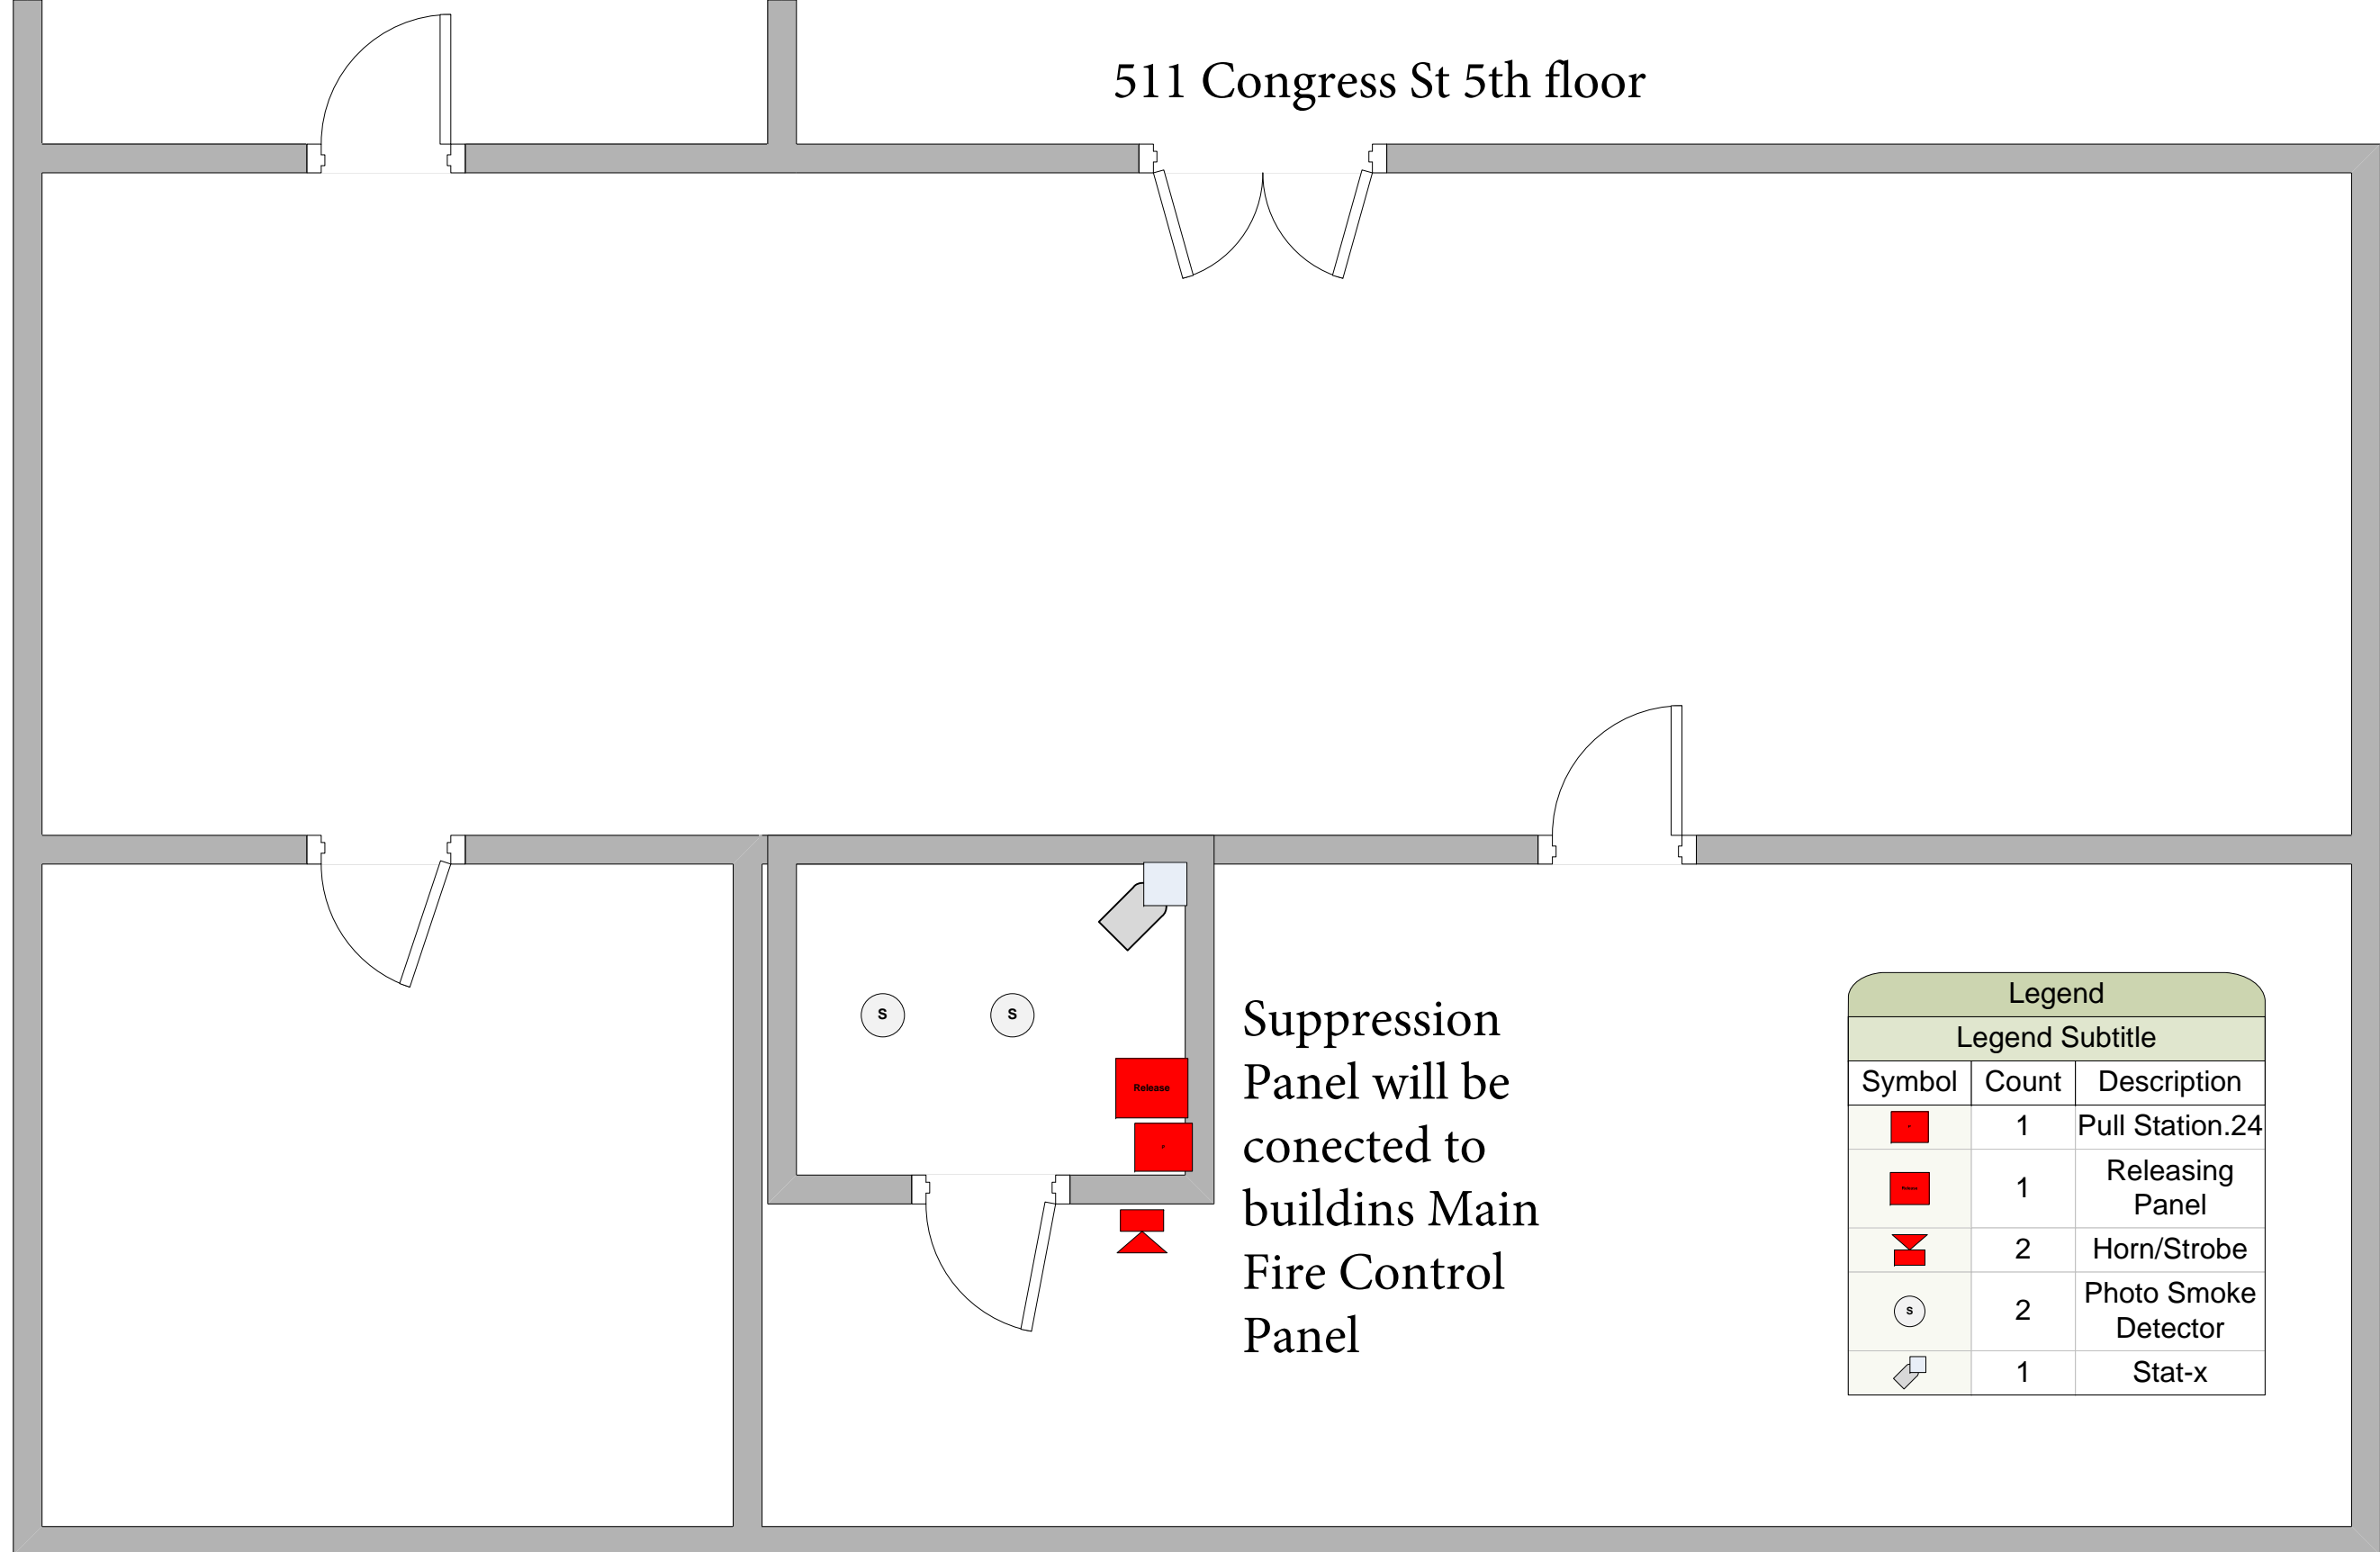

Suppression Panel will be conected to buildins Main Fire Control Panel

Legend		
Legend Subtitle		
Symbol	Count	Description
	1	Pull Station.24
	1	Releasing Panel
	2	Horn/Strobe
	2	Photo Smoke Detector
	1	Stat-x

Eric Colby, Certified Engineering Technician, Level 3 NICET Cert. # 116800			
-	20 Thomas Drive Westbrook ME 04092	08-13-14	Rev 0