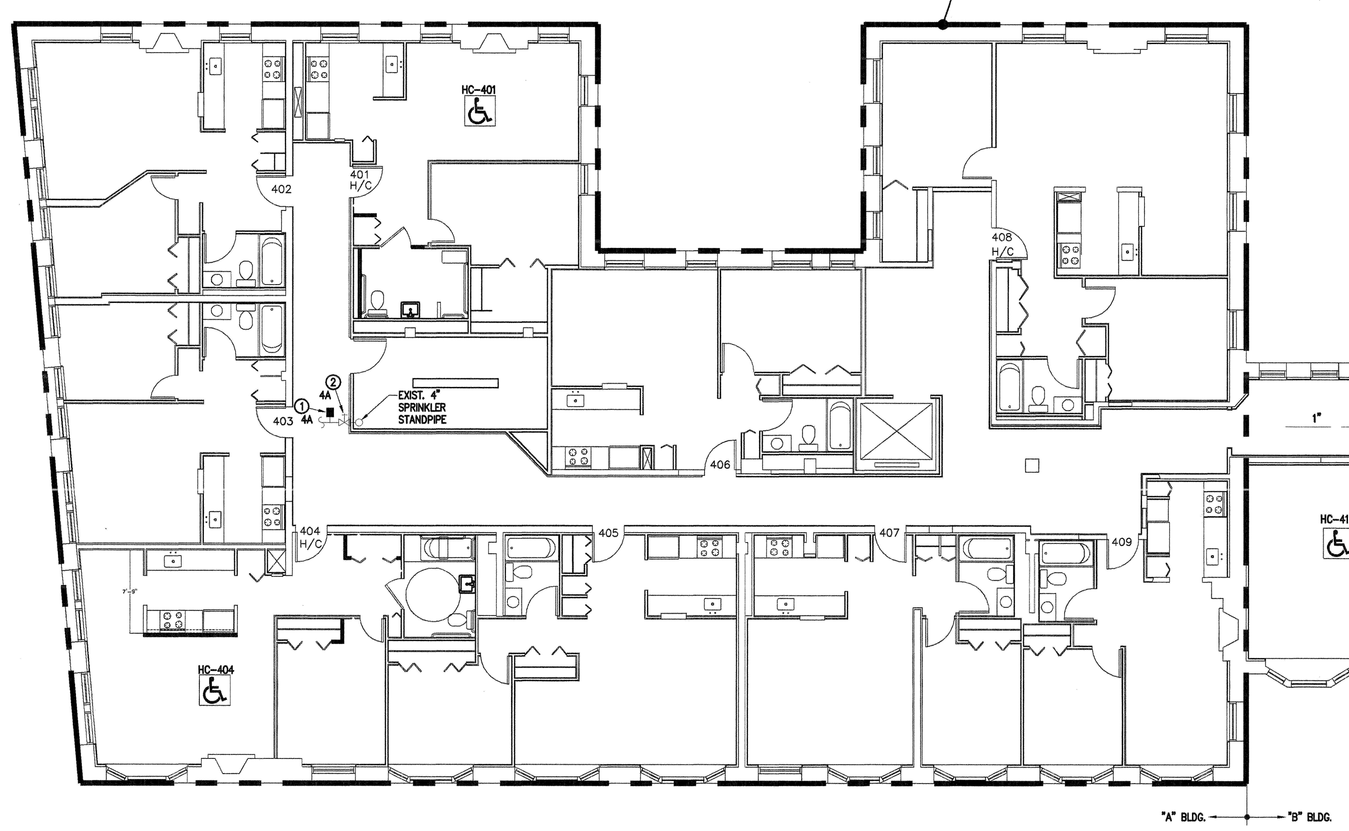

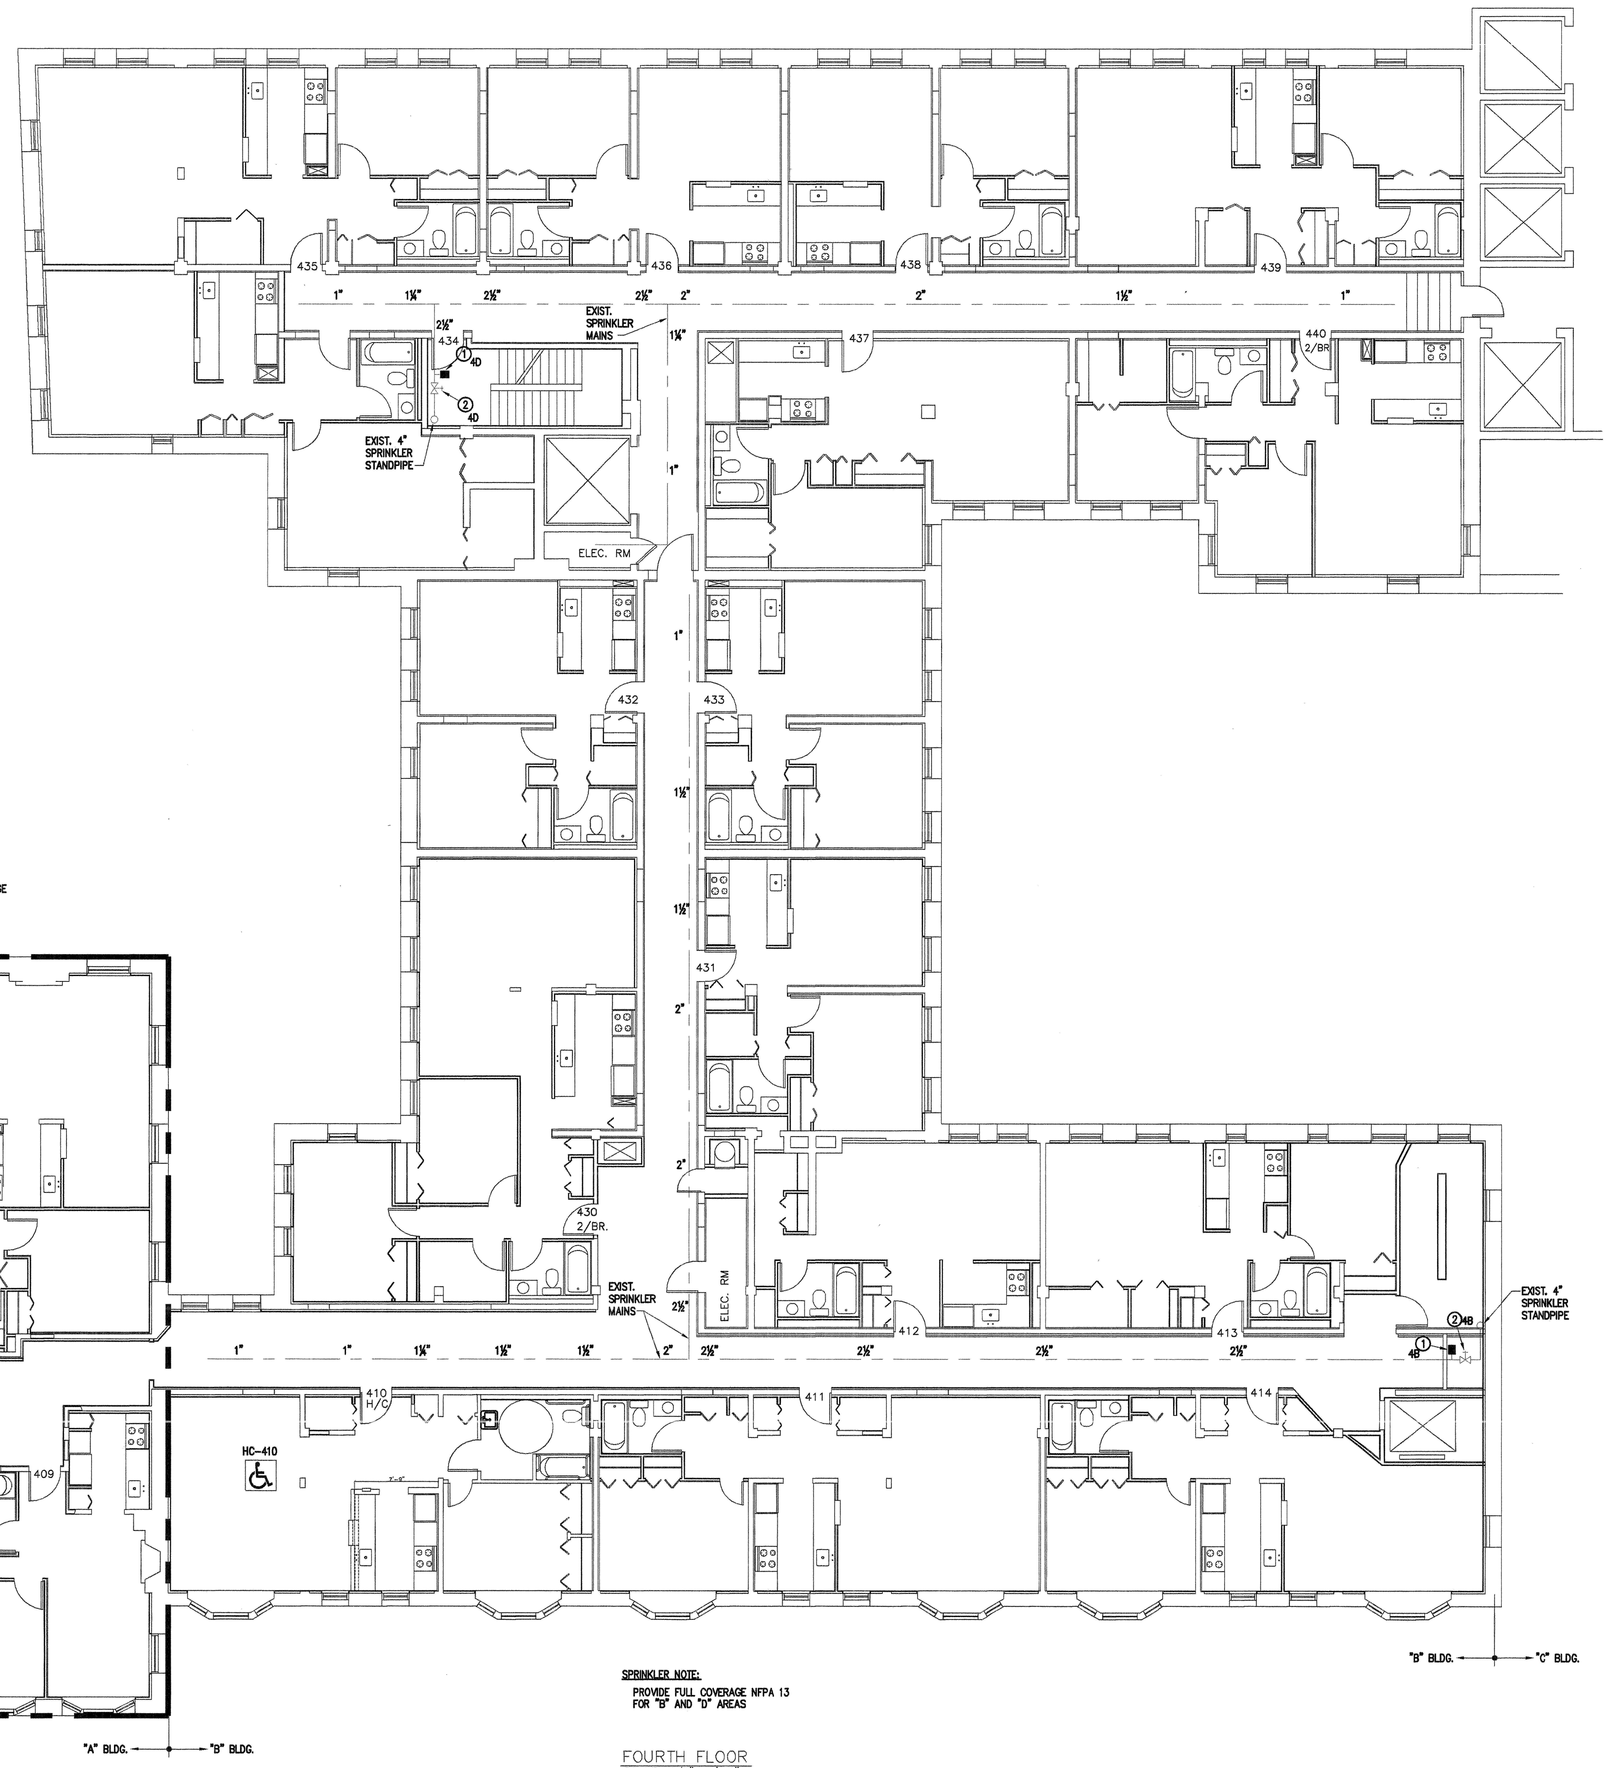

SPRINKLER NOTE:
PROVIDE FULL COVERAGE NFPA 13 FOR "B" AND "D" AREAS

FOURTH FLOOR
SCALE: 1/8" =1'-0"

SPRINKLER LEGEND:

1 AX — EXISTING FLOW SWITCH (OR NEW) TO BE UPGRADED FOR NEW FIRE ALARM SYSTEM INTEGRATION.

2 AX — EXISTING OS&Y VALVE (OR NEW) WITH UPGRADED SUPERVISED SWITCH FOR NEW FIRE ALARM SYSTEM.

(FIRST LETTER) EQUALS WHICH FLOOR ; FOR INSTANCE B = BASEMENT
(SECOND LETTER) EQUALS WHICH BLDG. ; FOR INSTANCE C = "C" BLDG.

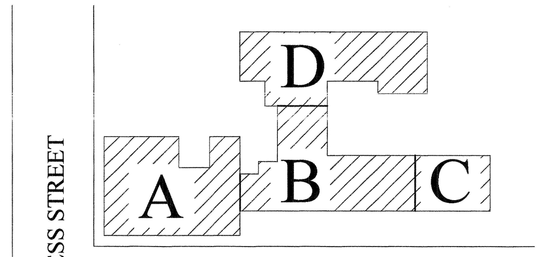

STATE OF ILLINOIS
ANDREW W. MELLEN
WILMINGTON, IL.
31772
REGISTERED
PROFESSIONAL ENGINEER
2/4/05

BID
SET
FEBRUARY 4, 2005

AWM engineering, inc.
CONSULTING ENGINEERS
Mechanical ✦ Environmental ✦ Electrical ✦ Construction Management
88 State Street, Gorham, Maine 04038 Tel.(207)839-2167
E-Mail: stu@awmeng.com Fax.(207)839-2168

Owner:
HARBOR MANAGEMENT CO.
23 CENTRAL AVENUE
SUITE 710
LYNN, MA 01901

Architect:
ARCHETYPE, P.A.
ARCHITECTS
48 Union Wharf Portland, Maine 04101
(207) 772-6022 Fax (207) 772-4056

Project:
RENOVATION OF
CONGRESS SQUARE PLAZA
10 CONGRESS STREET
PORTLAND, MAINE 04101

Date:	Scale:
2-4-05	1/8"=1'-0"
Drawn: CLC	Checked: AWM

Drawing:
FOURTH FLOOR APARTMENTS
MECHANICAL

M4