A3 - 12' LONG TRACK LIGHT, 7 HEADS A4 - 14' LONG TRACK LIGHT, 8 HEADS

B - RECESSED DOWNLIGHT 6" ROUND (INTERIOR)

C - 24" X 24" LAY-IN LED (ACT GRID CEILING)

D - DECORATIVE PENDANT

E - DECORATIVE WALL SCONCE

GENERAL CEILING NOTES

1. EXISTING GWB CEILING INSTALLED ON WOOD STRUCTURE ABOVE TO REMAIN.


2. ALL EXISTING ACT CEILINGS TO BE REMOVED.


3. INSTALL NEW 1-HOUR FIRE RATED CEILING CONTINUOUS THROUGHOUT TENANT SPACE. SEAL ALL PENETRATIONS WITH FIRESTOPPING.

4. MECHANICAL DIFFUSERS NOT SHOWN. GC COORDINATE WITH DESIGN -BUILD MECHANICAL CONTRACTOR

5. SPRINKLER SYSTEM NOT SHOWN. GC COORDINATE WITH SPRINKLER MANUFACTURE FOR NFPA 13 COMPLIANT SPRINKLER SYSTEM

ELECTRICAL/LIGHTING SYMBOL LEGEND			
	4' SURFACE MOUNTED FLUORESCENT LIGHT FIXTURE	-	SURFACE MOUNTED LIGHT FIXTURE
	UNDER-CABINET LIGHT FIXTURE	0	RECESSED LIGHT FIXTURE
X	PENDANT LIGHT FIXTURE	\bigoplus	WALL MOUNTED LIGHT FIXTURE
	WALL MOUNTED STRIP LIGHT	#	EXHAUST FAN/LIGHT
<u> </u>	TRACK LIGHTING		HORN/STROBE NOTIFICATION DEVICE
SD	SMOKE DETECTOR	Þ(Ø	STROBE ONLY NOTIFICATION DEVICE
HD	HEAT DETECTOR	A	EMERGENCY LIGHT
FACP	FIRE ALARM CONTROL PANEL		2X2 LED TROFFER LIGHT FOR ACT INSTALLATION

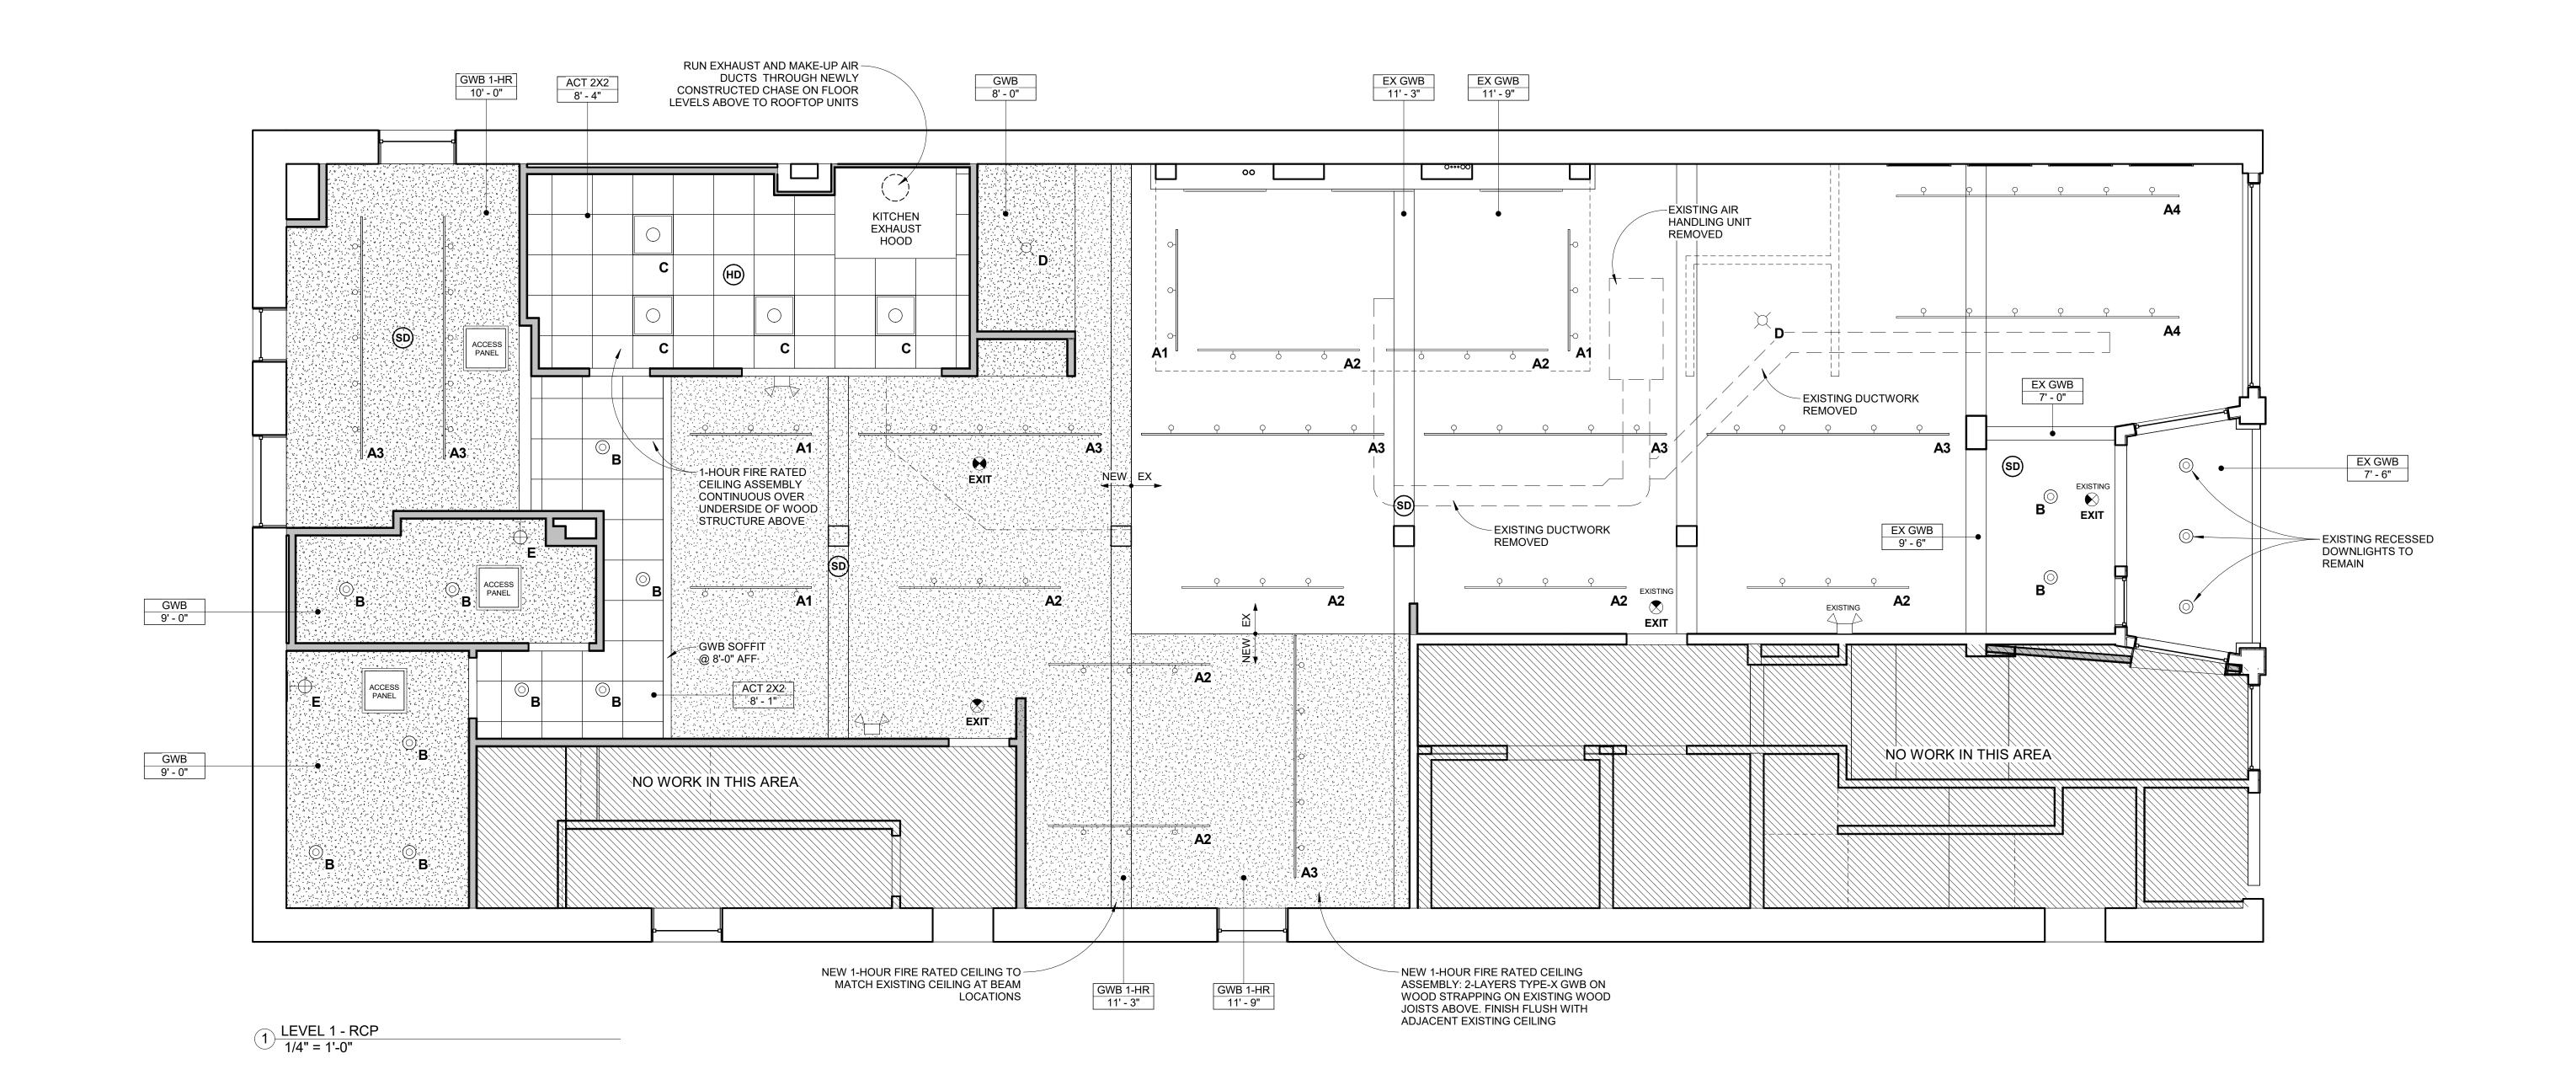



STREET **PREBLE**

CONSULTANTS:

REVISIONS: No. Name Date

ISSUED: 12/29/16 PROJECT No:

DRAWN BY: CHECKED BY:

SHEET TITLE: FIRST FLOOR RCP

A111