1. RETAIN AND RELOCATE LIFE SAFETY DEVICES PER APPLICABLE CODES AND REGULATIONS, INCLUDING HORNS/STROBE AND EMERGENCY LIGHTING. 2. ALL STRUCTURAL INTEGRITY SHALL BE MAINTAINED THROUGHOUT, INCLUDING ANY TEMPORARY SHORING, ETC. AS NEEDED.

3. MAINTAIN WEATHER TIGHT CONDITIONS OF AFFECTED AREAS AS NEEDED. 4. DOORS SCHEDULED FOR REMOVAL TO BE SALVAGED FOR REUSE. 5. ELECTRICAL, MECHANICAL AND PLUMBING NOTED TO BE REMOVED SHALL BE DONE SO TO THE GREATEST EXTENT POSSIBLE WITHOUT CAUSING

DISRUPTION TO OTHER SERVICES. 6. MATERIALS NOTED TO BE REMOVED SHALL BE PROPERLY DISPOSED OF BY GC UNLESS NOTED OTHERWISE.

7. ALL EXISTING WINDOWS TO REMAIN UNLESS NOTED OTHERWISE.

# | NOTE 1 REMOVE EXISTING PARTITION IN ITS ENTIRETY

2 REMOVE EXISTING PARTITION AS INDICATED

3 REMOVE EXISTING DOOR AND FRAME IN ITS ENTIRETY

4 REMOVE EXISTING WINDOW AND FRAME IN ITS ENTIRETY 5 REMOVE EXISTING ACT CEILING (TILES, GRID AND SUSPENSION) AND ALL EXISTING LIGHTING, MECHANICAL DIFFUSERS, AND CEILING MOUNTED DEVICES &

6 REMOVE EXISTING SOFFIT

ACCESSORIES

7 REMOVE EXISTING FLOORING AND SUBFLOORING IN ITS

8 REMOVE EXISTING PLUMBING FIXTURE AND PIPING AS REQUIRED TO COORDINATE WITH NEW FIXTURE INSTALLATION

## **CODE SUMMARY:**

PROJECT SUMMARY: ARCADIA

INTERIOR RENOVATION OF EXISTING ARCADE BAR AND EXPANSION TO OCCUPY SPACE PREVIOUSLY USED AS OFFICE SPACE BY SEPARATE TENANT. NEW ARRANGEMENT WILL INCLUDE ONLY ONE TENANT ON FIRST FLOOR OF BUILDING.

EXISTING SPRINKLER SYSTEM THROUGHOUT BUILDING IN COMPLIANCE WITH NFPA 13.

## **IBC 2009 CODE REVIEW SUMMARY**

CONSTRUCTION TYPE: III-B

USE & OCCUPANCY CLASSIFICATION (304.1) ASSEMBLY GROUP A

OCCUPANCY LOAD (table 1004.1) ASSEMBLY CONCENTRATED 7 SF/PERSON GROSS ASSEMBLY UNCONCENTRATED 15 SF/PERSON GROSS

EXIT TRAVEL DISTANCE (1016.1) 300' WITH SPRINKLER SYSTEM

NUMBER OF EXITS (1021.1) OCCUPANT LOAD 1-500 PER STORY; 2 INDEPENDENT EXITS

## NFPA 101 CODE REVIEW SUMMARY

CONSTRUCTION TYPE (NFPA 220) TYPE III 200

OCCUPANCY CLASSIFICATION (NFPA 101 6.1.2) ASSEMBLY

SPRINKLER SYSTEM FULLY SPRINKLED, SUPERVISED

OCCUPANT LOAD FACTORS (7.3.1.2) ASSEMBLY CONCENTRATED 7 SF/PERSON ASSEMBLY LESS CONCENTRATED 15 SF/PERSON

ARCADIA OCCUPANCY:

MAIN LOUNGE BAR SEATING SITTING AREA

PRIVATE LOUNGE KITCHEN

TOTAL OCCUPANCY:

EXISTING BASEMENT TO REMAIN 13

162 PEOPLE


BAR (STAFF)


NUMBER OF MEANS OF EGRESS (7.4)

COMMON PATH OF TRAVEL (12.2.5.1.2)

TRAVEL DISTANCE (12.2.6) 250' WITH SPRINKLER SYSTEM

EGRESS DOOR CAPACITY FACTOR 0.2

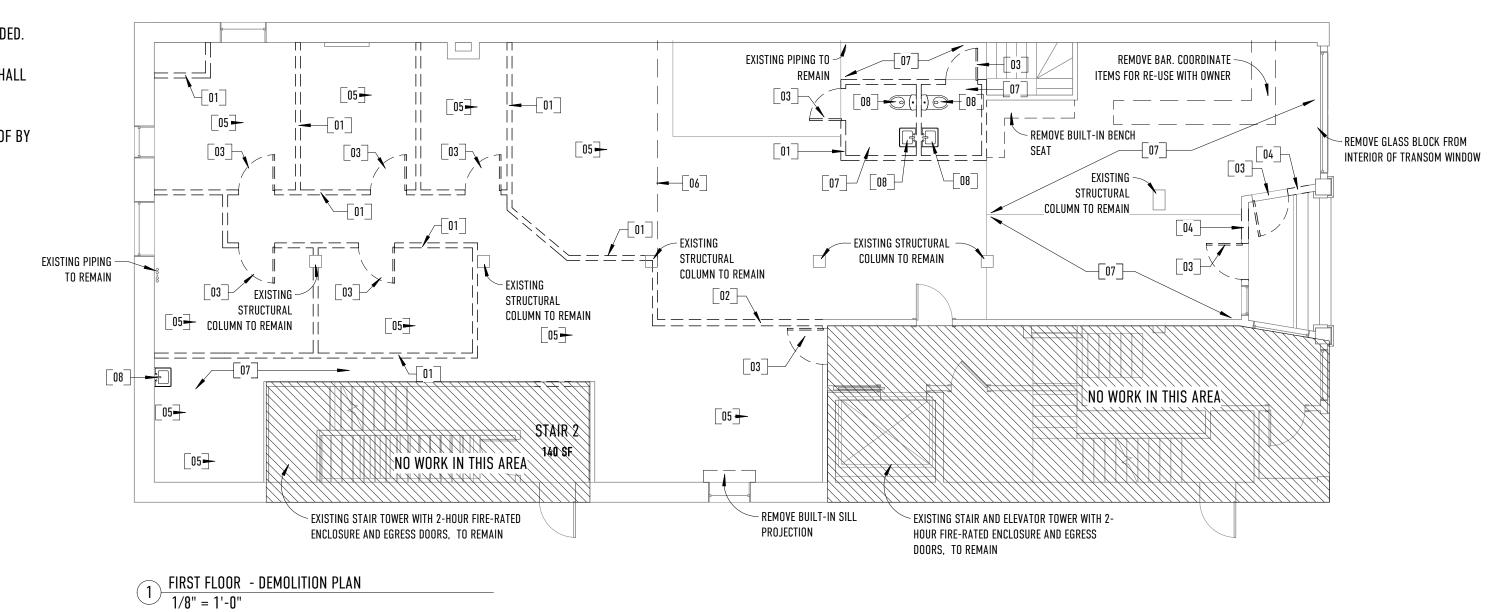

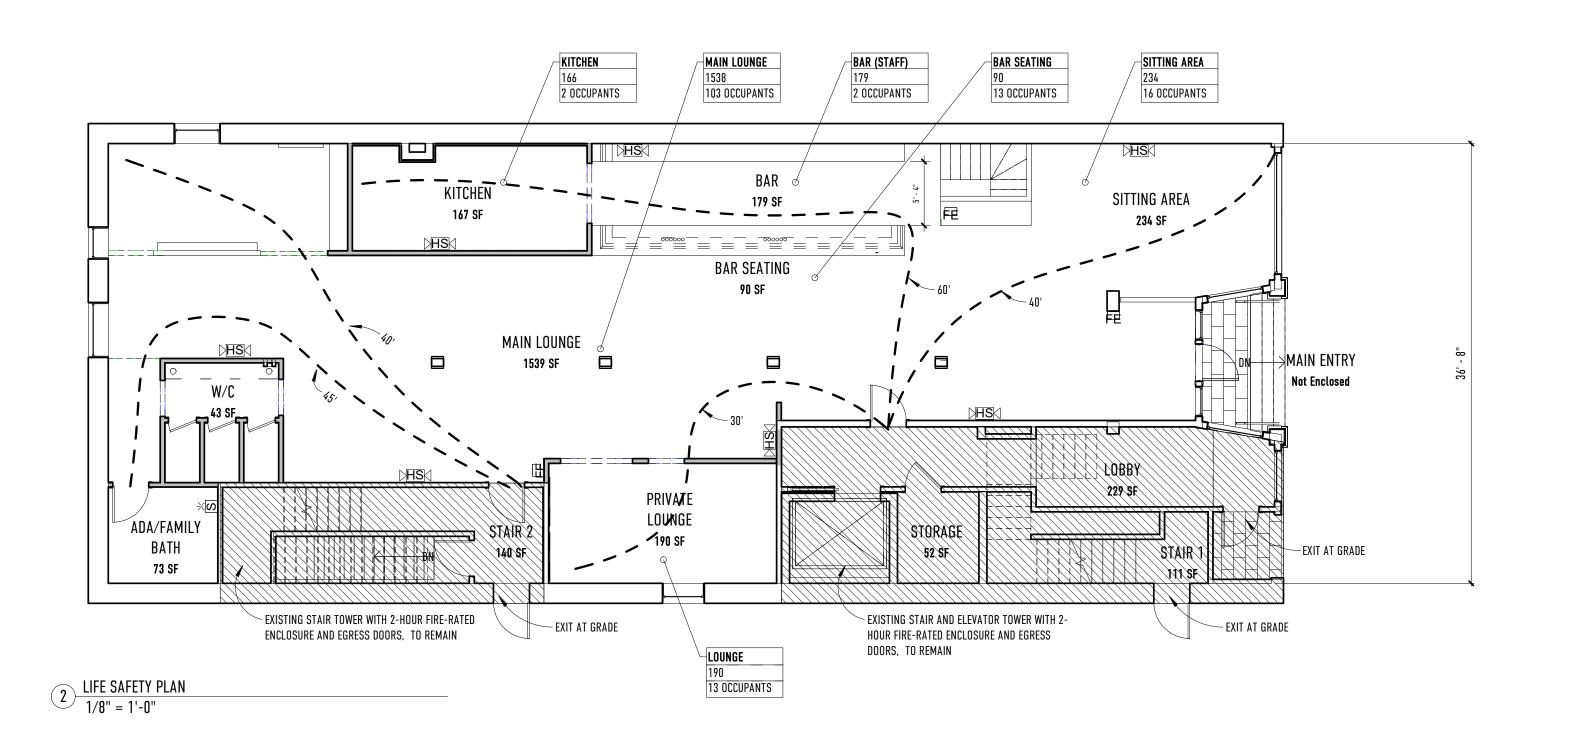

 $\forall$ S

PLAN

A001

**DEMO**