

REVISION	DESCRIPTION	DATE
0	ISSUED FOR REVIEW & APPROVAL	1/30/2017


RESERVED FOR CITY STAMP

**CUNNINGHAM**  
 Security Systems  
 10 Princes Point Road, Yarmouth, Maine 04096  
 Office: 207.846.3350 • Fax: 207.846.6080


**24 PEBBLE STREET**  
**PORTLAND, MAINE 04101**  
**BASEMENT FIRE ALARM PLAN**

DRAWN	JPB UNICAD JOB #17018
CHECKED	WAYNE B. HAWES NCET # 90496
DATE	1/30/2017
REVISION	0
SCALE	AS NOTED

**FA-2**

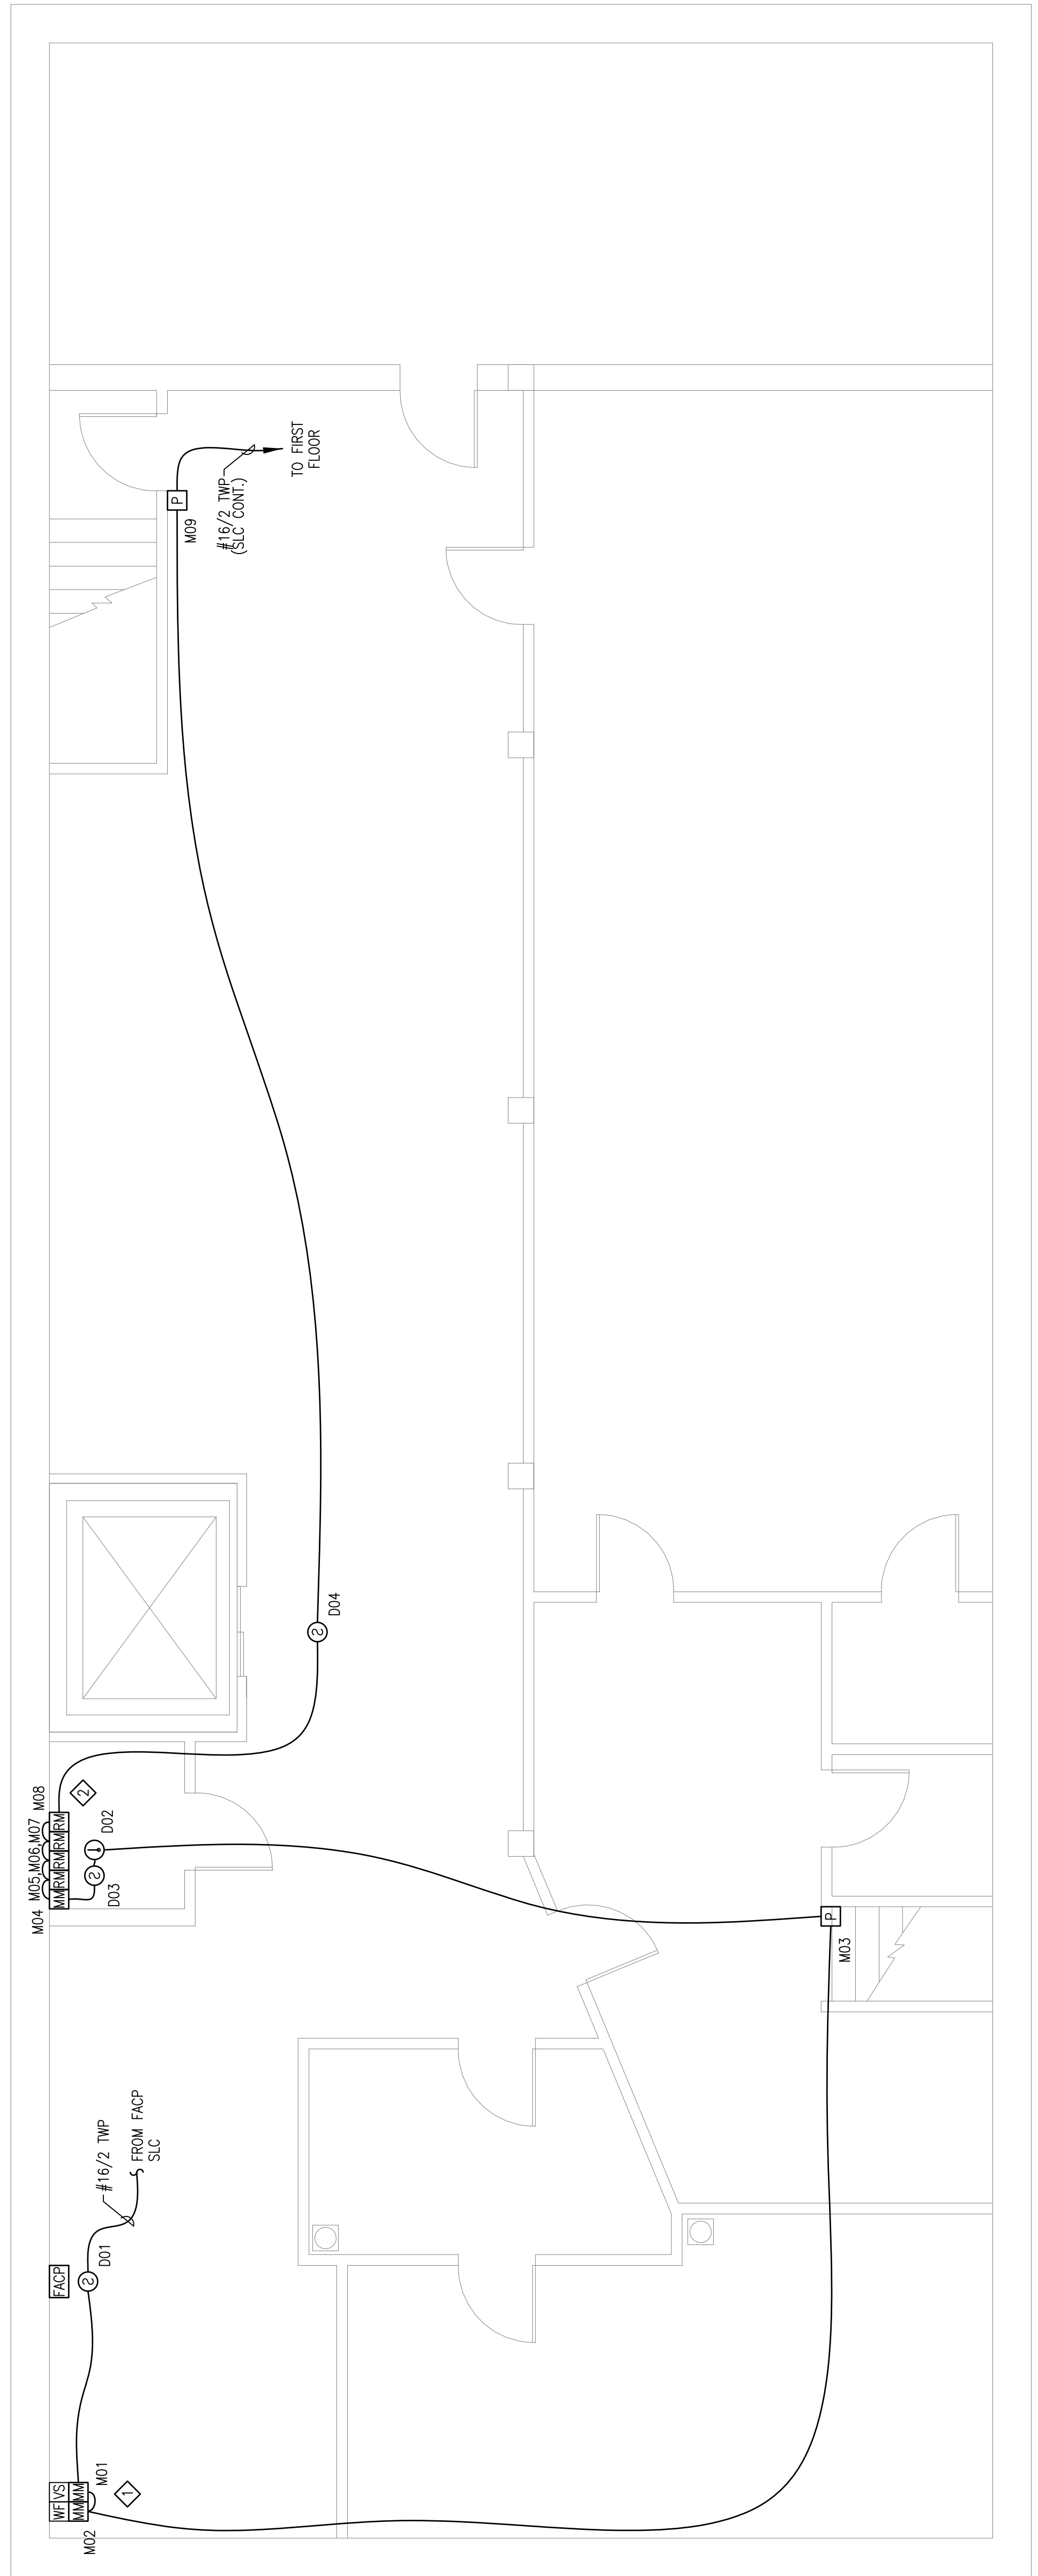

**DEVICE NOTE:**  
 - EXISTING SMOKE DETECTORS AND PULL STATIONS ARE TO BE REPLACED WITH NEW ADDRESSABLE DEVICES.  
 - EXISTING NOTIFICATION TO REMAIN AS IS.  
 - INSTALL A NEW ADDRESSABLE FIRE ALARM CONTROL PANE WITH SMOKE DETECTOR ABOVE.  
 - MONITOR NEW SPRINKLER RISER.

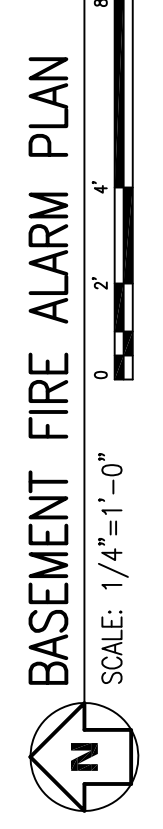

**SHEET NOTES:**

- ◆ ADDRESSABLE RELAY MODULE(S) AND MULTI-VOLTAGE CONTROL RELAY(S) PROVIDED FOR DOOR HOLDER CONTROL. INSTALLING CONTRACTOR SHALL FIELD VERIFY EXACT MOUNTING, CIRCUITING AND PROGRAMMING REQUIREMENTS. FIELD VERIFY POWER SOURCE (24 VDC OR 120 VAC). USE MULTI-VOLTAGE CONTROL RELAY(S) IF REQUIRED. FIELD VERIFY EXACT QUANTITY AND LOCATION(S).
- ◆ ADDRESSABLE MONITOR MODULE(S) PROVIDED TO MONITOR ALL WATER FLOW, PRESSURE SWITCHES, TAMPER SWITCHES AND POST INDICATING VALVES ASSOCIATED WITH THE FIRE SPRINKLER SYSTEM. INSTALLING CONTRACTOR SHALL FIELD VERIFY EXACT MOUNTING, CIRCUITING AND PROGRAMMING REQUIREMENTS. FIELD VERIFY EXACT QUANTITY AND LOCATION(S).

**UNICAD** Inc.  
 Fire Alarm Design & Drafting Services  
 578 W. 40th St.  
 Portland, ME 04102  
 Office: 603.865.6410  
 www.unicad.net