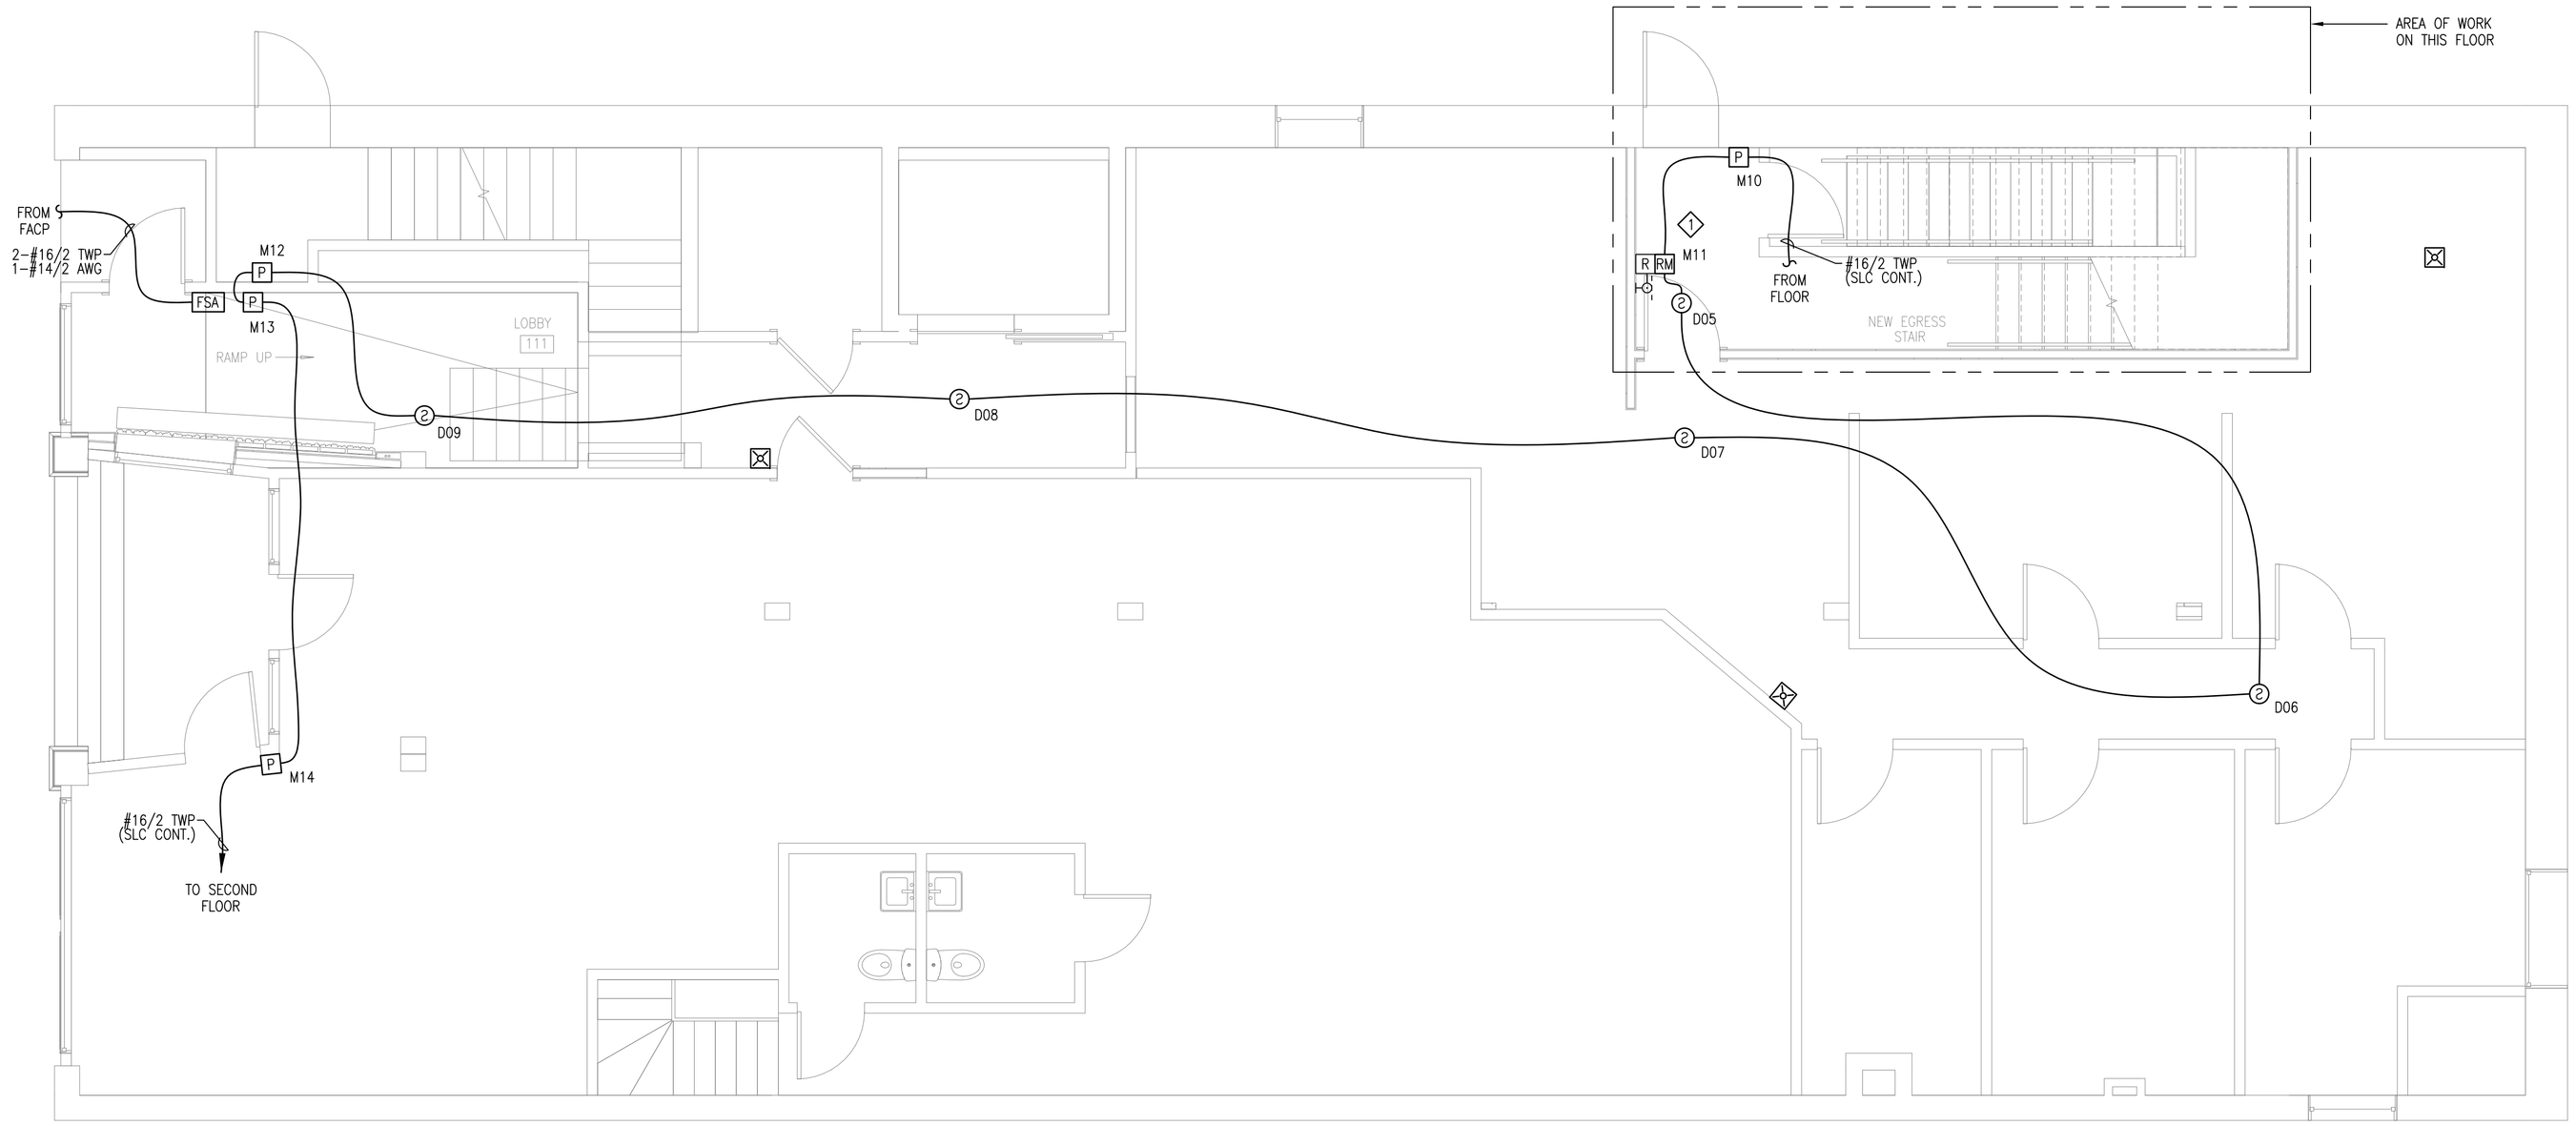

RESERVED FOR CITY STAMP

REVISION	DESCRIPTION	DATE
0	ISSUED FOR REVIEW & APPROVAL	1/30/2017

CUNNINGHAM
Security Systems
10 Princes Point Road, Yarmouth, Maine 04096
Office: 207.846.3350 • Fax: 207.846.6080

SHEET NOTES:

1. ADDRESSABLE RELAY MODULE(S) AND MULTI–VOLTAGE CONTROL RELAY(S) PROVIDED FOR DOOR HOLDER CONTROL. INSTALLING CONTRACTOR SHALL FIELD VERIFY EXACT MOUNTING, CIRCUITING AND PROGRAMMING REQUIREMENTS. FIELD VERIFY POWER SOURCE (24 VDC OR 120 VAC). USE MULTI–VOLTAGE CONTROL RELAY(S) IF REQUIRED. FIELD VERIFY EXACT QUANTITY AND LOCATION(S).

FIRST FLOOR FIRE ALARM PLAN

SCALE: 1/4"=1'–0" 0 2' 4' 8'

DEVICE NOTE:
- EXISTING SMOKE DETECTORS AND PULL STATIONS ARE TO BE REPLACED WITH NEW ADDRESSABLE DEVICES.
- EXISTING NOTIFICATION TO REMAIN AS IS.
- INSTALL A NEW REMOTE ANNUNCIATOR AT BOTTOM OF THE LOBBY RAMP.
- NEW REAR STAIRWELL FIRE DOOR, DOOR HOLDER AND SMOKE DETECTOR(S).

24 PREBLE STREET
PORTLAND, MAINE 04101
FIRST FLOOR FIRE ALARM PLAN

DRAWN	JPB UNICAD JOB #17018
CHECKED	WAYNE B. HAWS NICET IV 90496
DATE	1/30/2017
REVISION	0
SCALE	AS NOTED

FA-3

shop drawings created by:
5794 W. 4600 So.
Hooper, UT 84315
Office: 801.985.0410
www.unicad.net
UNICAD Inc.
Fire Alarm Design & Drafting Services