

REVISION	DESCRIPTION	DATE
0	ISSUED FOR REVIEW & APPROVAL	1/30/2017

DATE	DESCRIPTION	DATE

**CUNNINGHAM**

**Security Systems**

10 Princes Point Road, Yarmouth, Maine 04096  
Office: 207.846.3350 • Fax: 207.846.6080


**PORTLAND, MAINE 04101  
THIRD FLOOR FIRE ALARM PLAN**

**24 PEBBLE STREET**

DRAWN	JPB UNICAD JOB #17018
CHECKED	WAYNE B. HAWES NICET # 90496
DATE	1/30/2017
REVISION	0
SCALE	AS NOTED

**FA-5**

**UNICAD** Inc.  
Fire Alarm Design & Drafting Services  
www.unicad.net  
578 W. 40th St.  
Portland, ME 04102  
Office: 603.865.6410

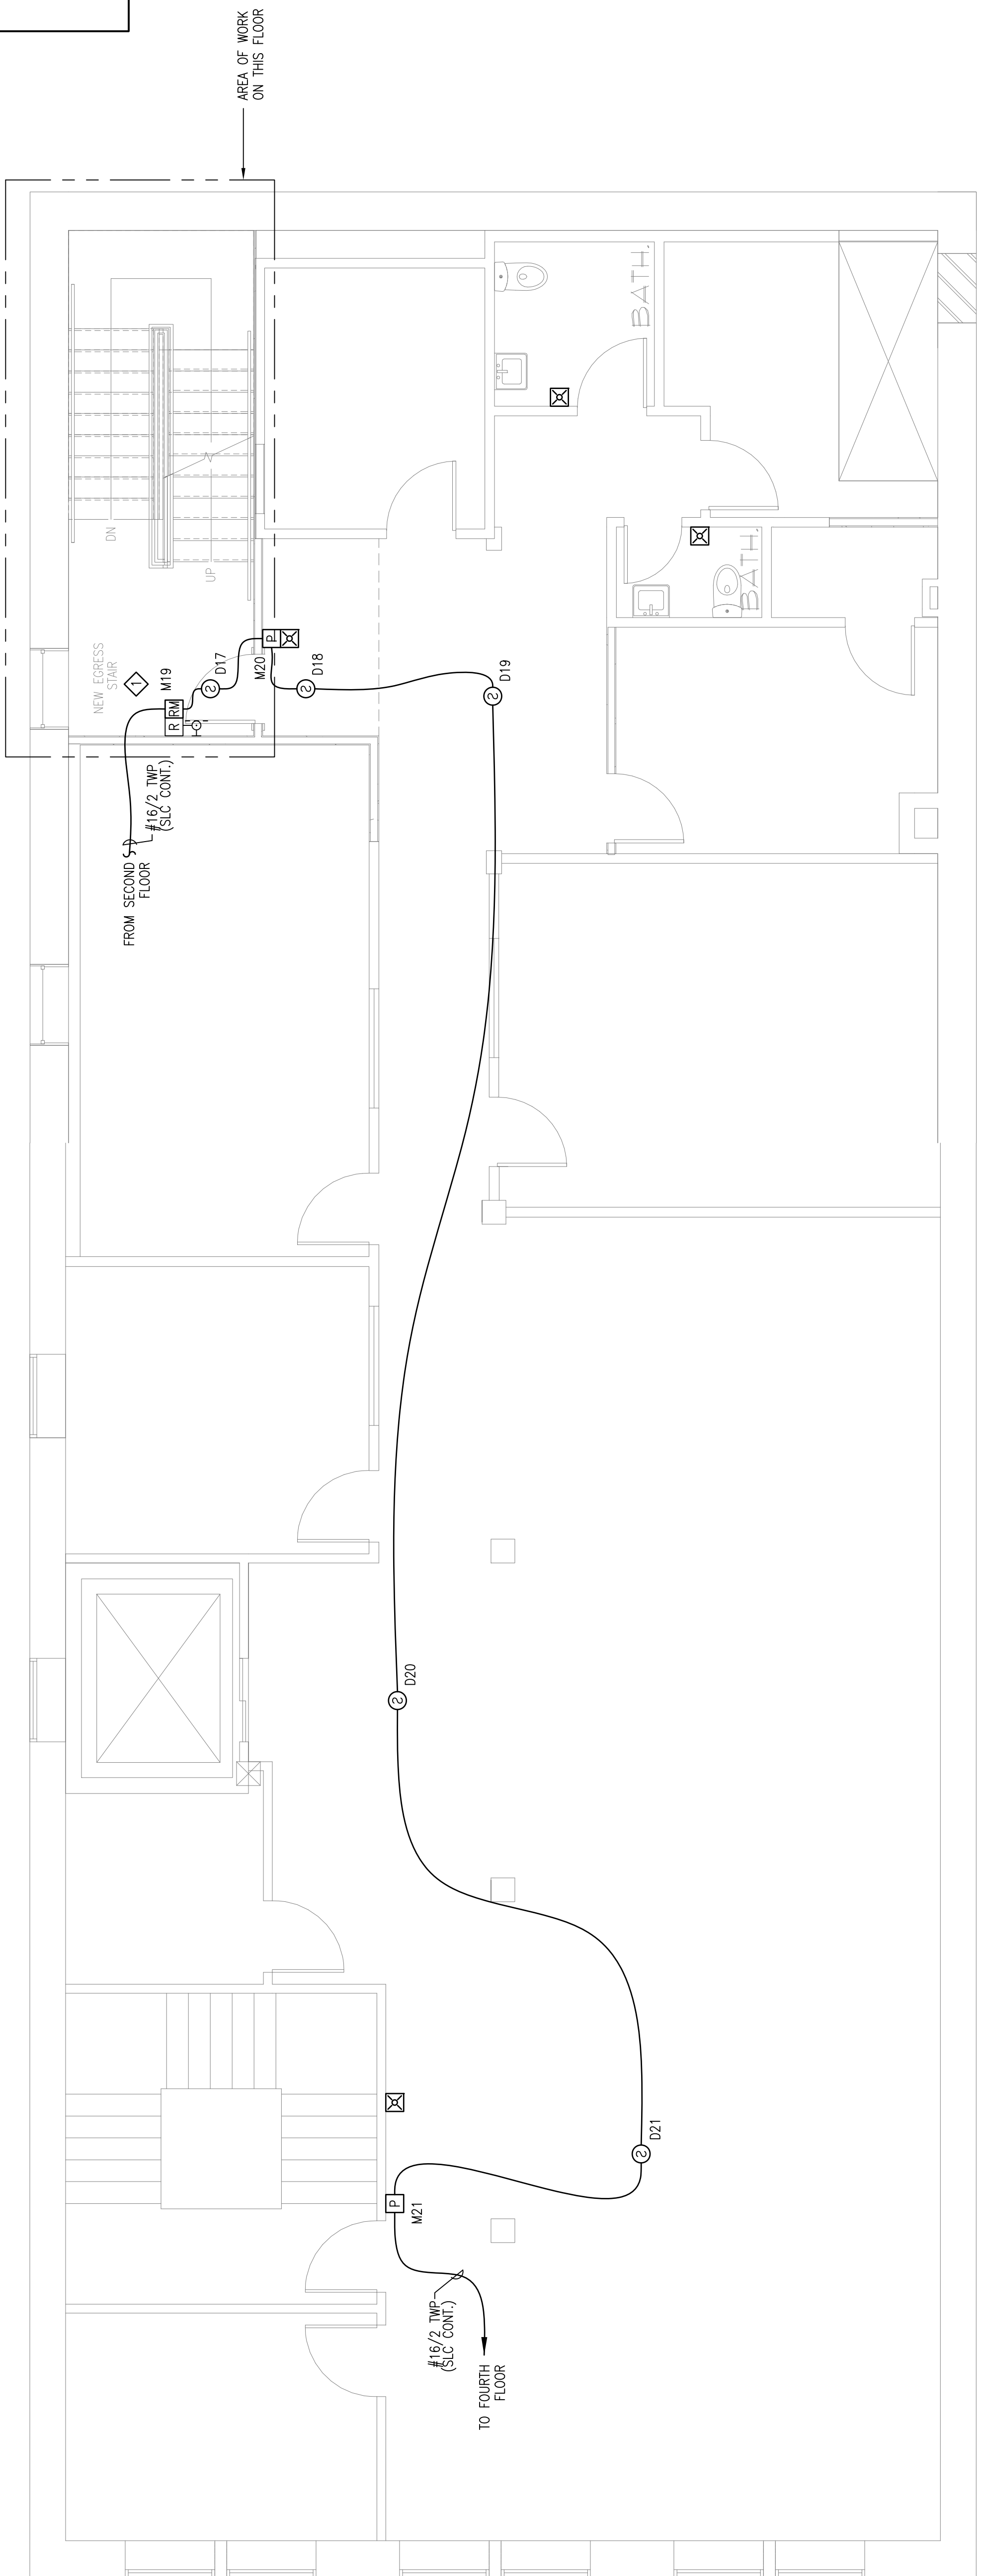

RESERVED FOR CITY STAMP

AREA OF WORK ON THIS FLOOR

FROM SECOND FLOOR  
#16/2 TWP (SLC CONT.)

NEW EGRESS STAIR

DN

UP

M19

FD

D17

M20

D18

D19

D20

D21

M21

FD

BATH

BATH

BATH

BATH

BATH

BATH

BATH

BATH

BATH

BATH

BATH

BATH

BATH

BATH

BATH

BATH

BATH

BATH

**DEVICE NOTE:**  
 - EXISTING SMOKE DETECTORS AND PULL STATIONS ARE TO BE REPLACED WITH NEW ADDRESSABLE DEVICES.  
 - EXISTING NOTIFICATION TO REMAIN AS IS.  
 - NEW REAR STAIRWELL FIRE DOOR, DOOR HOLDER AND SMOKE DETECTOR(S).

**THIRD FLOOR FIRE ALARM PLAN**  
SCALE: 1/4"=1'-0"

**SHEET NOTES:**  
 ◆ ADDRESSABLE RELAY MODULE(S) AND MULTI-VOLTAGE CONTROL RELAY(S) PROVIDED FOR DOOR HOLDER CONTROL. INSTALLING CONTRACTOR SHALL FIELD VERIFY EXACT MOUNTING, CIRCUITING AND PROGRAMMING REQUIREMENTS. FIELD VERIFY POWER SOURCE (24 VDC OR 120 VAC). USE MULTI-VOLTAGE CONTROL RELAY(S) IF REQUIRED. FIELD VERIFY EXACT QUANTITY AND LOCATION(S).