


# MAIN SWITCH ROOM


## NOZZLE PERFORMANCE

START	END	PIPE SIZE	NOZZLE CODE	CU. FT. DISCHARGED
19	301	1 1/4 40 T	.7656	1826
20	302	1 1/4 40 T	.7656	1826
23	303	1 1/4 40 T	.7656	1820.6
22	304	1 1/4 40 T	.7656	1820.6

**TOTAL QUANTITY INERGEN DISCHARGED:** 7294  
**NINETY % DISCHARGED IN APPX.:** 45.91 SECONDS  
**NINETY % DISCHARGE PRESSURE (APPX):** 195 PSI

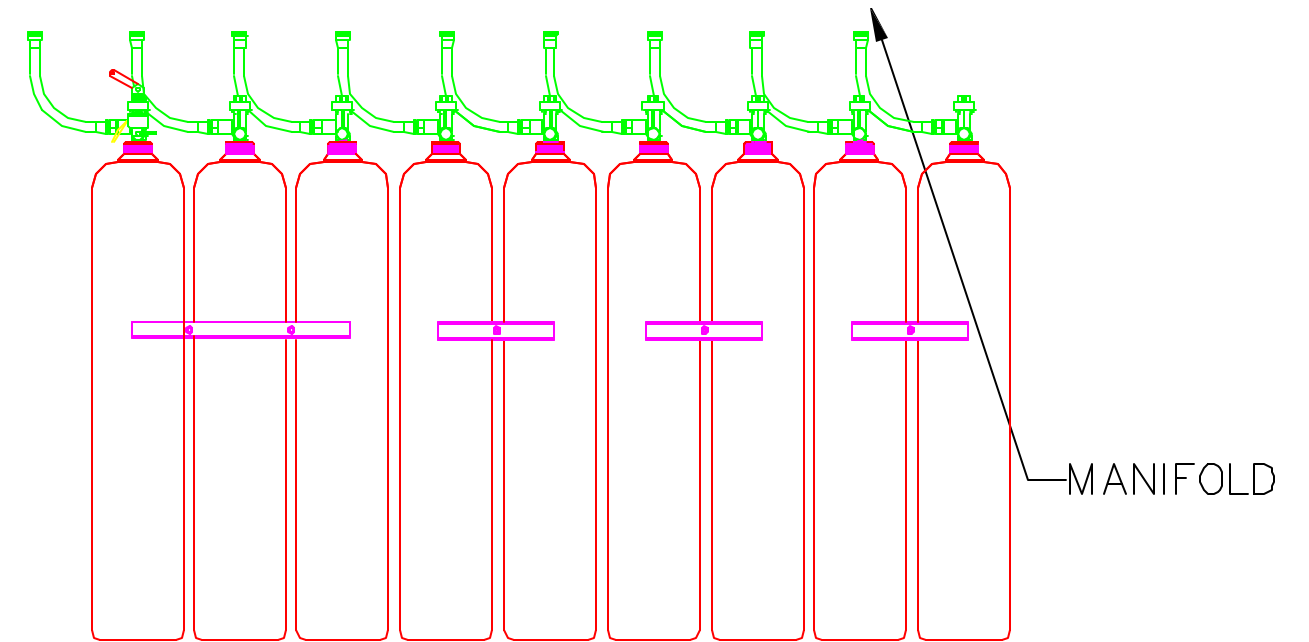

TYPICAL CYLINDER MOUNTING DETAIL  
SHOWING POSSIBLE CYLINDER ARRANGEMENT

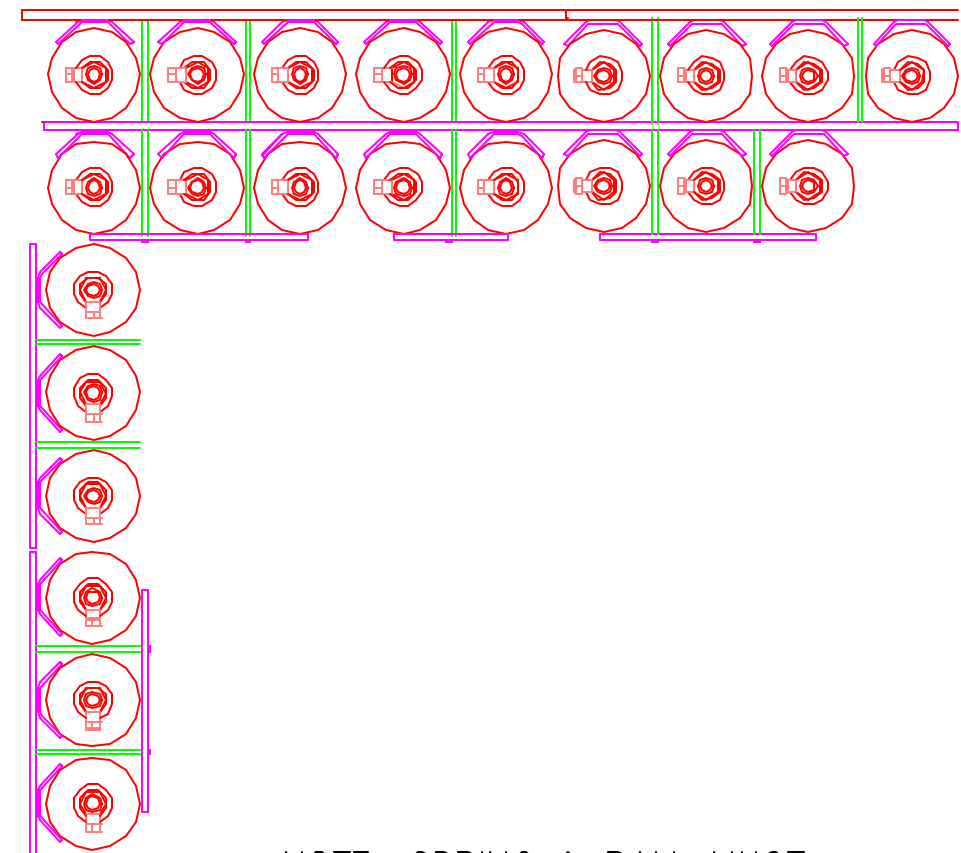

NOTE: SPRING & BALL MUST  
REMAIN IN PLACE WHEN  
INSTALLING ADAPTOR AND  
FLOW.

