


FIRST FLOOR ZONING PLAN 1/8"=1'





FIRST FLOOR ZONING PLAN 1/8"=1'


- HYDRONIC HEATING NOTES:
1. ALL PIPING TO BE COPPER TYPE L OR SCH 40 B WITH 125 PSIG FITTINGS
  2. REFER TO VAV BOX PIPING DETAILS FOR COIL CONNECTIONS
  3. FOR THE CONTROL SEQUENCE FOR THE BUFFER TANK AND CIRCULATOR PUMPS PLEASE REFER TO THE CONTROL SCHEDULE
  4. THE SYSTEM TO BE PASSED WITH A 40% PROPYLENE GLYCOL SOLUTION. THE FILL VALVE TO BE ISOLATED, AFTER COMPLETION.
  5. THE HYDRONIC PIPING TO BE INSULATED WITH FIBERGLASS INSULATION WITH ASL.
  6. NOTE: RELOCATE EXISTING HOFRMAN PUMP SET IF REQUIRED TO ACCOMMODATE NEW SYSTEMS.

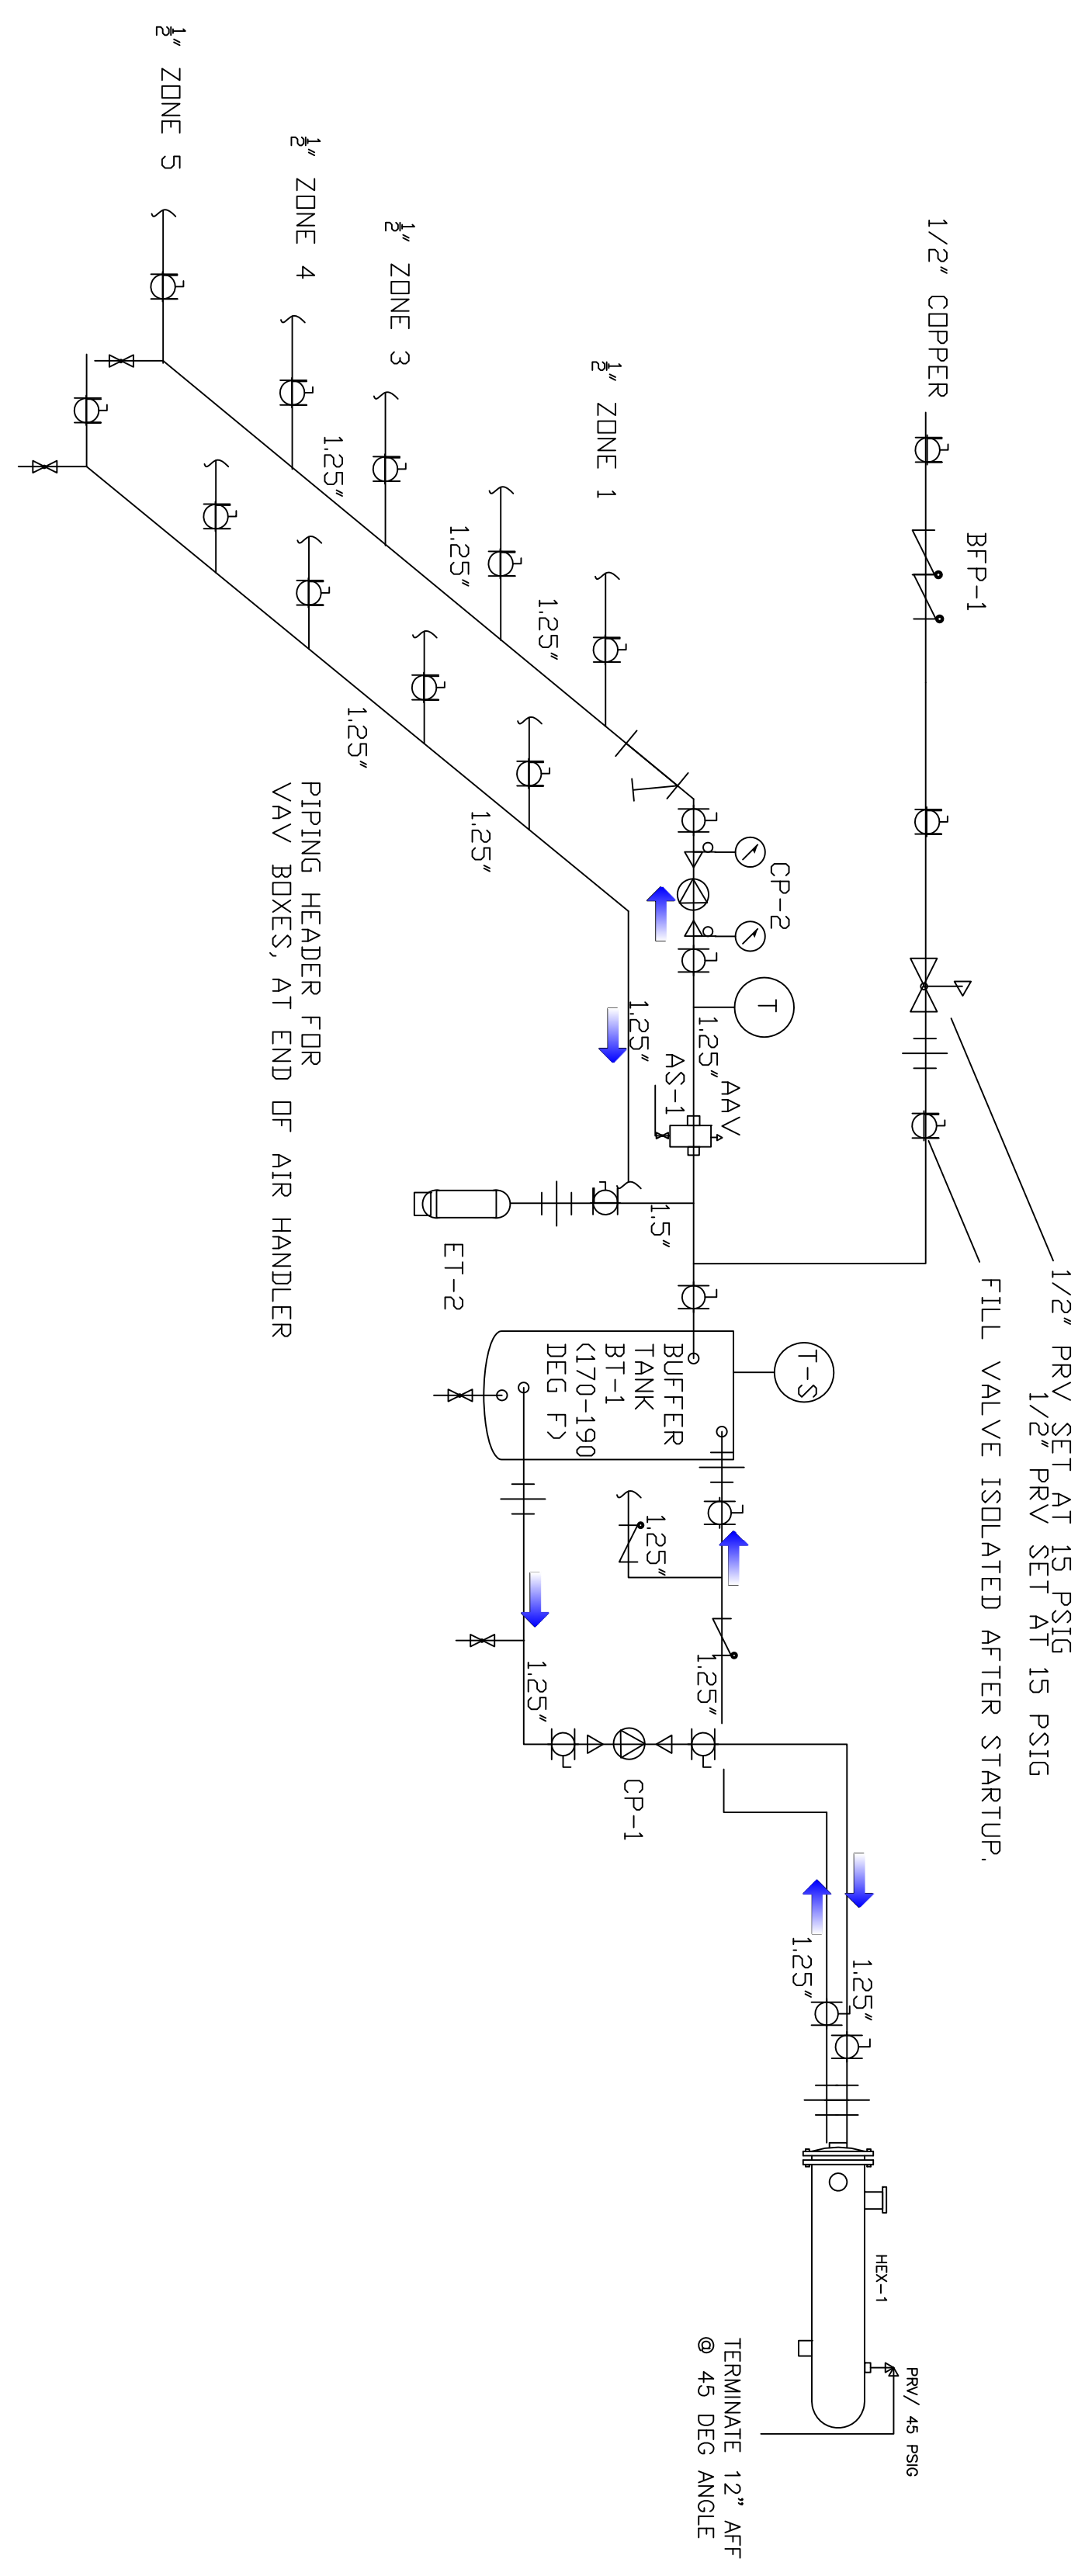

HYDRONIC PIPING SCHEMATIC NTS

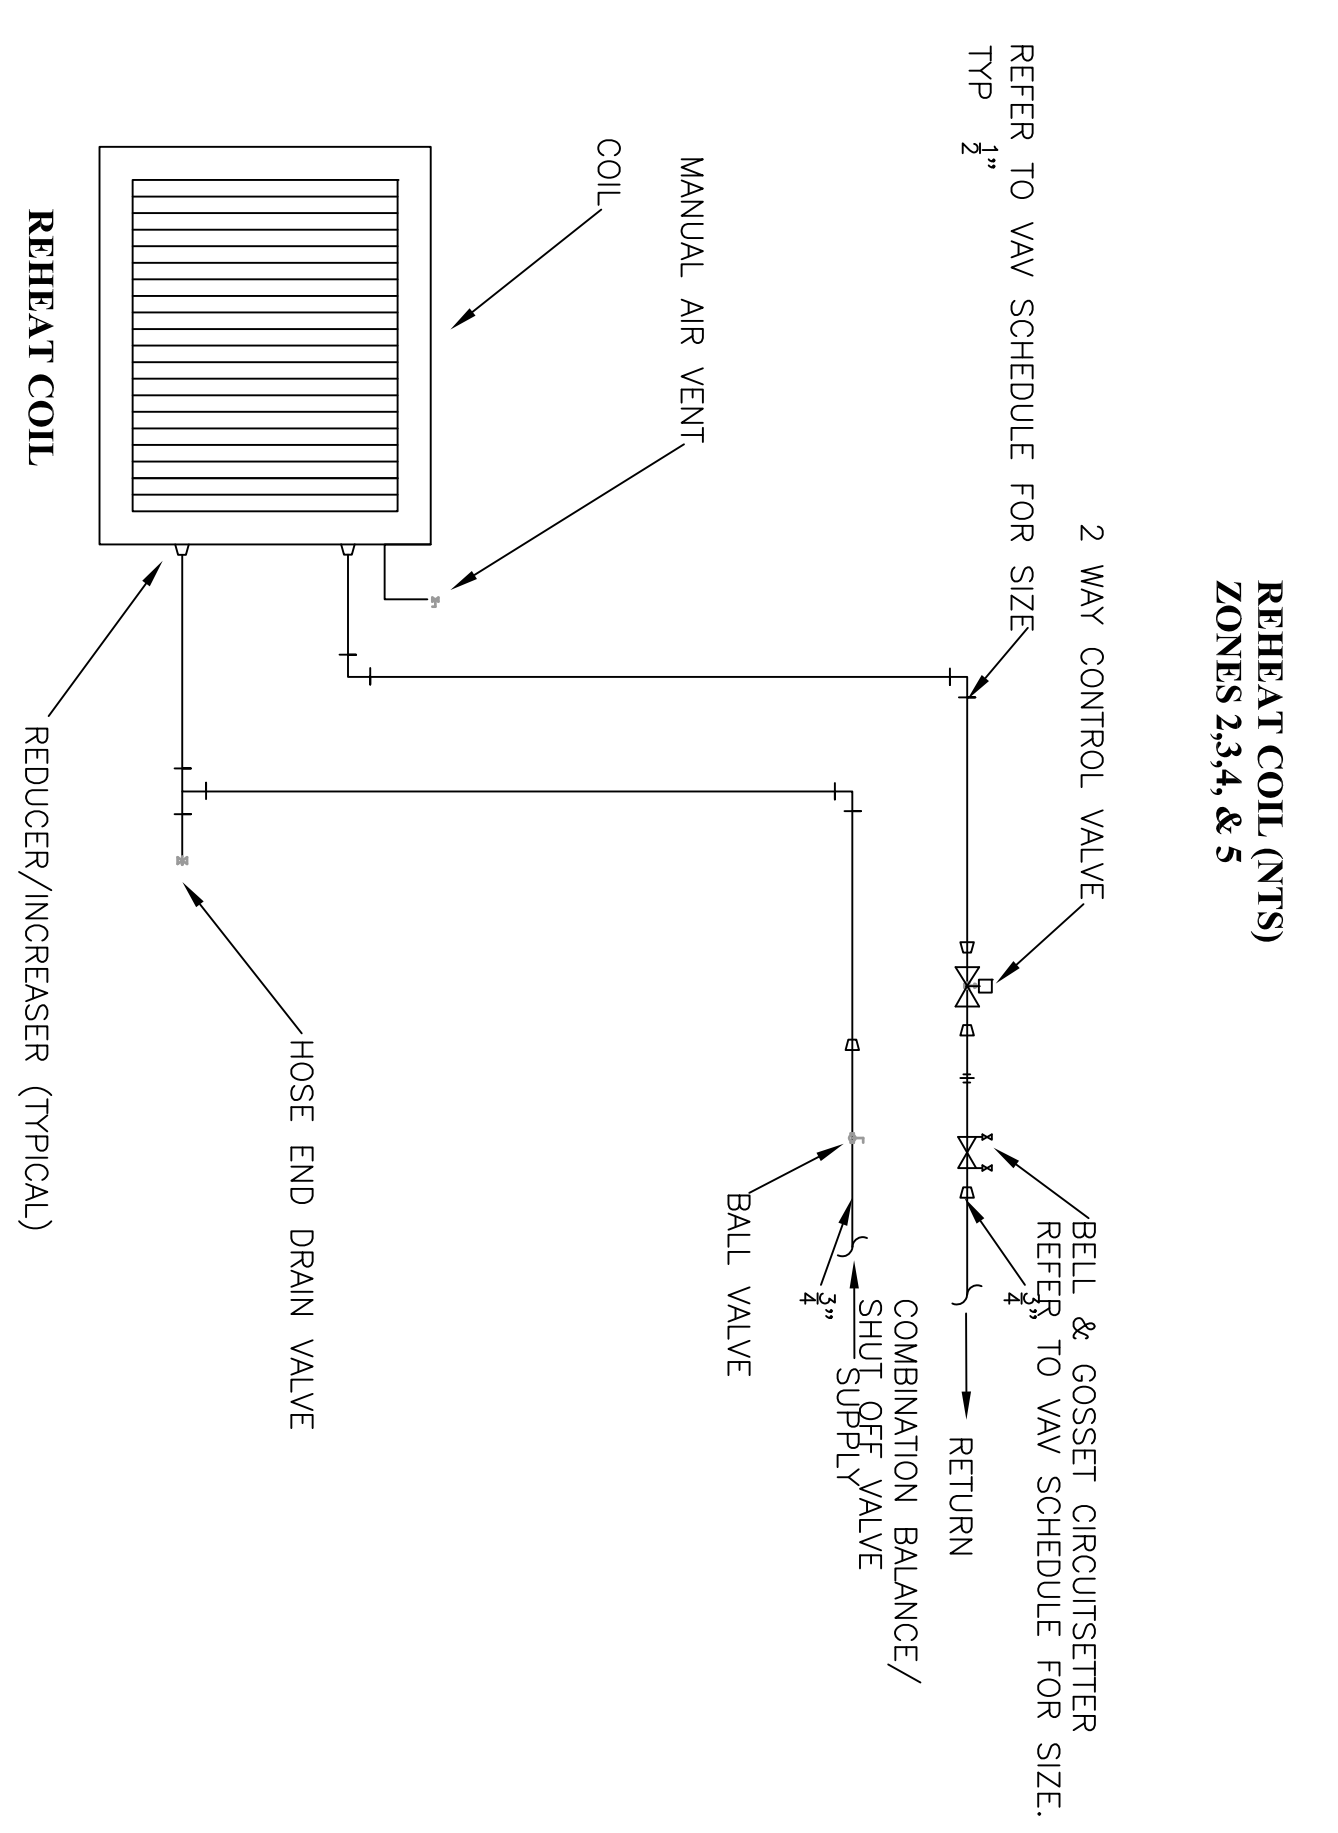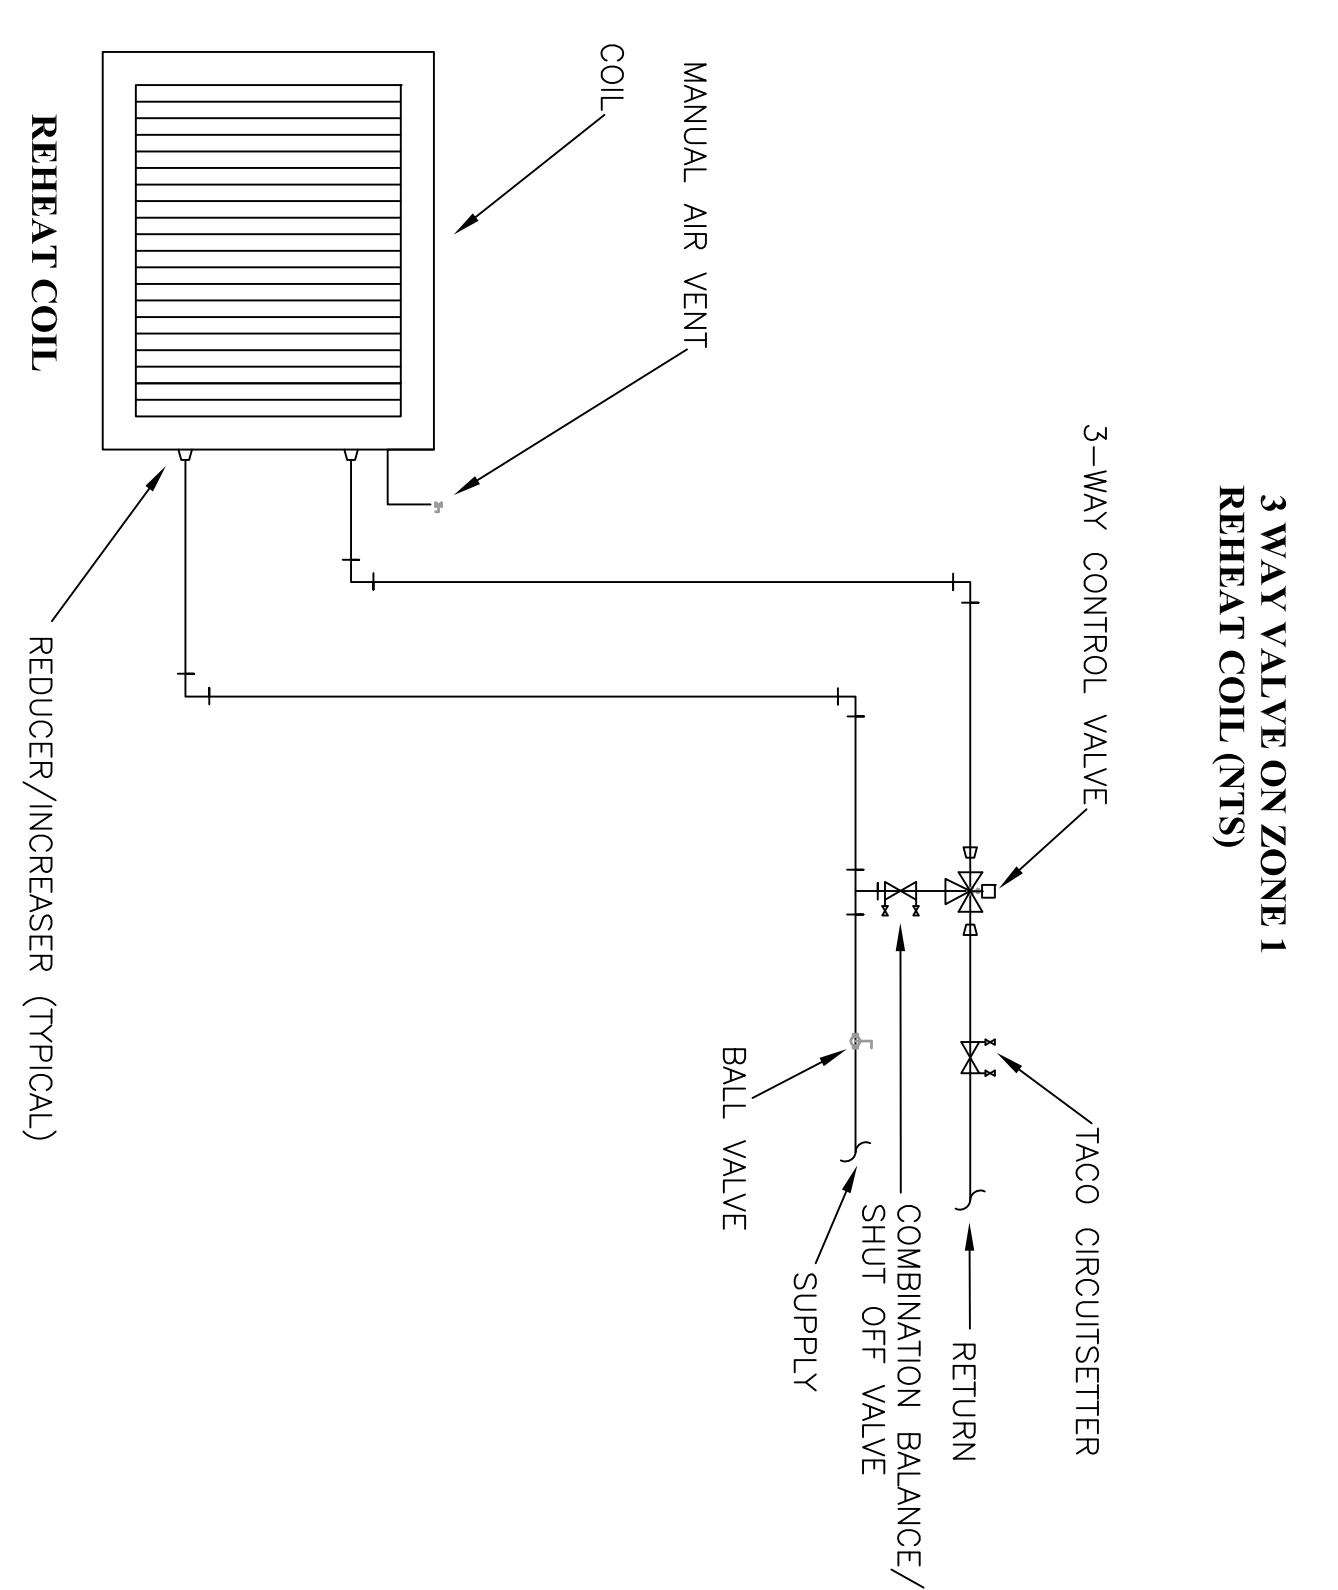

AIRTEMP INC  
20 THOMAS DRIVE  
WESTBROOK ME

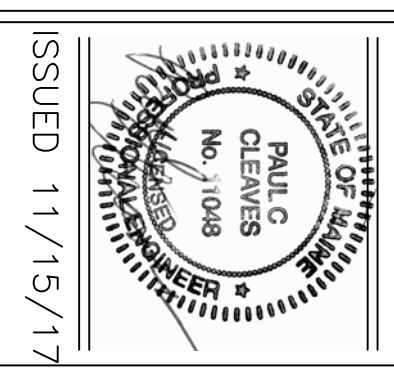

ISSUED 11/15/17



TD BANK  
481 CONGRESS ST  
PORTLAND MAINE

CLIENT	
DATE	
DRAWN BY	FCC
CHECKED BY	PCC
DATE	10/01/17
SHEET TITLE	ZONING PLAN

PREL.	10/10/17
CONST.	11/15/17
DRAWING	
M-3	

SCALE VARIES