CONTRACTOR TO FURNISH AND INSTALL ALL NOTED LABOR AND MATERIALS UNLESS OTHERWISE NOTED.

2: CODE COMPLIANCE:

ALL WORK SHALL CONFORM TO THE LATEST EDITION OF STATE, LOCAL AND OTHER CODES WHICH APPLY TO THIS PROJECT OR

3: COORDINATION:

IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE ALL DISCIPLINES AND TRADES SO THAT ALL BUILDING SYSTEMS AND COMPONENTS CAN BE ASSEMBLED WITHOUT CONFLICTS. IN THE EVENT THAT THE CONSTRUCTION DOCUMENTS DEFINE CONDITIONS WHICH PROHIBIT, OR MAY PROHIBIT, SUCH ASSEMBLY, THE CONTRACTOR SHALL BRING TO THE ARCHITECTS ATTENTION, IN WRITING AND IN A TIMELY FASHION, SUCH CONDITION. THE CONTRACTOR SHALL NOT PROCEED WITH RELATED WORK WITHOUT A WRITTEN RESOLUTION CLARIFICATION FROM THE ARCHITECT

THE CONTRACTOR AND HIS/HER SUBCONTRACTORS SHALL BE RESPONSIBLE FOR PROVIDING MATERIALS AND SYSTEMS SHOWN IN THE CONSTRUCTION DOCUMENTS REGARDLESS OF WHERE THE INFORMATION IS LOCATED. WHERE COMPONENTS OF A SYSTEM ARE INDICATED THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL LABOR AND MATERIALS NECESSARY TO COMPLETE THE SYSTEM.

4: DISCREPANCIES & CLARIFICATIONS:

THIS PROJECT INVOLVES THE FIT-UP OF AN EXISTING BUILDING. EXISTING DIMENSIONS SHOWN ON THE DRAWINGS ARE BELIEVED TO BE ACCURATE, BUT CANNOT BE GUARANTEED, MEASURE AND VERIFY DIMENSIONS IN FIELD PRIOR TO FABRICATION AND CONSTRUCTION. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO BRING TO THE ARCHITECTS ATTENTION, IN WRITING, ANY DISCREPANCIES OR AMBIGUITIES IN THE DRAWINGS AND/OR SPECIFICATIONS. THE CONTRACTOR SHALL NOT PROCEED WITH RELATED WORK WITHOUT A WRITTEN RESOLUTION OR CLARIFICATION FROM THE ARCHITECT.

UNLESS INDICATED OTHERWISE, CENTER WALL FRAMING AND PARTITION FRAMING ON COLUMN LINES. FLOOR PLAN DIMENSIONS ARE TO CENTER OF FRAMING, FACE OF CONCRETE, FACE OF CMU, OR FROM COLUMN CENTERLINES, UNLESS INDICATED OTHERWISE. DOORS AND WINDOWS ARE DIMENSIONED TO CENTERLINES UNLESS INDICATED OTHERWISE.

UNLESS INDICATED OTHERWISE, CENTER BUILDING ELEMENTS WITHIN OR BETWEEN OTHER BUILDING ELEMENTS WHEN CONDITIONS OR THE DRAWINGS INDICATE OR IMPLY THAT SUCH IS THE INTENT, WHETHER OR NOT DIMENSIONS ARE INCLUDED

WHERE CONDITIONS OR THE DRAWINGS INDICATE OR IMPLY THAT SYMMETRY IS INTENDED, INFORMATION PROVIDED AT ONE SIDE APPLIES EQUALLY TO BOTH SIDES, UNLESS CONDITIONS CLEARLY PRECLUDE SUCH APPLICATION.

8: ACCESSIBILITY:

ALL HANDICAPPED ACCESSIBLE BATHROOMS, GRAB BARS, AND DOOR OPENINGS SHALL MEET THE REQUIREMENTS OF TITLE 94-348, CHAPTER 5 OF THE MAINE HUMAN RIGHTS COMMISION TITLE LATEST EDITION & THE DEPARTMENT OF JUSTICE ADA STANDARDS FOR ACCESSIBLE DESIGN.

9: DRAWING SCALES:

WORK FROM THE GIVEN DIMENSIONS ONLY. SCALE IS INDICATED ON THE DRAWINGS FOR CONVENIENCE ONLY. IT IS NOT INTENDED THAT INFORMATION BE DETERMINED BY SCALING THE DRAWINGS SINCE SOME ITEMS MAY NOT BE TO SCALE

10: WATER-RESISTANT GWB:

INSTALL WATER-RESISTANT GYPSUM WALL BOARD IN ALL REST ROOMS & TOILET ROOMS OR AT ANY WALL WITH PLUMBING FIXTURES.

10A: HIGH IMPACT GWB:

INSTALL HIGH IMPACT GYPSUM WALL BOARD IN ALL STAIRWELLS

11: INTERIOR ELEVATIONS: INTERIOR ELEVATIONS MAY BE REVERSED FROM AND/OR SIMILAR

TO ACTUAL CONDITIONS. SEE FLOOR PLANS FOR WINDOW AND DOOR QUANTITIES AND LOCATIONS, FOR CASEWORK LAYOUTS, AND FOR MONITOR LOCATIONS.

12: BUILDING INSULATION: PROVIDE AS INDICATED IN WALL SECTIONS AND IN ACCORDANCE WITH PARTITION TYPES, WHETHER OR NOT SHOWN IN DETAILS

AND OTHER DRAWINGS. FOR CLARITY, INSULATION MAY NOT BE SHOWN IN SOME CASES, EVEN IF IT IS TO BE PROVIDED.

13: BLOCKING: INSTALL BLOCKING BEHIND ALL SURFACE-APPLIED FIXTURES TRIM, CASEWORK, SHELVES, BRACKETS, TOILET ACCESSORIES, CHAIR RAILS, PICTURE RAILS, GRAB BARS, BASE MOLDINGS, AND AS OTHERWISE REQUIRED, WHEN SUCH ITEMS ARE APPLIED ON STUD WALLS.

14: PENETRATIONS AT STRUCTURAL MEMBERS: BEFORE PENETRATING JOISTS, BEAMS OR OTHER STRUCTURAL

MEMBERS, CONSULT WITH THE ARCHITECT. 15: DAMAGED WORK:

BUILDING OR SITE COMPONENTS WHICH ARE AFFECTED BY NEW WORK, DEMOLITION, OR WHICH MAY BE DAMAGED BY THE GENERAL CONTRACTOR OR ANY SUB-CONTRACTOR SHALL BE REPLACED OR RESTORED TO ORIGINAL CONDITION AND COLOR TO MEET THE APPROVAL OF THE ARCHITECT.

16: UTILITIES:

VERIFY THE SIZE AND LOCATION OF ALL UNDERGROUND UTILITIES AND REPORT ANY DISCREPANCIES TO THE ARCHITECT IN WRITING. DO NOT PROCEED WITH WORK UNTIL THE DISCREPANCY HAS BEEN RESOLVED TO THE SATISFACTION OF THE ARCHITECT.

17: RATED CONSTRUCTION:

PROVIDE RATED CONSTRUCTION AS REQUIRED BY CODE, AS SPECIFIED, AND AS INDICATED ON DRAWINGS. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO PROVIDE AND INSTALL ALL COMPONENTS REQUIRED TO CREATE SUCH RATED CONSTRUCTION. REGARDLESS OF WHETHER OR NOT SUCH COMPONENTS ARE INDICATED. PROVIDE CONTINUITY OF SUCH RATED CONSTRUCTION AROUND AND BETWEEN SPACES. INCLUDING AT CHASES AND AT FLOORS, TO MAINTAIN COMPLETE SEPARATIONS, EVEN IF NOT SPECIFICALLY INDICATED.

SUBMIT SHOP DRAWINGS TO THE ARCHITECT FOR REVIEW PRIOR AWS TO FABRICATIONS. SUBMITTALS REQUIRED INCLUDE, BUT ARE NOT LIMITED TO, SHOP DRAWINGS FOR ALL PREFABRICATED CONCRETE, STEEL, MILLWORK & SIGNAGE, SAMPLES OF ALL PROPOSED PAINTS, METALS, WALL COVERINGS, LAMINATES. SOLID SURFACE MATERIALS, CERAMIC TILE, AND HARDWARE. SUBMIT MANUFACTURERS' DATA FOR ALL LIGHTING SYSTEMS, AND HARDWARE.

19: PERMITS:

THE GENERAL CONTRACTOR SHALL OBTAIN AND PAY FOR ANY BUILDING PERMITS REQUIRED AND CARRY ANY INSURANCE COVERAGES REQUIRED.

ALL INTERIOR FINISHES AND FURNISHINGS ARE TO BE CLASS 'A' FIRE-RATED AND ARE TO COMPLY WITH SECTION 920.0 BOCA

21: ELECTRICAL DESIGN:

(INTERIOR FLAME SPREAD).

22: WASTE REMOVAL: THE GENERAL CONTRACTOR SHALL DISPOSE OF ALL WASTE AND DEBRIS OFF THE PREMISES.

23: LANDLORD COORDINATION

THE GENERAL CONTRACTOR MUST COORDINATE WITH THE BUILDING OWNER ALL ACTIVITIES INCLUDING BUT NOT LIMITED TO WORK WHICH WILL GENERATE EXCESSIVE NOISE AND MODIFICATION TO UTILITIES. WORK MUST NOT INTERFERE WITH EXISTING SMOKE DETECTORS, ALARMS OR BUILDING SYSTEM MANAGEMENT.

24: TEMPORARY FACILITIES: PROVIDE ALL TEMPORARY FACILITIES AND SERVICES,

CONSTRUCTION AND SUPPORT FACILITIES, AND SECURITY AND PROTECTION AS NEEDED TO PROTECT NEW AND EXISTING CONSTRUCTION FOR THE DURATION OF A COMPLETE INSTALLATION.

25: FINAL CLEANING:

EMPLOY EXPERIENCED WORKERS FOR FINAL CLEANING. CLEAN EACH SURFACE TO THE CONDITION EXPECTED IN A COMMERCIAL BUILDING CLEANING PROGRAM.

26: MANUFACTURERS INSTRUCTIONS: ALL MATERIALS & EQUIPMENT SHALL BE INSTALLED

ACCORDING TO MANUFACTURER'S SPECIFICATIONS.

27: GUARANTEE GUARANTEE: ALL MATERIALS AND WORKMANSHIP SHALL BE GUARANTEED FOR A PERIOD OF ONE YEAR FROM THE DATE OF FINAL ACCEPTANCE UNLESS OTHERWISE SPECIFIED FOR A

LONGER PERIOD OF TIME ON A CERTAIN ITEM. ALL MATERIAL USED FOR THE CONSTRUCTION OF THIS PROJECT, WHETHER BUILDING MATERIALS OR

APPURTENANCES, SHALL BE NON-ASBESTOS CONTAINING

29: HAZARDOUS FUMES: THE GENERAL CONTRACTOR SHALL CONFIRM THAT ALL MATERIAL AND FINISHES SPECIFIED AND THEIR FABRICATION OR INSTALLATION WILL NOT RELEASE FUMES OR AROMAS DURING CONSTRUCTION WHICH MAY BE A HAZARD OR NUISANCE TO PERSONNEL.

30: PEST CONTROL:

SEAL AND CAULK AROUND ALL PENETRATIONS. CRACKS AND CREVICES AND ANY OPENINGS CAPABLE OF HARBORING INSECTS/RODENTS.

31. EXPOSED UTILITIES:

ALL EXPOSED UTILITY WIRES AND PIPES (ELECTRICAL PLUMBING, ETC.) SHALL BE INSTALLED IN A WAY THAT DOES NOT OBSTRUCT OR PREVENT THE CLEANING OF FLOORS, WALLS, AND CEILING AREAS. THEY SHALL BE INSTALLED A MINIMUM OF 6" OFF FLOORS AND 1" OFF WALLS, CEILINGS AND ADJACENT PIPES.

32. OWNER SUPPLIED EQUIPMENT: EQUIPMENT SUPPLIED BY THE OWNER AND INSTALLED BY THE GENERAL CONTRACTOR:I **EQUIPMENT INFORMATION AND SPECIFICATIONS ARE TO BE** THE MOST CURRENT AVAILABLE AT THE TIME OF DOCUMENTATION PREPARATION THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING WITH THE OWNER THE EXACT DIMENSIONS AND FQUIPMENT CONNECTION REQUIREMENTS (INCLUDING ELECTRICAL CIRCUIT REQUIREMENTS) OF EQUIPMENT TO BE SUPPLIED. THE GENERAL CONTRACTOR SHALL MAKE ALL FINAL CONNECTIONS AS NOTED ON THE DRAWINGS, INSTALL THE SET UP IN WORKING ORDER, CHECK WARRANTIES, TEST AND NOT VOID WARRANTIES. THE GENERAL CONTRACTOR SHALL COORDINATE WITH THE OWNER DELIVERY, STORAGE AND INSTALLATION OF ALL OWNER SUPPLIED EQUIPMENT. THE GENERAL CONTRACTOR SHALL STORE EQUIPMENT IF REQUESTED BY THE OWNER UNTIL INSTALLATION. SEE DRAWINGS FOR OTHER OWNER SUPPLIED/GENERAL

33: FIRE PROTECTION NOTE:

CONTRACTOR INSTALLED ITEMS.

EXISTING SPRINKLERHEADS, ALARM SYSTEM AND DETECTORS ARE TO BE MODIFIED TO CONFORM. WITH THE PROPOSED PLAN. COORDINATE WITH THE ARCHITECT, ANY MODIFICATION OR LOCATIONS WHERE EXISTING SYSTEMS ARE AFFECTED BY

34: SOILS AT FOOTINGS:

REPORT THE LOCATION OF ALL UNSUITABLE SOILS AND MATERIALS BELOW ANTICIPATED LEVEL OF FOOTING TO THE ARCHITECT PRIOR TO THE SETTING OF FORMS.

35: ACCESS PANELS:

CONTRACTOR IS RESPONSIBLE FOR COORDINATING QUANTITY AND LOCATION OF ALL REQUIRED ACCESS PANELS FOR ALL MEP CONTROLS, CLEANOUTS, DAMPERS, PULL BOXES, ETC.

36: EXISTING HAZARDOUS MATERIALS


ALL HAZARDOUS MATERIALS INCLUDING BUT NOT LIMITED TO ASBESTOS AND LEAD PAINT ARE TO BE HANDLED, ENCAPSULATED, ABATED AND DISPOSED OF IN ACCORDANCE WITH ANY AND ALL FEDERAL, STATE AND LOCAL REQUIREMENTS AND REGULATIONS.

37: INDUSTRY STANDARDS:

ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH INDUSTRY STANDARDS. STANDARDS INCLUDE BUT ARE NOT LIMITED TO THE FOLLOWING:

AAMA AMERICAN ARCHITECTURAL MANUFACTURERS

- ASSOCATION AMERICAN CONCRETE INSTITUTE AMERICAN NATIONAL STANDARDS INSTITUTE AMERICAN SOCIETY FOR TESTS AND MATERIALS ASTM ARCHITECTURAL WOODWORK INSTITUTE "CUSTOM GRADE"
- AMERICAN WELDING SOCIETY INSULATING GLASS MANUFACTURERS ALLIANCE IGMA NAAMM NATIONAL ASSOCIATION OF ARCHITECTURAL METAL
- MANUFACTURERS NATIONAL ROOFING CONTRACTORS ASSOCIATION NATIONAL TILE CONTRACTORS ASSOCIATION SMACNA SHEET METAL AND AIR CONDITIONING NATIONAL
- ASSOCIATION WDMA WINDOW AND DOOR MANUFACTURERS ASSOCIATION

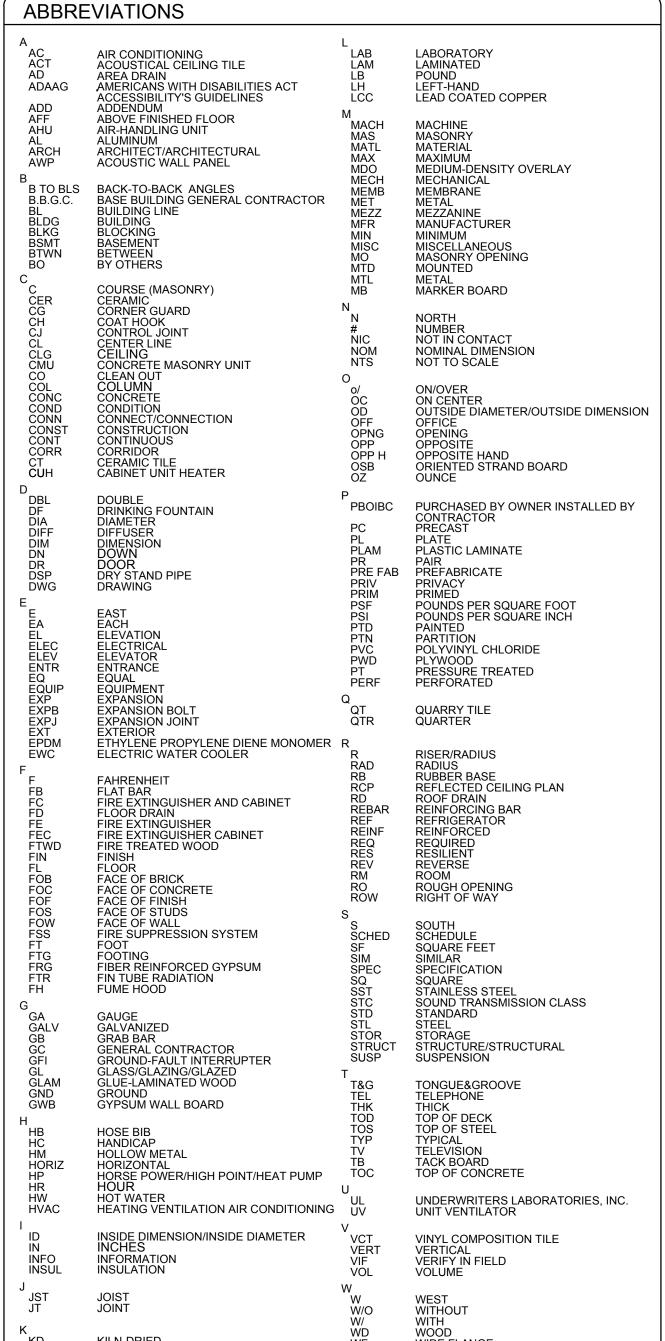

WORK POINT

1000 POUNDS

POROUS FILL

CONCRETE

CONCRETE

MASONRY UNIT

SYPSUM BOARD

RIGID INSULATION

BATT INSULATION

CELLULOSE INSULATION

BEDROOM

ROOM NAME

AND NUMBER

DOOR NUMBER

WINDOW NUMBER

FLOOR-CEILING TYPE

ROOF SYSTEM TYPE


FIRE EXTINGUISHER

SLAB TYPE

DRAWING LEGEND

4 4 4

FIRESTOPPING DETAILS

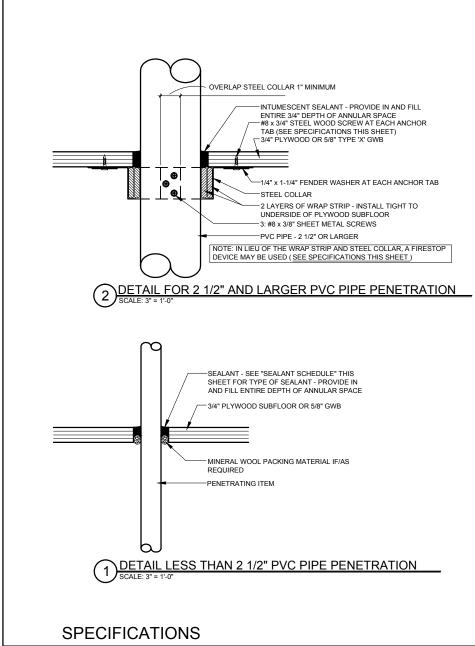

WRAP STRIP: 1/4" THICK x 1 1/2" MINIMUM WIDTH INTUMESCENT MATERIAL WITH PLASTIC FILM FACING BOTH SIDES. TEMPORARILY SECURE WITH MAKSING TAPE. SPECIFIED TECHNOLOGIES INC. (STI) "SpecSeal RED Wrap Strip" OR "SpecSeal BLU Wrap Strip" OR EQUAL.

STEEL COLLAR: WRAP STRIP MANUFACTURER'S STEEL COLLAR, FABRICATED FROM .016 INCH THICK GALVANIZED SHEET STEEL, WIDTH TO MATCH WRAP STRIP (1 1/2" MINIMUM), WITH 1 INCH x 2 INCH ANCHOR TABS AND RETAINER TABS. ANCHOR TABS TO BE SYMMETRICALLY OPPOSED AROUND COLLAR; PROVIDE 3 TABS FOR 2 1/2" AND 3" PIPE; PROVIDE 4 TABS FOR 4" PIPE.

INTUMESCENT SEALANT: ONE-PART, INTUMESCENT, LATEX ELASTOMER TESTED TO ASTM E 814. MINIMUM EXPANSION OF 3x AT 1000°F. 3M "FIRE BARRIER SEALANT CP 25WB+" OR EQUAL.

FIRESTOP SEALANT: SINGLE COMPONENT NONCOMBUSTIBLE FIRE RATED SEALANT TESTED TO ASTM E 814. TESTED TO 3000°F. "BOSS 136 FIRESTOP/DRAFT SEALANT" MANUFACTURED BY ACCUMETRIC, LLC., OR EQUAL.

SEALANT SCHEDULE:

INTUMESCENT SEALANT: PROVIDE AT ALL PENETRATIONS THROUGH RATED CONSTRUCTION FOR PENETRATING ITEMS INCLUDING BUT NOT LIMITED TO: PVC PIPE: ROOF LEADER PIPES: GAS PIPES & LINES: SPRINKLER PIPES: ELECTRICAL & COMMUNICATIONS CABLES & WIRES AND ALARM SYSTEM WIRES. DO NOT USE INTUMESCENT SEALANT AT DOMESTIC HOT WATER OR HYDRONIC HEATING SYSTEM PIPES.

FIRESTOP SEALANT: PROVIDE AT ALL PENETRATIONS THROUGH RATED CONSTRUCTION FOR PENETRATING ITEMS INCLUDING DOMESTIC HOT AND COLD WATER PIPES AND HYDRONIC HEATING SYSTEM PIPES.

- ELEVATION COMPASS NUMBER

INTERIOR ELEVATION SYMBOL

FLOORING TYPE TRANSITION

SHEET WHERE ELEVATION LOCATED

ELEVATION NUMBER

SECTION NUMBER

SECTION MARK

SHT WHERE SECTION LOCATED

1HR FIRE RATED WALL

2HR FIRE RATED WALL

FOR LOCATIONS OF RATED CONSTRUCTION, SEE ARCHITECTURAL FLOOR PLANS AND SECTIONS

WALL TYPES

GENERAL PARTITION NOTES:

WITH PLUMBING FIXTURES.

1.) AT ALL FIRE WALLS, GENERAL CONTRACTOR TO CONFIRM THAT ALL WALLS ARE TIGHT TO ROOF AND OR FLOOR DECK ABOVE, PROVIDE HEAD DEFLECTION SLIP TRACKS AT NON BEARING METAL STUD FRAMED WALLS. G.C. TO EXTEND EXISTING WALLS CONVERTED TO FIRE WALLS UP TIGHT TO DECK ABOVE SHOULD THE EXISTING CONDITION REQUIRE.

2.) G.C. TO PROVIDE FIRE CAULKING, FIRE STOPPING, AND BLOCKING AS REQUIRED AT ALL TOP OF WALLS AT CORRUGATED DECK FLUTES,

TRUSS VOIDS, AND ALL GENERAL VOIDS.

4.) INSTALL WATER-RESISTANT GYPSUM WALL BOARD IN ALL RESTROOMS AND TOILET ROOMS WALLS AND CEILINGS, AND AT ANY WALL

5.) ALL PARTITION TYPES WITH AN INSULATION COMPONENT TO BE ACOUSTICALLY SEALED.

6.) COORDINATE FINISHES WITH ROOM FINISH SCHEDULE.

7.) PENETRATIONS THROUGH RATED WALLS AND CEILING ASSEMBLIES SHALL HAVE SEALANTS CONFORMING TO RATING REQUIREMENTS

8.) CONTRACTOR TO VERIFY WALL LOCATIONS IN FIELD AND COORDINATE WITH EXISTING PIPE LOCATIONS, NOTIFY ARCHITECT OF ANY

10.) HOLD BOTTOM EDGE OF GWB UP FROM CONCRETE TYPICAL

11.) PROVIDE MID SPAN METAL BLOCKING AT ALL WALLS OVER 9' TALL

12.) PROVIDE SOLID BLOCKING IN WALLS AND PARTITIONS FOR ALL WALL MOUNTED ITEMS (GRAB BARS, CABINETS, COUNTERS, SHELVES,

	TYPE	STC RATING	UL / GA RATING	DESCRIPTION	NOTES
	1	N/A	N/A	- 5/8" GWB - 3 5/8" MTL STUDS @ 16" O.C. - 3 1/2" BATT INSULATION - 5/8" GWB	-WALL TO EXTEND TO 6" ABOVE FINISHED CEILING HEIGHT BRACE WALL WITH DIAGONAL BRACES TO STRUCTURE ABOVE -MATCH ADJACENT WALL THICKNESS AT INFILL WALLS
	2	N/A	N/A	- 5/8" GWB - 3 5/8" MTL STUDS @ 16" O.C. - 3 1/2" BATT INSULATION - 5/8" GWB	WALL TO EXTEND TO ROOF OR FLOOR DECK ABOVE WITH DEFELCTION HEAD TRACK, PROVIDE ACOUSTICAL SEALANT AT ALL INTERSECTIONS -MATCH ADJACENT WALL THICKNESS AT INFILL WALLS
	3	50	N/A	- (2) LAYERS OF 5/8" GWB - 3 5/8" MTL STUDS @ 16" O.C. - 3 1/2" BATT INSULATION - (2) LAYERS OF 5/8" GWB	WALL TO EXTEND TO ROOF OR FLOOR DECK ABOVE WITH DEFELCTION HEAD TRACK, PROVIDE ACOUSTICAL SEALANT AT ALL INTERSECTIONS -MATCH ADJACENT WALL THICKNESS AT INFILL WALLS
			_		

CEILING TYPES

TYPE		UL / GA RATING		DESCRIPTION		
1				- EXISTING ROOF / FLOOR FRAMING - IF BATT INSULATION IS FOUND ABOVE EXISTING CEILING REINSTALL ON TOP OF NEW CEILING - ACOUSTICAL CEILING HANGER SYSTEM AND TRACKS, HUNG FROM JOISTS ABOVE - ACOUSTICAL CEILING TILE		
2				- EXISTING ROOF / FLOOR FRAMING - IF BATT INSULATION IS FOUND ABOVE EXISTING CEILING REINSTALL ON TOP OF NEW CEILING - EXISTING CEILING HANGER SYSTEM AND TRACKS, HUNG FROM JOISTS ABOVE (REPLACE GIRD AS REQUIRED) - 5/8" MOISTURE RESISTANT GYPSUM WALLBOARD WITH PLASTER TOPCOAT AND LATEX ENAMEL PAINT		

TR

© 2014 RYAN SENATOF

ARCHITECTURE

0

ARCHITECTURE

565 CONGRESS STREET

SUITE 304

PORTLAND, MAINE 04101 207-650-6414 senatorearchitecture.com CONSULTANTS:

REVISIONS:

AUGUST 29, 201 PROJECT No.

DRAWN BY: RRT / RJS CHECKED BY: AS NOTE SCALE:

SHEET TITLE: **GENERAL NOTES ABBREVIATIONS** LEGEND WALL TYPES CEILING TYPES