

CITY OF PORTLAND

BUILDING INSPECTION

PERMIT

Please Read Application And Notes, If Any, Attached

Permit Number 060286

PERMIT ISSUED

MAR - 9 2006

CITY OF PORTLAND

This is to certify that KAPLAN 504 LLC / Simple Grinnell
 has permission to Replace existing Kitchen Hood fire suppression system to include new larger cylinder
 AT 504 CONGRESS ST 037 H013001
 provided that the person or persons performing or accepting this permit shall comply with all of the provisions of the Statutes of Maine and of the Ordinances of the City of Portland regulating the construction, maintenance and use of buildings and structures, and of the application on file in this department.

Apply to Public Works for street line and grade if nature of work requires such information.

Classification of inspection must be given and when permission procedure before this building or part thereof is closed or service closed-in. **YOUR NOTICE REQUIRED.**

A certificate of occupancy must be procured by owner before this building or part thereof is occupied.

OTHER REQUIRED APPROVALS

Fire Dept. Greg Cass 3-6-06
 Health Dept. _____
 Appeal Board _____
 Other _____
 Department Name

[Signature] 3/8/06
 Director - Building & Inspection Services

PENALTY FOR REMOVING THIS CARD

City of Portland, Maine - Building or Use Permit

389 Congress Street, 04101 Tel: (207) 874-8703, Fax: (207) 874-8716

| | | |
|------------------------------|--|----------------------------|
| Permit No: 06-0291 | Date Applied For: 03/02/2006 | CBL: 037 H013001 |
|------------------------------|--|----------------------------|


| | | | |
|---|---|---|--------------------------------|
| Location of Construction: 504 CONGRESS ST | Owner Name: KAPLAN 504 LLC | Owner Address: 49 OCEAN AVE | Phone: |
| Business Name: | Contractor Name: Simplex / Grinnell | Contractor Address: 20 Thomas Drive Westbrook | Phone (207) 842-6440 |
| Lessee/Buyer's Name | Phone: | Permit Type: Hood Systems, Commerical | |

Proposed Use:
Commercial/The Stadium/ Replace existing Kitchen Hood fire suppression system to include new larger cylinder

Proposed Project Description:
Replace existing Kitchen Hood fire suppression system to include new larger cylinder

Dept: Fire **Status:** Approved with Conditions **Reviewer:** Cptn Greg Cass **Approval Date:** 03/06/2006

I) Install shall comply with NFPA 96

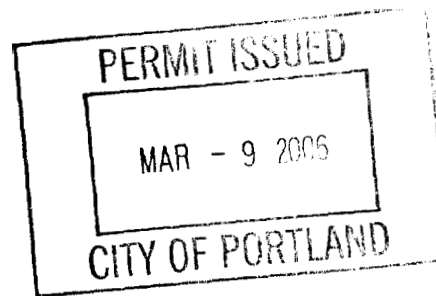

SimplexGrinnell
20 Thomas Dr.
Westbrook, ME 04092
Tel: 207-842-6440

CERTIFICATE OF INSTALLATION

| | |
|---------------------|--|
| Customer Address | The Stadium 504 Congress St. Portland, ME 04101 |
| Property inspected | (same) |
| Hazard location | 18' long kitchen hood (2 sections, 9' each) |
| System location | Cylinder and controls mounted on top of the right side of the hood above the ceiling. |
| System Type | Pyro-Chem model PCL600, UL300 wet chemical per NFPA 17A & 96 |
| System size | 6-gallon (1 cylinder) |
| Remarks | A. System includes: (1) 6-gallon cylinder, (14) discharge nozzles, (5) fusible link detectors, (1) pull station and (1) electrical gas shutoff valve with a manual reset relay (in the basement). B. System nozzles include: (2) 1H nozzles; 1 for each plenum, (2) 2D nozzles; 1 for each for duct, (3) 2H nozzles; 1 for each fryer, (2) 1H nozzles for the char-broiler and (5) 1L nozzles for the 10-burner range. C. A single micro-switch is connected to the solenoid gas valve and a 2 nd micro-switch would need to be installed to facilitate an alarm system connection. |
| Installation date | March, 2006 |
| Next inspection due | Semi-annual: Sept. 2006, March. 2007 etc. |
| Installed by | Installation/inspection by Bryan Ross |