



SCOPE OF WORK:
 FURNISH & INSTALL A 6 GALLON
 PYRO-CHEM WET CHEMICAL KITCHEN HOOD
 FIRE SUPPRESSION SYSTEM PER NFPA 17A,
 NFPA 96 AND UL 300 TO PROTECT: (2)
 9'-0" HOODS, (2) EXHAUST DUCTS, (1)
 SALAMANDER BROILER, (1) 10 BURNER
 RANGE, (1) CHARBROILER AND (3) FRYERS
 AT THE STADIUM IN PORTLAND, ME.

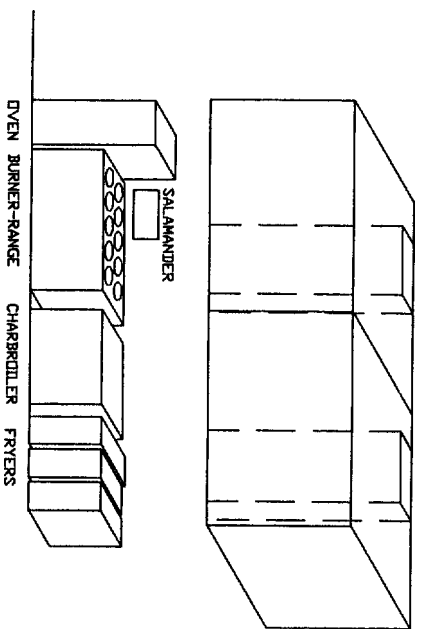


ISOMETRIC VIEW
 SCALE: 1/8"=1'-0"

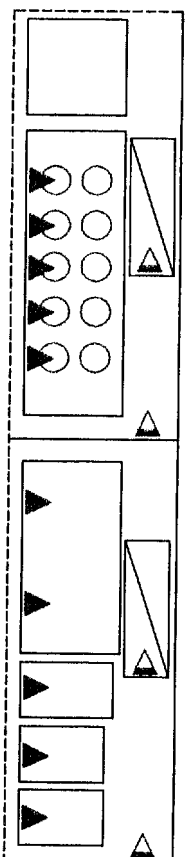

PIPING / NOZZLE DETAIL
 SCALE: NTS

- NOZZLE COVERAGES:**
- 2- 1H NOZZLES, 1 FOR EACH 9' PLENUM
 - 2- 2D NOZZLES, 1 FOR EACH EXHAUST DUCT
 - 3- 2H NOZZLES, 1 FOR EACH FRYER
 - 2- 1H NOZZLES AT CHARBROILER
 - 5- 1L NOZZLES AT RANGE
 - SALAMANDER NOT FUNCTIONAL AND NOT PROTECTED

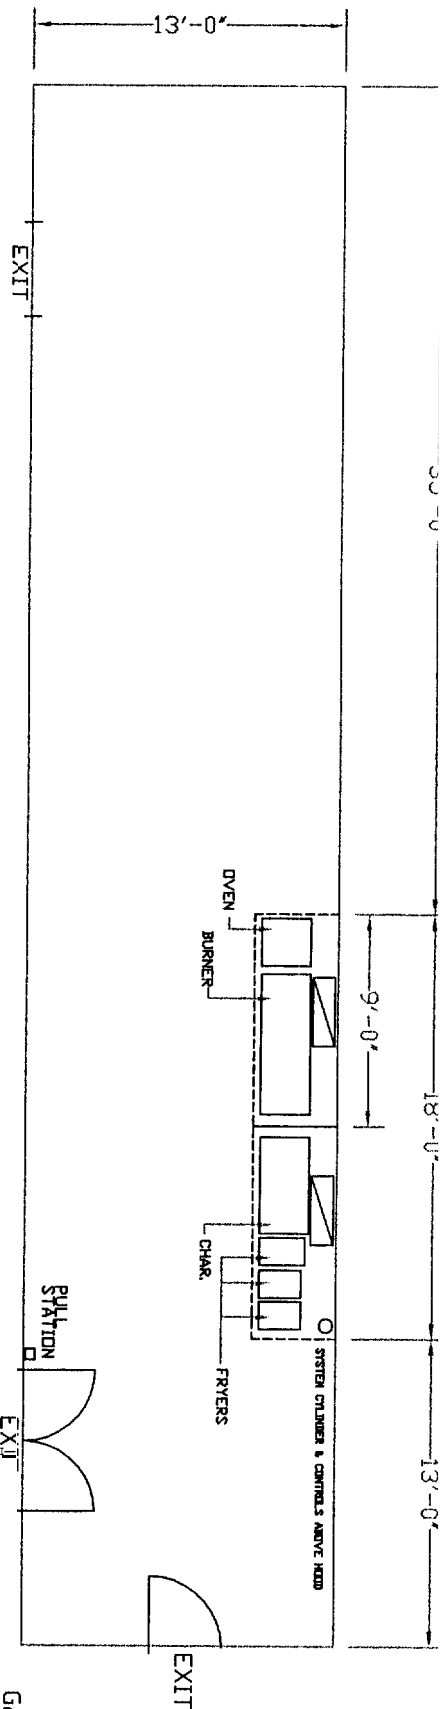

PLAN VIEW
 SCALE: 1/8"=1'-0"

GAS V.A.
 SOLENOID GAS SHUTOFF
 VALVE AND RESET
 RELAY IN BASEMENT ON
 FREE STREET SIDE OF
 BLDG.

tyco
Fire & Security
 Sales Office - Westbrook, ME, USA
 LOCAL OFFICE: WESTBROOK, ME.


APPROVALS

<input type="checkbox"/>	OUT	<input type="checkbox"/>	IN	<input type="checkbox"/>	OUT	<input type="checkbox"/>	IN
REVISIONS							
NO.	DATE	BY	REVISION DESCRIPTION	NO.	DATE	BY	REVISION DESCRIPTION


SYSTEM INFO		CONTRACT NAME	
SYSTEM NAME/NO.	VALUE/STREET AREA	THE STADIUM CONGRESS ST. PORTLAND, ME.	
SYSTEM TYPE	HAZARD CLASSIFICATION	CONTRACT WITH THE STADIUM	
		PYRO-CHEM	
HYDRAULIC DESIGN DATA		TEST LOCATION	
DESIGN PRESSURE	TEST DATE		
DESIGN FLOW	TEST DATE		
DESIGN TEMPERATURE	TEST DATE		
DESIGN WIND SPEED	TEST DATE		

SCALE: 1/8"=1'-0"
 DRAWN BY: B.H.
 CHECKED BY:
 THESE PLANS PREPARED AT: WESTBROOK, ME. ENGINEERING DEPARTMENT
 CONTRACT NO:
 DATE: MARCH 2006
 DRAWING NO. 1 OF 1

SCOPE OF WORK:
 FURNISH & INSTALL A 6 GALLON PYRO-CHEM WET CHEMICAL KITCHEN HOOD FIRE SUPPRESSION SYSTEM PER NFPA 17A, NFPA 96 AND UL 300 TO PROTECT: (2) 9'-0" HOODS, (2) EXHAUST DUCTS, (1) SALAMANDER BROILER, (1) 10 BURNER RANGE, (1) CHARBROILER AND (3) FRYERS AT THE STADIUM IN PORTLAND, ME.

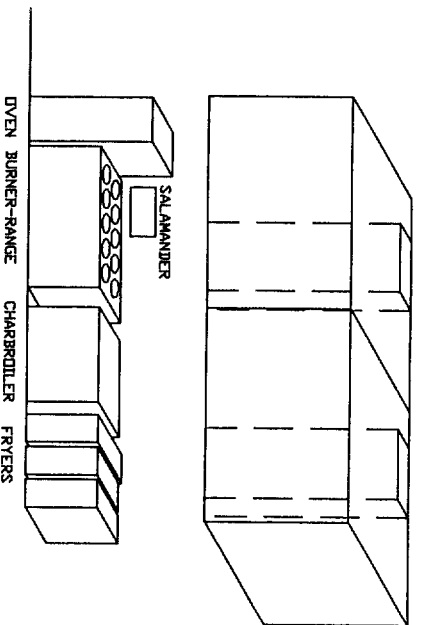


ISOMETRIC VIEW
 SCALE: 1/8"=1'-0"

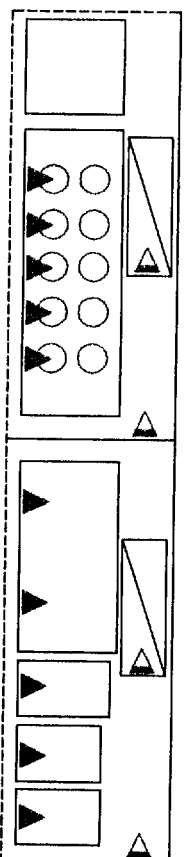

PIPING / NOZZLE DETAIL
 SCALE: NTS

- NOZZLE COVERAGES:**
- 2- 1H NOZZLES, 1 FOR EACH 9' PLENUM
 - 2- 2D NOZZLES, 1 FOR EACH EXHAUST DUCT
 - 3- 2H NOZZLES, 1 FOR EACH FRYER
 - 2- 1H NOZZLES AT CHARBROILER
 - 5- 1L NOZZLES AT RANGE
 - SALAMANDER NOT FUNCTIONAL AND NOT PROTECTED

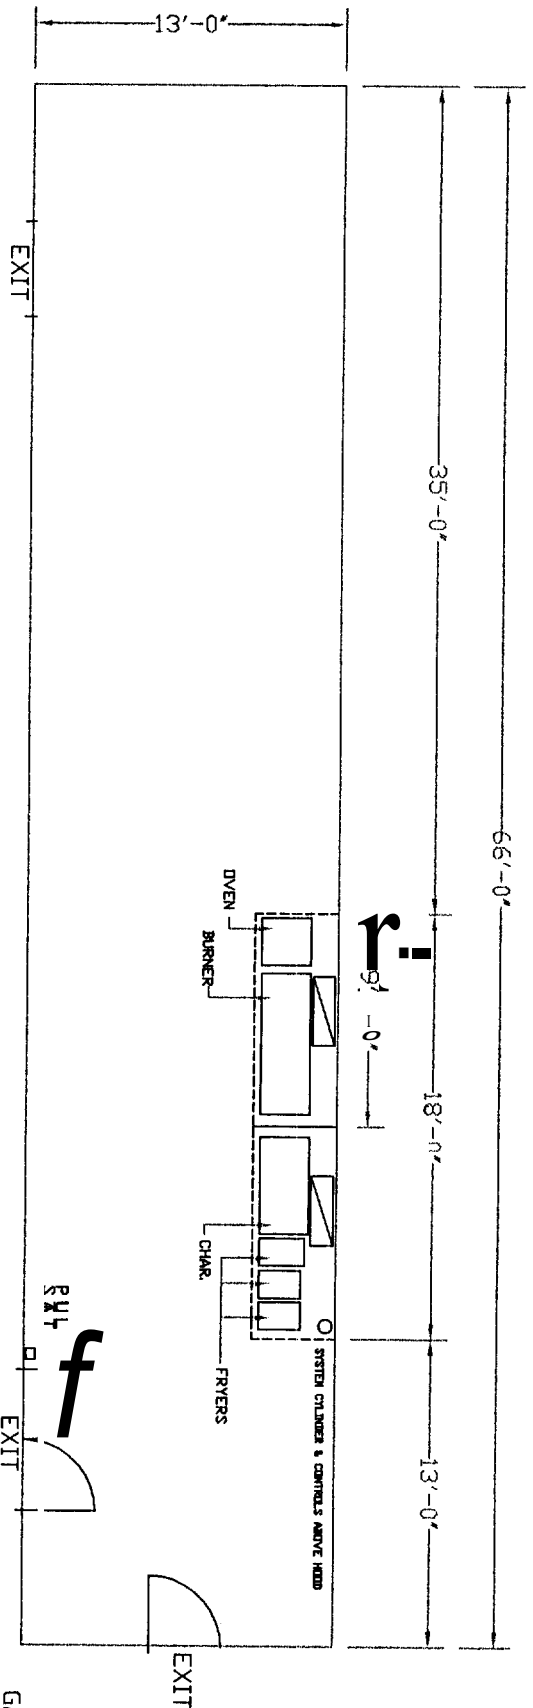

PLAN VIEW
 SCALE: 1/8"=1'-0"

GAS V.A.
 SOLENOID GAS SHUTOFF VALVE AND RESET RELAY IN BASEMENT ON FREE STREET SIDE OF BLDG.

		Safety Division DISTRICT OFFICE - ROSELTON, TEXAS, 9514 LOCAL OFFICE: WESTBROOK, ME.	
APPROVALS			
REVISIONS			
		CONTRACT TITLE: THE STADIUM CONGRESS ST. PORTLAND, ME. PROJECT: PYRO-CHEM	
SYSTEM INFO SERIAL: / NO. / SYSTEM TYPE / VALVE SIZE / SYSTEM AREA		CONTRACT DATA CONTRACT NO. / DATE / AREA OF HOOD / SQ. FT. / TOTAL SYSTEM BEHINDERS AT	
HYDRAULIC DESIGN DATA IDENTIFY: / AREA OF HOOD / ALONG / SQ. FT. / TOTAL SYSTEM BEHINDERS AT		THESE PLANS PREPARED AT: WESTBROOK, ME. ENGINEERING DEPARTMENT	
TEST LOCATION:		DATE: MARCH 2006	
TEST DATE:		DRAWING NO. 1 OF 1	