


3 SLAB DETAIL
 Scale: 3/4" = 1'-0"

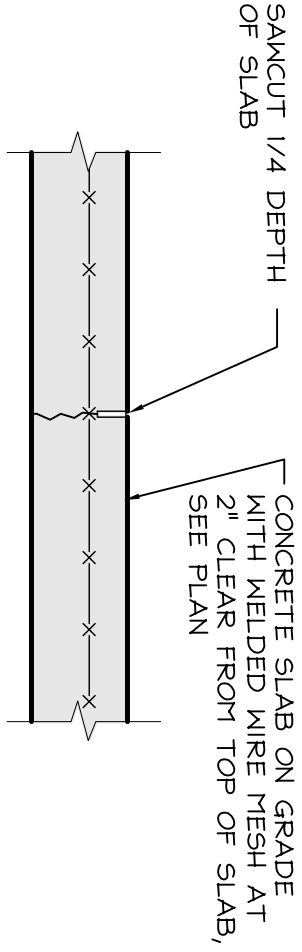

4 SLAB CONTROL JOINT
 Scale: NOT TO SCALE

NOTES:

1. GENERAL CONTRACTOR SHALL COORDINATE UNDERSLAB UTILITIES AND FLOOR DRAIN LOCATIONS.
2. FOUNDATION CONTRACTOR SHALL FINISH TOP OF SLAB SMOOTH AND SLOPED TO DRAINS AS REQUIRED.
3. REMOVE EXISTING CONCRETE SLAB AND ALL ORGANIC MATERIAL OR SOIL UNDER SLAB THAT APPEARS TO BE UNSUITABLE PRIOR TO PREPARING THE NEW SLAB SUBGRADE.
4. WELDED WIRE FABRIC REINFORCEMENT SHALL CONFORM TO THE REQUIREMENTS OF ASTM A185. USE FLAT SHEETS ONLY.
5. SLAB CONTROL JOINTS SHALL BE SAW CUT IMMEDIATELY AFTER FINISHING. JOINTS SHALL BE AT MINIMUM 1/4 OF THE THICKNESS OF THE SLAB.
6. MAXIMUM WATER TO CEMENT RATIO SHALL BE 0.5 FOR 3000 PSI CONCRETE MIX WITH MID-RANGE WATER REDUCERS (MRWR). MINIMUM CEMENT QUANTITIES SHALL BE 517 LB./YD FOR 3000 PSI CONCRETE. MAXIMUM SLUMP SHALL BE 6" WITH MRWR. MRWR MUST BE USED IN CONCRETE MIX. DO NOT USE AIR-ENTRAINING ADMIXTURES IN CONCRETE FOR USE IN INTERIOR SLABS ON GRADE. AIR CONTENT OF TROWELED FINISH FLOORS NOT TO EXCEED 3 PERCENT.

Project No.: 080613

JSN
 Associates, Inc.
 Consulting Structural Engineers

One Autumn Street
 Portsmouth, NH 03801
 (603) 433-8639
 Fax: (603) 431-2811
 www.jsneng.com

Tio Juan's
Margaritas
 11 Brown Street
 Portland, ME

Drawn By:	SED
Date:	7/15/08
Scale:	As Noted
SK-02	