

PROJECT DIRECTORY

OWNER RREEF AMERICA REIT III-Z4 LLC
4 TECHNOLOGY DRIVE
WESTBORO, MA 01581
P: 508.366.1904
F: 508.366.1906
Email: dave.crane@rreef.com

BUILDING MANAGER Michael McDonald - Senior Real Estate Manager
CBRE - Boulos Asset Management
One Portland Square, Portland, Maine 04101
P: 207.874.6000
F: 207.871.7010
Email: mmcDonald@boulos.com
www.boulos.com

ARCHITECT MARK MUELLER ARCHITECTS
100 COMMERCIAL STREET
SUITE #207
PORTLAND, MAINE 04101
P: 207.774.9057
F: 207.773.3851
Email: rf@muellerarchitects.com

TENANT LIH Corp.
217 Commercial St., Suite 300
Portland, Maine 04101
P: 207.772.8800 x 5
F: 772.8802
Email: lhchampagne@lihmaine.com
www.lihmaine.com

GENERAL NOTES

- THE BUILDING SHALL BE CONSTRUCTED TO CONFORM WITH ALL CURRENT APPLICABLE CODES INCLUDING, BUT NOT LIMITED TO, THE LATEST EDITIONS OF IBC, IECC, NFPA 101, ANSI, UFAS, HUD/AG, ADA/AG, MPS.
- ALL WOOD IN CONTACT WITH CONCRETE SHALL BE TREATED WITH PRESSURE PRESERVATIVE.
- CONTRACTOR SHALL WORK FROM GIVEN DIMENSIONS AND LARGE SCALE DETAILS ONLY. DO NOT SCALE THE DRAWINGS.
- INSTALL BLOCKING FOR SURFACE APPLIED FIXTURES, TRIM, CABINETS, COUNTER TOPS, AND GRAB BARS WHEN MOUNTED ON STUD WALLS, INCLUDING ALL FUTURE INSTALLATIONS.
- ALL GRAB BARS SHALL BE ABLE TO SUPPORT A DEAD WEIGHT OF 250 LBS AT ANY POINT.
- INSTALL MOISTURE RESISTANT GYPSUM BOARD IN HOUSEKEEPING, UTILITY, STORAGE, SPRINKLER AND ALL OTHER HIGH HUMIDITY AREAS, INCLUDING UNIT BATHROOMS. MOISTURE RESISTANT FIRE CODE G.W.B. @ ALL FIRE RATED WALLS COMMON WITH HOUSE UTILITY AND UNIT BATH ROOMS. IF APPLICABLE TO THIS PROJECT, SHOWERS TO HAVE DURAROCK BACKING ALL SIDES. ALL CAULKING AROUND WINDOWS SHALL BE NON-HARDENING TYPE SEALANT.
- INSTALL U.L. SLEEVE FIRE-STOPPING SYSTEM & FIRE RATED SEALANTS EQUAL TO THE FIRE RATED FLOOR, CEILING AND WALL ASSEMBLY.
- FIRESTOP VERTICAL MECHANICAL CHASES @ FLOOR & CEILING U.L. RATED PENETRATIONS, CAULK JOINTS, COORDINATE AND FLASH ALL ROOF/WALL PENETRATIONS WITH THE SUB-TRADES.
- CONTINUE SEPARATION WALLS TO UNDERSIDE OF FLOOR/CEILING ABOVE. UNIT TO UNIT, UNIT TO CORRIDOR, CORRIDOR WALLS, STORAGE WALLS, ELEVATOR, STAIRWELL WALLS, ETC.
- PROJECT ASSUMES ALL EXISTING HAZARDOUS MATERIALS HAVE BEEN REMOVED PRIOR TO THE COMMENCEMENT OF WORK. ALL HAZARDOUS MATERIAL REMOVAL IS THE RESPONSIBILITY OF THE OWNER.
- DESIGNATED EGRESS WINDOWS IN SLEEPING ROOMS SHALL MEET THE FOLLOWING MINIMUM CLEAR OPENING REQUIREMENTS OF 22" WIDE, 24" HIGH & 5.7 SF CLEAR OPENING. ALL BEDROOMS SHALL CONTAIN A MINIMUM OF (1) EGRESS OPENING. (NOT APPLICABLE TO THIS PROJECT).

- WINDOW SAFETY GLAZING SHALL BE LOCATED AS FOLLOWS, BUT NOT LIMITED TO:
- ALL WINDOWS WITHIN 60" HORIZ. & VERT. DIMENSION OF STAIRS MUST BE TEMPERED.
 - ALL WINDOWS WITHIN 4" OF A DOOR SWING MUST BE TEMPERED.
 - ALL WINDOWS WITHIN A SHOWER ENCLOSURE MUST BE TEMPERED.
- BUILDING INSULATION SHALL BE PROVIDED AS INDICATED & NOTED IF NOT SHOWN IN ITS ENTIRETY THROUGHOUT THE DRAWING SET. INSULATE ALL BATHROOM, LAUNDRY, MECH. ROOM WALLS, AND ROOF DRAINS THRU BUILDING. BEAM, JOIST OR OTHER STRUCTURAL MEMBER PENETRATIONS NOT SHOWN OR INDICATED ON DRAWINGS MUST BE CONSULTED WITH THE ARCHITECT &/OR ENGINEER PRIOR TO WORK.
 - ANY CHANGE DURING CONSTRUCTION OF USE, OCCUPANCY OR CONSTRUCTION TYPE MUST BE DISCUSSED WITH ARCHITECT PRIOR TO ANY WORK PERFORMED AND SUBSTANTIAL TIME ALLOWED FOR REQUIRED CODE RESEARCH AND DRAWING MODIFICATIONS OR ADDITIONS.
 - REPORT ANY AND ALL DISCREPANCIES TO THE ARCHITECT PRIOR TO PROCEEDING WITH WORK.

PROJECT NOTES

- SCOPE OF WORK SHALL INCLUDE INTERIOR TENANT FIT-UP FOR LOW INCOME HOUSING. WORK TO INCLUDE NEW INTERIOR OFFICE PARTITIONS, NEW CEILING AND NEW MILLWORK AS SHOWN.
- HISTORIC PRESERVATION NOT REQUIRED. NO EXTERIOR WORK PROPOSED. EXTERIOR SIGNAGE NOT PART OF THIS PERMIT.
- ALL NEW WORK SHALL CONFORM TO THE CITY OF PORTLAND INSPECTION, FIRE AND ZONING REQUIREMENTS.
- THE GENERAL CONTRACTOR (GC) SHALL BE RESPONSIBLE FOR ALL INTERIOR WORK. GC TO OBTAIN ALL NECESSARY PERMITS FOR THE CONSTRUCTION, INCLUDING BUT NOT LIMITED TO, STREET CLOSINGS, ELECTRICAL, MECHANICAL, SPRINKLER SYSTEMS, AS REQUIRED. GC TO MODIFY MECHANICAL, ELECTRICAL, PLUMBING AND SPRINKLER SYSTEMS ACCORDING TO ARCHITECTS/ENGINEERS' PLANS.
- BASED ON ARCHITECT'S FLOOR PLAN, ENGINEER SHALL SUBMIT LIFE SAFETY PLANS TO THE STATE OF MAINE AND THE CITY OF PORTLAND FOR APPROVAL.
- FIRE ALARM WORK SHALL BE INSTALLED BY A STATE CERTIFIED CONTRACTOR. FIRE ALARM WORK TO MEET NFPA 72, CITY OF PORTLAND AND STATE FIRE MARSHAL REQUIREMENTS.
- ALL FIRE RATED PENETRATIONS SHALL BE FIRE STOPPED WITH UL APPROVED SYSTEMS. ALL INTERIOR FINISHES TO MEET NFPA 701.
- CONTRACTOR SHALL ADHERE TO BUILDING RULES AND REGULATIONS AGREEMENT FOR INTERIOR CONSTRUCTION AS PROVIDED BY BOULOS PROPERTY MANAGEMENT.
- CONTACT THE ARCHITECT PRIOR TO WORK SHOULD DISCREPANCIES BE DISCOVERED DURING THE BUILDING PROCESS.


DEMOLITION NOTES

- ELECTRIC POWER TO THE TENANT SPACE ONLY SHALL BE DISCONNECTED PRIOR TO ANY DEMOLITION. VERIFY WATER SHUT-OFF W/ BUILDING OWNER. EXISTING DUCT WORK TO REMAIN SHALL BE SEALED. SPRINKLER SYSTEMS, WHERE APPLICABLE, SHALL REMAIN OPERATIONAL UNLESS PERMITTED BY THE CITY BUILDING INSPECTOR. FIRE ALARM SYSTEMS TO REMAIN FULLY OPERATIONAL DURING DEMOLITION.
- DUST BARRIER PARTITIONING SHALL BE INSTALLED @ TENANT SEPARATIONS.
- ALL DEMOLITION SHALL BE REMOVED FROM THE REAR/ SIDE OF THE BUILDING ONLY.
- ALL FIRE PROTECTION (IF EXISTING), GYPSUM DRYWALL &/ OR FRESpray ON STRUCTURAL MEMBERS SHALL REMAIN. BEARING WALLS, FIRE SEPARATION WALLS, BEAMS, COLUMNS & FIRE RATED FLOOR/ CEILING ASSEMBLIES SHALL NOT BE REMOVED.
- PROTECT ALL FINISHES, MATERIALS AND EQUIPMENT NOTED AS EXISTING TO REMAIN.
- DIMENSIONS INDICATED +/- ARE EXISTING CONDITION DIMENSIONS TO BE FIELD VERIFIED.
- REMOVE EXISTING PLUMBING FIXTURES IF ANY, VENTING AND ASSOCIATED EXHAUST FANS. CAP PLUMBING FLUSH WITH FLOOR. (NOT APPLICABLE TO THIS PROJECT).
- GC TO VERIFY WITH 'DIG SAFE' PRIOR TO ANY SITE WORK. (NOT APPLICABLE TO THIS PROJECT).
- FIELD VERIFY ALL STRUCTURAL COMPONENTS PRIOR TO DEMOLITION. REPORT ANY DISCREPANCIES IMMEDIATELY TO ARCHITECT.

NFPA 101 2009 & NFPA 220 2006 CODE DATA	
OCCUPANT LOAD	30 PEOPLE
USE GROUP CLASSIFICATION	BUSINESS
TYPE OF CONSTRUCTION	EXISTING TO REMAIN
TOTAL AREA OF WORK	3,000 SF
ACTUAL BUILDING AREA	188,072 SF (18,807 SF PER FLOOR)
BUILDING HEIGHT	(10) TEN STORIES
BUILDING AREA LIMITATION	N/A
BUILDING HEIGHT LIMITATION	N/A
STREET FRONTAGE INCREASE (150%) - SQ. FT.	N/A
AUTOMATIC SPRINKLER SYSTEM AREA INCREASE (200%) - SQ. FT.	N/A
AUTOMATIC SPRINKLER SYSTEM HEIGHT INCREASE	N/A
FIRE SUPPRESSION:	YES-PER NFPA 13
EXIT ACCESS FIRE RATINGS:	
FIRE WALLS:	
PARTY WALLS	0 HOUR
STAIR ENCLOSURES	2 HOURS
SHAFTS	2 HOURS
EXIT ACCESS CORRIDORS	0 HOUR
FIRE PROTECTION OF STRUCTURE:	
PRIMARY STRUCTURAL FRAME	EXISTING TO REMAIN
LOAD BEARING WALLS - EXTERIOR	EXISTING TO REMAIN
LOAD BEARING WALLS - INTERIOR	EXISTING TO REMAIN
NON-LOAD BEARING WALLS - EXTERIOR	EXISTING TO REMAIN
NON-LOAD BEARING WALLS - INTERIOR	EXISTING TO REMAIN
FLOOR CONSTRUCTION	EXISTING TO REMAIN
ROOF CONSTRUCTION	EXISTING TO REMAIN
GENERAL NOTES : OCCUPANT LOAD: 3000 SF/ 100 SF/PERSON = 30	
TOTAL OCCUPANT LOAD = 30 PEOPLE	
INTERIOR FINISHES: WALLS AND CEILINGS: CLASS A, B OR C FLOORS: CLASS 1 OR 2 F.F.E. SHALL MEET NFPA 265 AND 701.	


IBC 2009 CODE DATA	
OCCUPANT LOAD	30 PEOPLE
USE GROUP CLASSIFICATION	BUSINESS
TYPE OF CONSTRUCTION	EXISTING TO REMAIN
TOTAL AREA OF WORK	3,000 SF
ACTUAL BUILDING AREA	188,072 SF (18,807 SF PER FLOOR)
BUILDING HEIGHT	(10) TEN STORIES
BUILDING AREA LIMITATION - SQ. FT. (TABLE 503)	37,500 SF PER FLOOR
BUILDING HEIGHT LIMITATION - STORIES (TABLE 503)	N/A
STREET FRONTAGE INCREASE (150%) - SQ. FT.	N/A
AUTOMATIC SPRINKLER SYSTEM AREA INCREASE (200%) - SQ. FT.	N/A
AUTOMATIC SPRINKLER SYSTEM HEIGHT INCREASE	N/A
FIRE SUPPRESSION:	YES-PER NFPA 13
EXIT ACCESS FIRE RATINGS:	
FIRE WALLS:	
PARTY WALLS	0 HOUR
STAIR ENCLOSURES	2 HOURS
SHAFTS	2 HOURS
EXIT ACCESS CORRIDORS	0 HOUR
FIRE PROTECTION OF STRUCTURE:	
PRIMARY STRUCTURAL FRAME	EXISTING TO REMAIN
LOAD BEARING WALLS - EXTERIOR	EXISTING TO REMAIN
LOAD BEARING WALLS - INTERIOR	EXISTING TO REMAIN
NON-LOAD BEARING WALLS - EXTERIOR	EXISTING TO REMAIN
NON-LOAD BEARING WALLS - INTERIOR	EXISTING TO REMAIN
FLOOR CONSTRUCTION	EXISTING TO REMAIN
ROOF CONSTRUCTION	EXISTING TO REMAIN
GENERAL NOTES : OCCUPANT LOAD: 3000 SF/ 100 SF/PERSON = 30	
TOTAL OCCUPANT LOAD = 30 PEOPLE	
INTERIOR FINISHES: WALLS AND CEILINGS: CLASS A, B OR C FLOORS: CLASS 1 OR 2 F.F.E. SHALL MEET NFPA 265 AND 701.	

TYPE 1 PROPOSED NEW WALL - INTERIOR

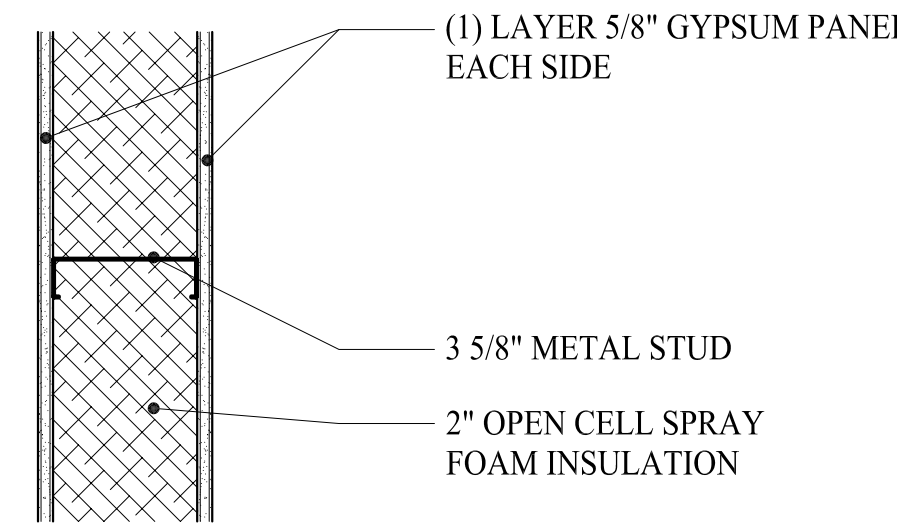

1 3 5/8" METAL WALL - (NON-RATED)
CAULK PERIMETER


- * EXTEND WALL 3" ABOVE CEILING.
- * INSTALL ALL MATERIALS PER MANUFACTURER'S REQUIREMENTS.

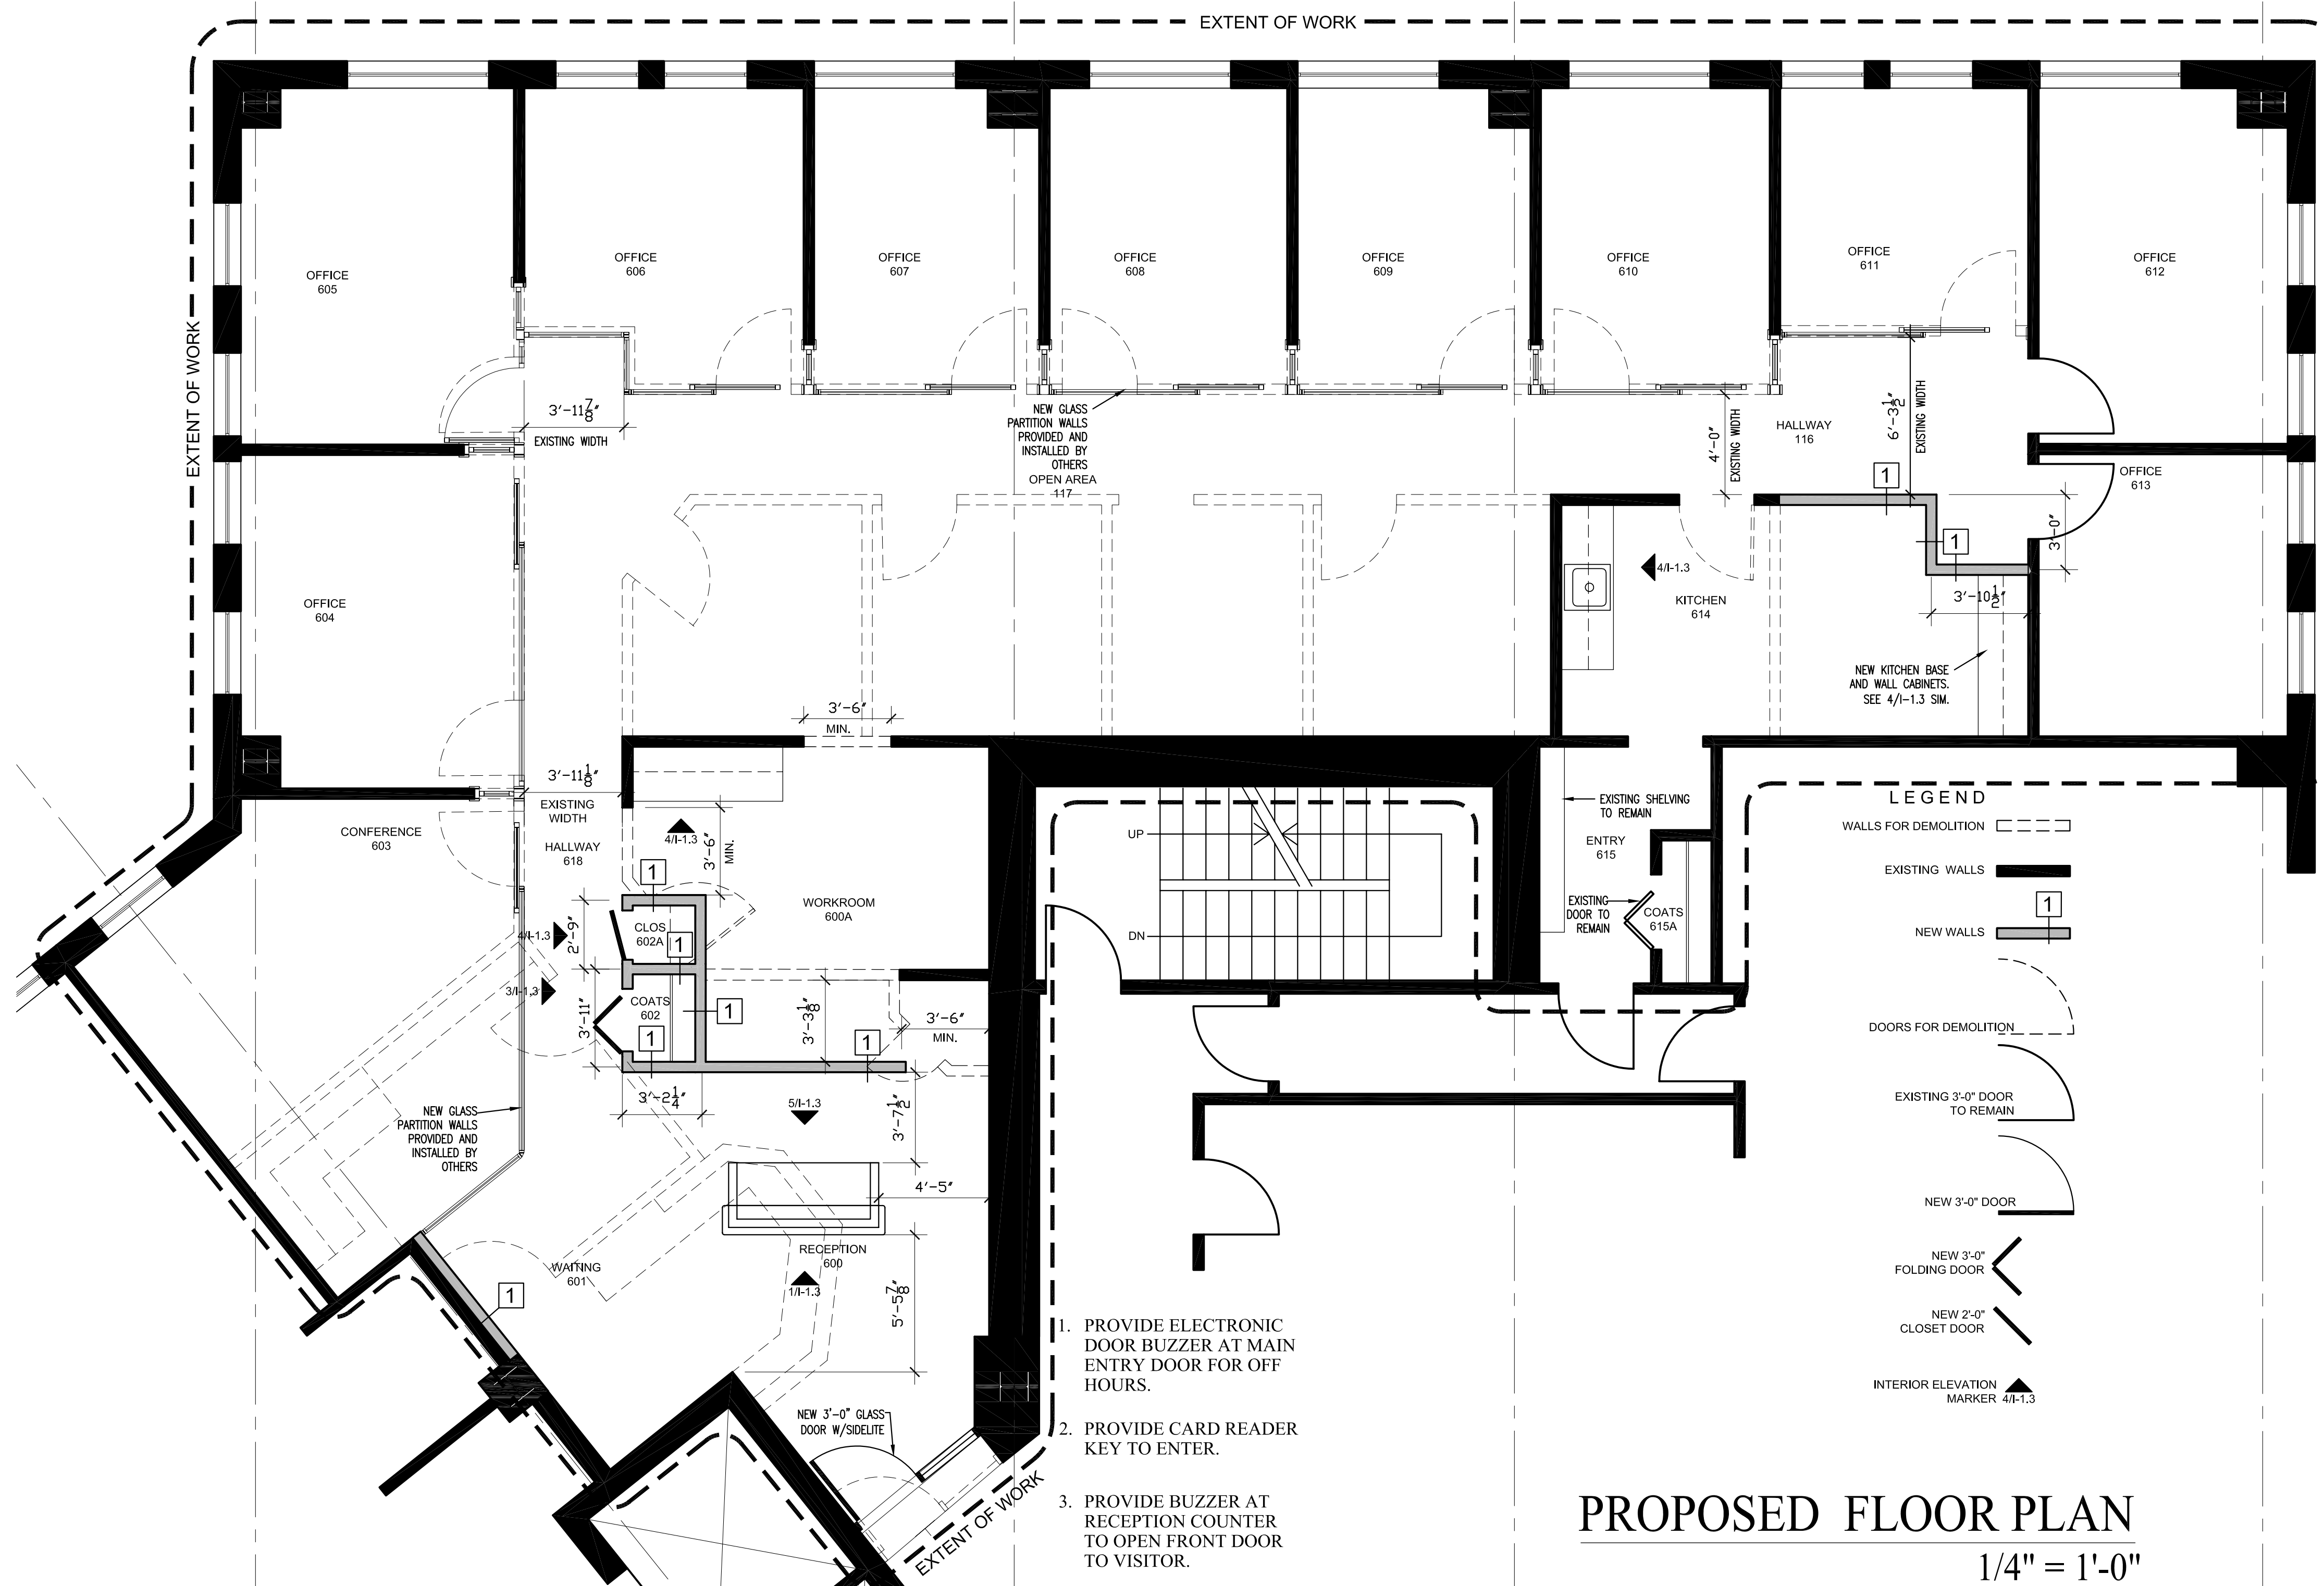

PROPOSED FLOOR PLAN

1/4" = 1'-0"

PERMIT SET: JANUARY 2, 2014

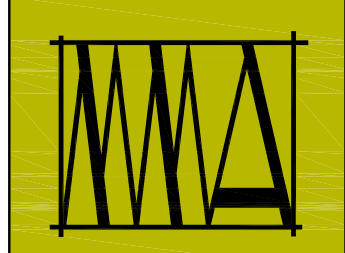

MARK MUELLER ARCHITECTS
A.I.A.

100 Commercial Street
Suite 205
Portland, Maine 04101
Phone: 207.774.9057
Email: rf@muellerarchitects.com

© COPYRIGHT 2013
MARK MUELLER ARCHITECTS

LIH, INC.
6TH FLOOR
ONE PORTLAND SQUARE
PORTLAND, MAINE 04101

Interior Tenant Renovations:

PROPOSED FLOOR PLAN

REVISIONS
DATE
DECEMBER 2013
PROJECT
6TH FLOOR OFFICE ONE PORTLAND SQUARE
DRAWN BY
JME
CHECK BY
MUM

A-1.1