


#KEYED NOTES

- ① EXISTING TEMPERATURE SENSOR TO REMAIN.
- ② EXISTING AHU.
- ③ SCOPE OF WORK ON "HOLD" PENDING INFORMATION FROM CLIENT.

NOTE: ALL EXISTING SUPPLY DIFFUSERS, RETURN REGISTERS, AND EXHAUST GRILLES TO REMAIN IN SAME CEILING GRID LOCATION UNLESS OTHERWISE NOTED.

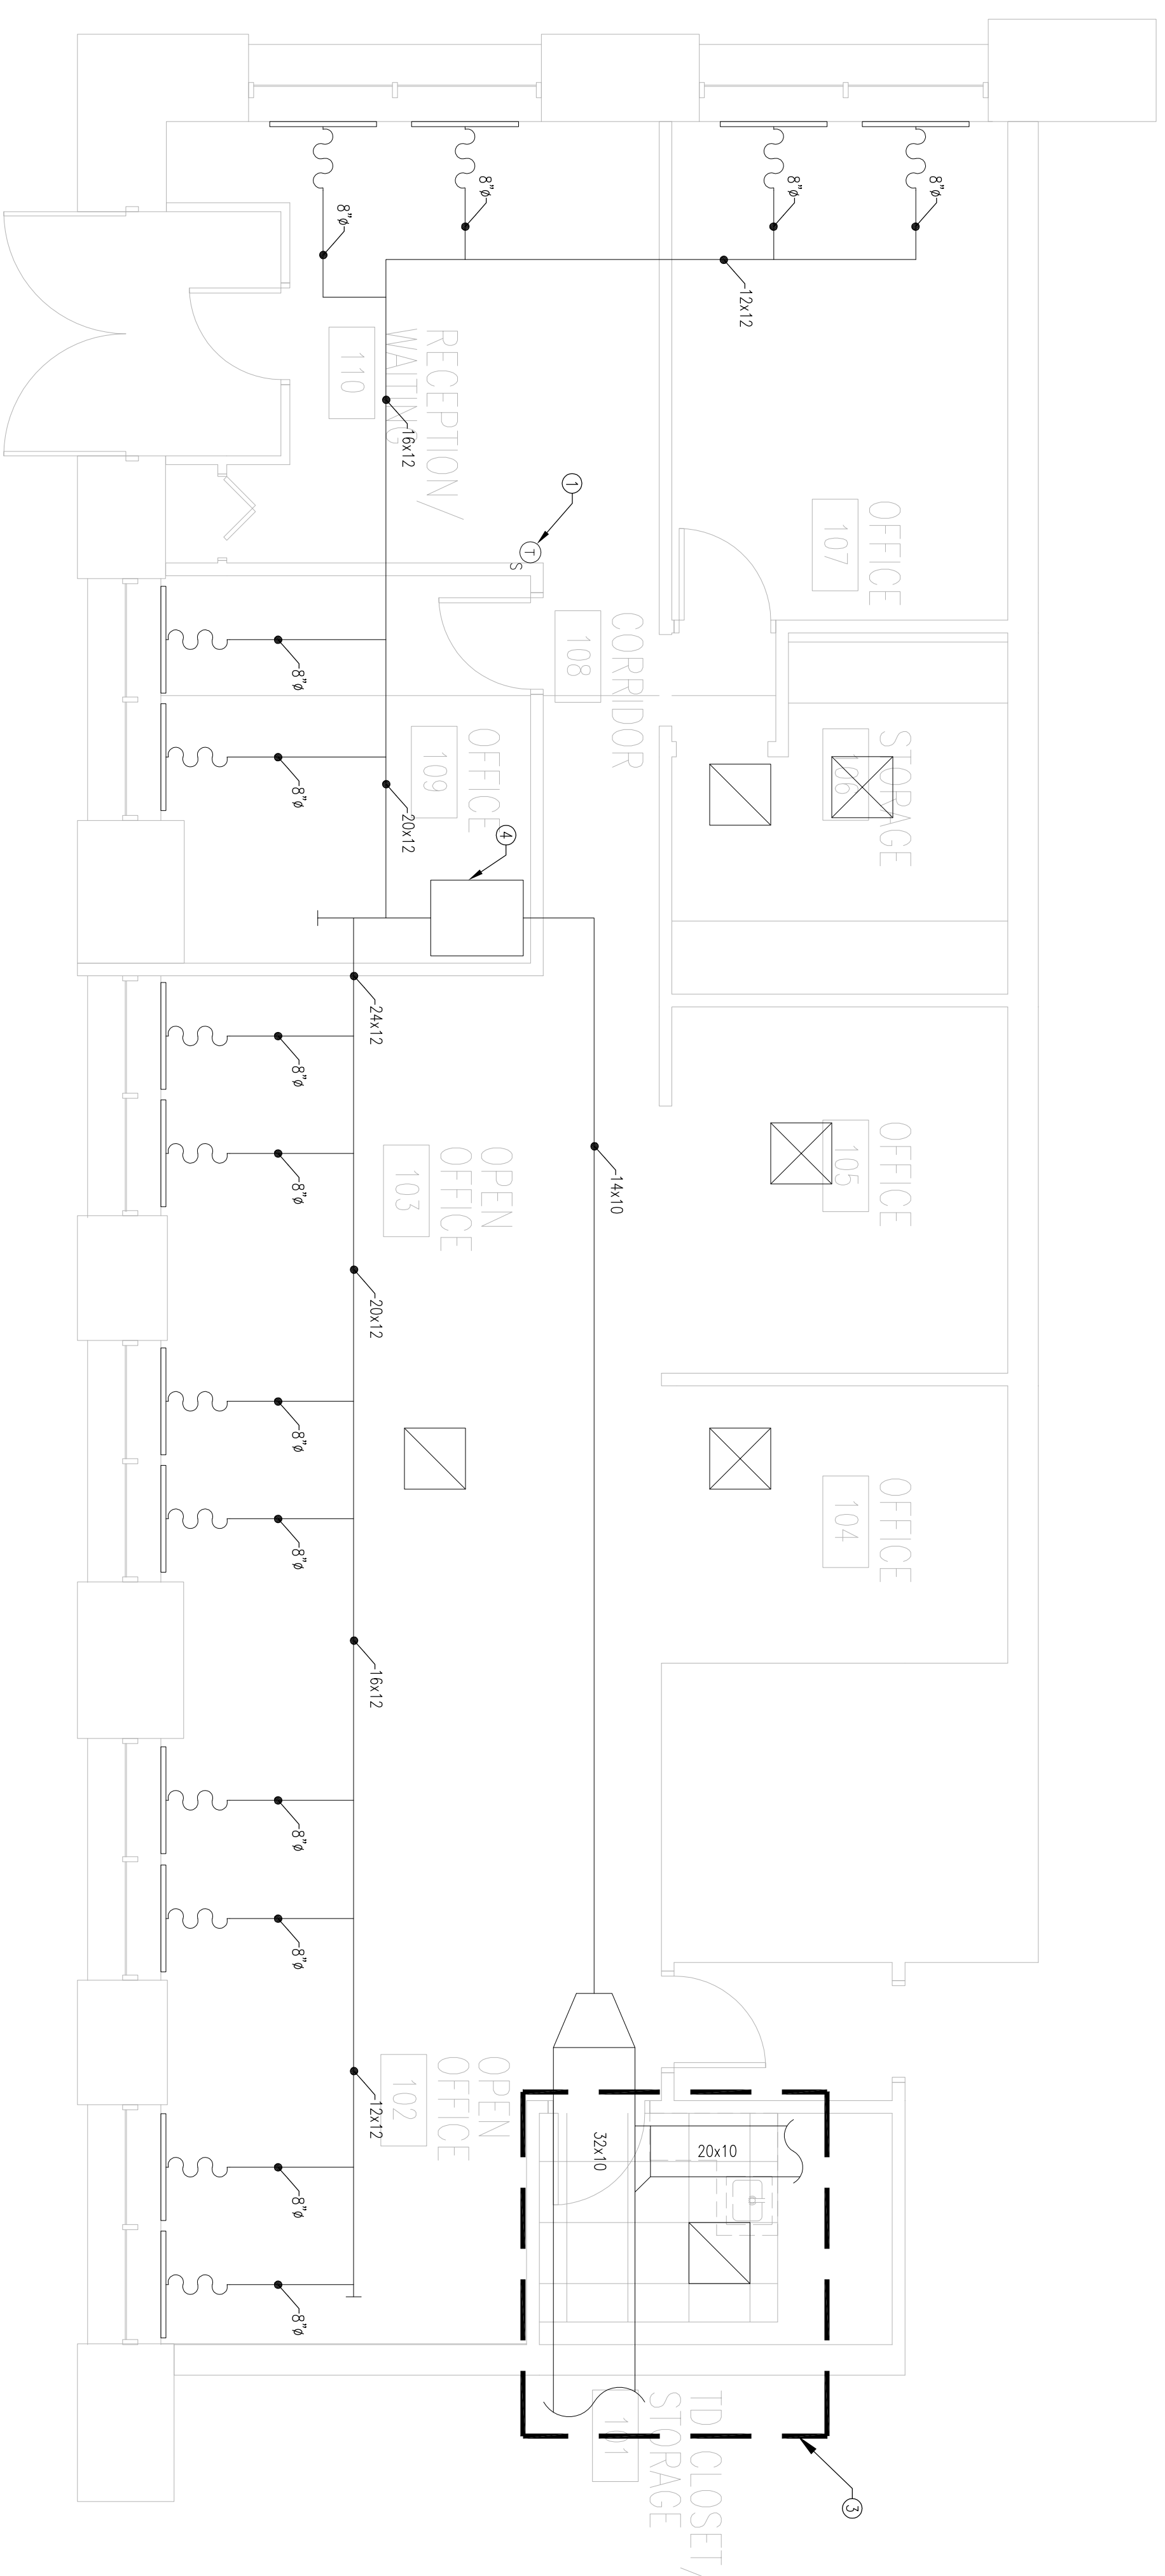

LEGEND	
	SUPPLY DIFFUSER
	RETURN GRILLE
	TEMPERATURE SENSOR
	KEYED NOTE
	FLEXIBLE DUCT

OWNER REVIEW _____ DATE _____
NAME _____

NO.	DATE	DESCRIPTION
1	2/5/2010	PERMIT SET
ISSUE LOG		
Δ		CLOUDED CHANGE
TD BANK		
TENANT RENOVATION		
1 PORTLAND SQUARE		
CAMBRIDGE, MA 02142		

**LOWER LEVEL PLAN
& SCHEDULE**

SCALE 1/4"=1'-0"
DRAWN BY MGR
CHECKED BY
PROJ. ARCH./ENGR. AAB/MOB
PROJ. MGR. SJD
JOB NO. 09093V/09063.01
SYMMES MAINI & MCKEE ASSOCIATES, INC. 2010

M1.01