


LEGEND

- HS horn strobe
 - illuminated exit sign with 90 minute battery backup and direction indicators
 - emergency light with 90 minute battery backup
 - P pull station
- building owner reports building to be fully sprinklered.
- provide add price for replacing all emergency lights on 4th floor with new

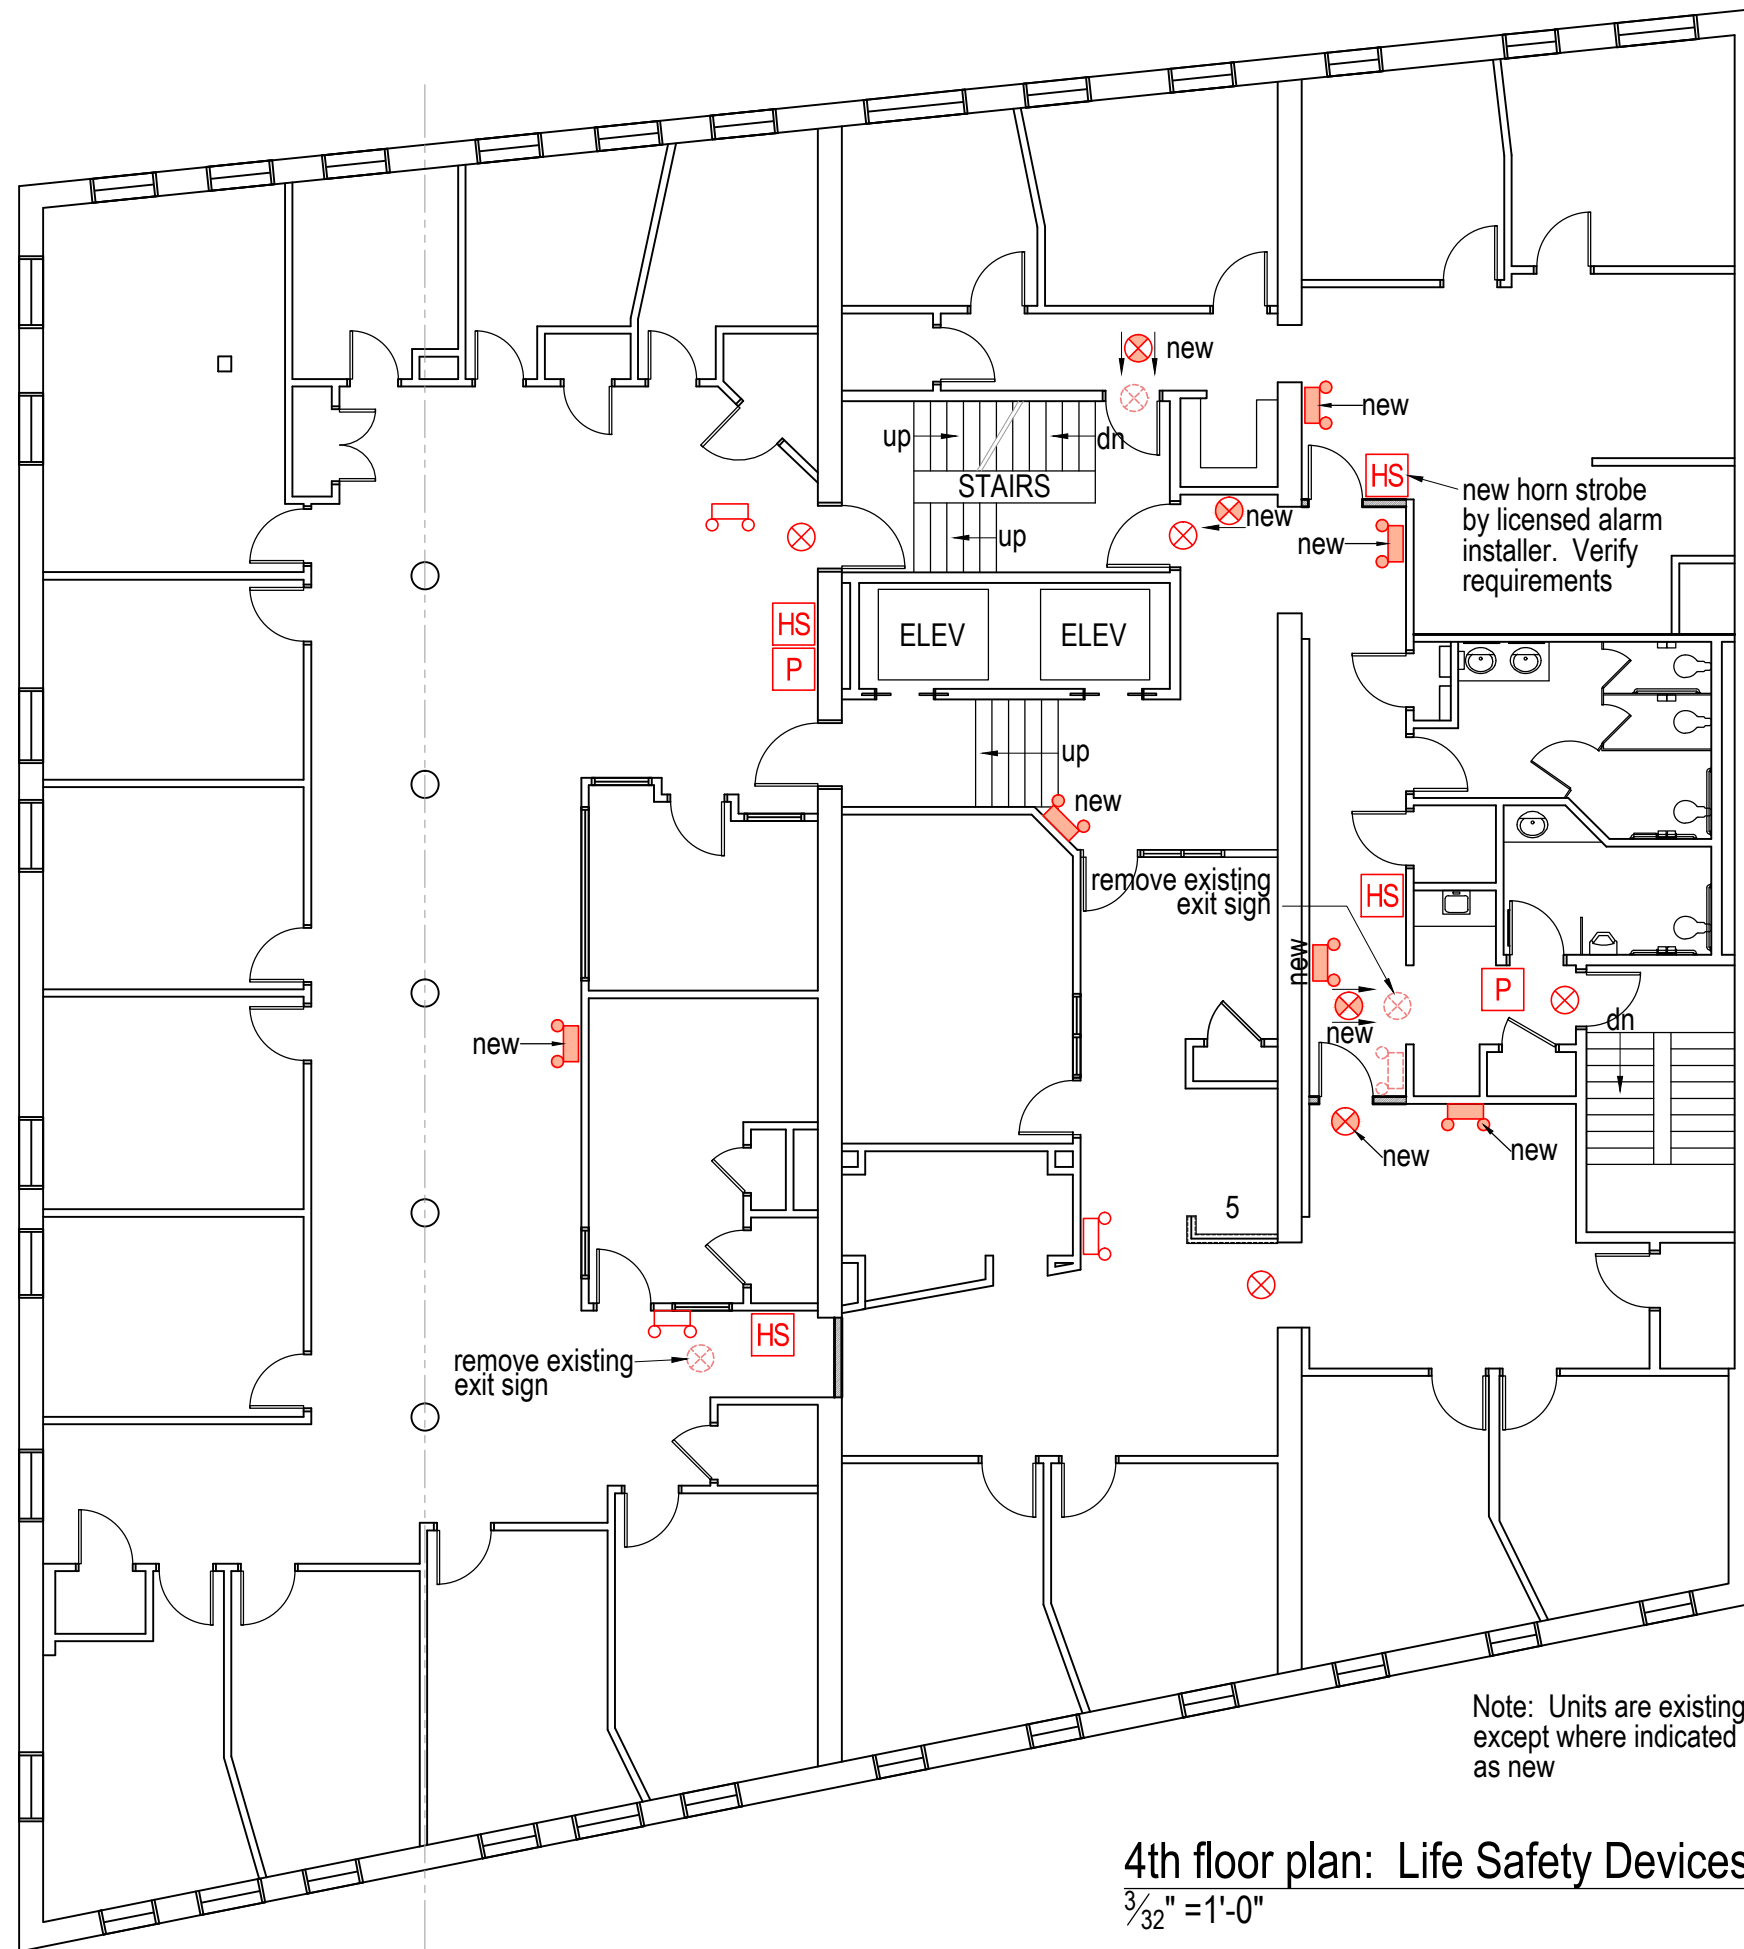

4th floor plan: Life Safety Devices
 $\frac{3}{32}'' = 1'-0''$