


PROJECT NORTH

- NOTES:
1. STAIR DETAILS SEE DRAWING A11 THRU A17
  2. WALL TYPES SEE DRAWING A20
  3. DOOR SCHEDULE SEE DRAWINGS A25 THRU A27
  4. ELECTRICAL ENGINEER SHALL REVIEW AND CONFIRM LIFE SAFETY COMPONENTS & EMERGENCY LIGHTING REQUIREMENTS AND EQUIPMENT SHOWN. (PROVIDE PHOTOELECTRIC LAYOUTS IF NEEDED IN 1ST FLOOR RESTAURANT AREA). SEE NOTES 18, 19, 20, 24 ON DWG LST
  5. REFER TO ELECTRICAL DRAWINGS FOR SPECIFIC EQUIPMENT SPECIFICATIONS AND LAYOUTS

ENLARGED PLAN SEE DWG A18

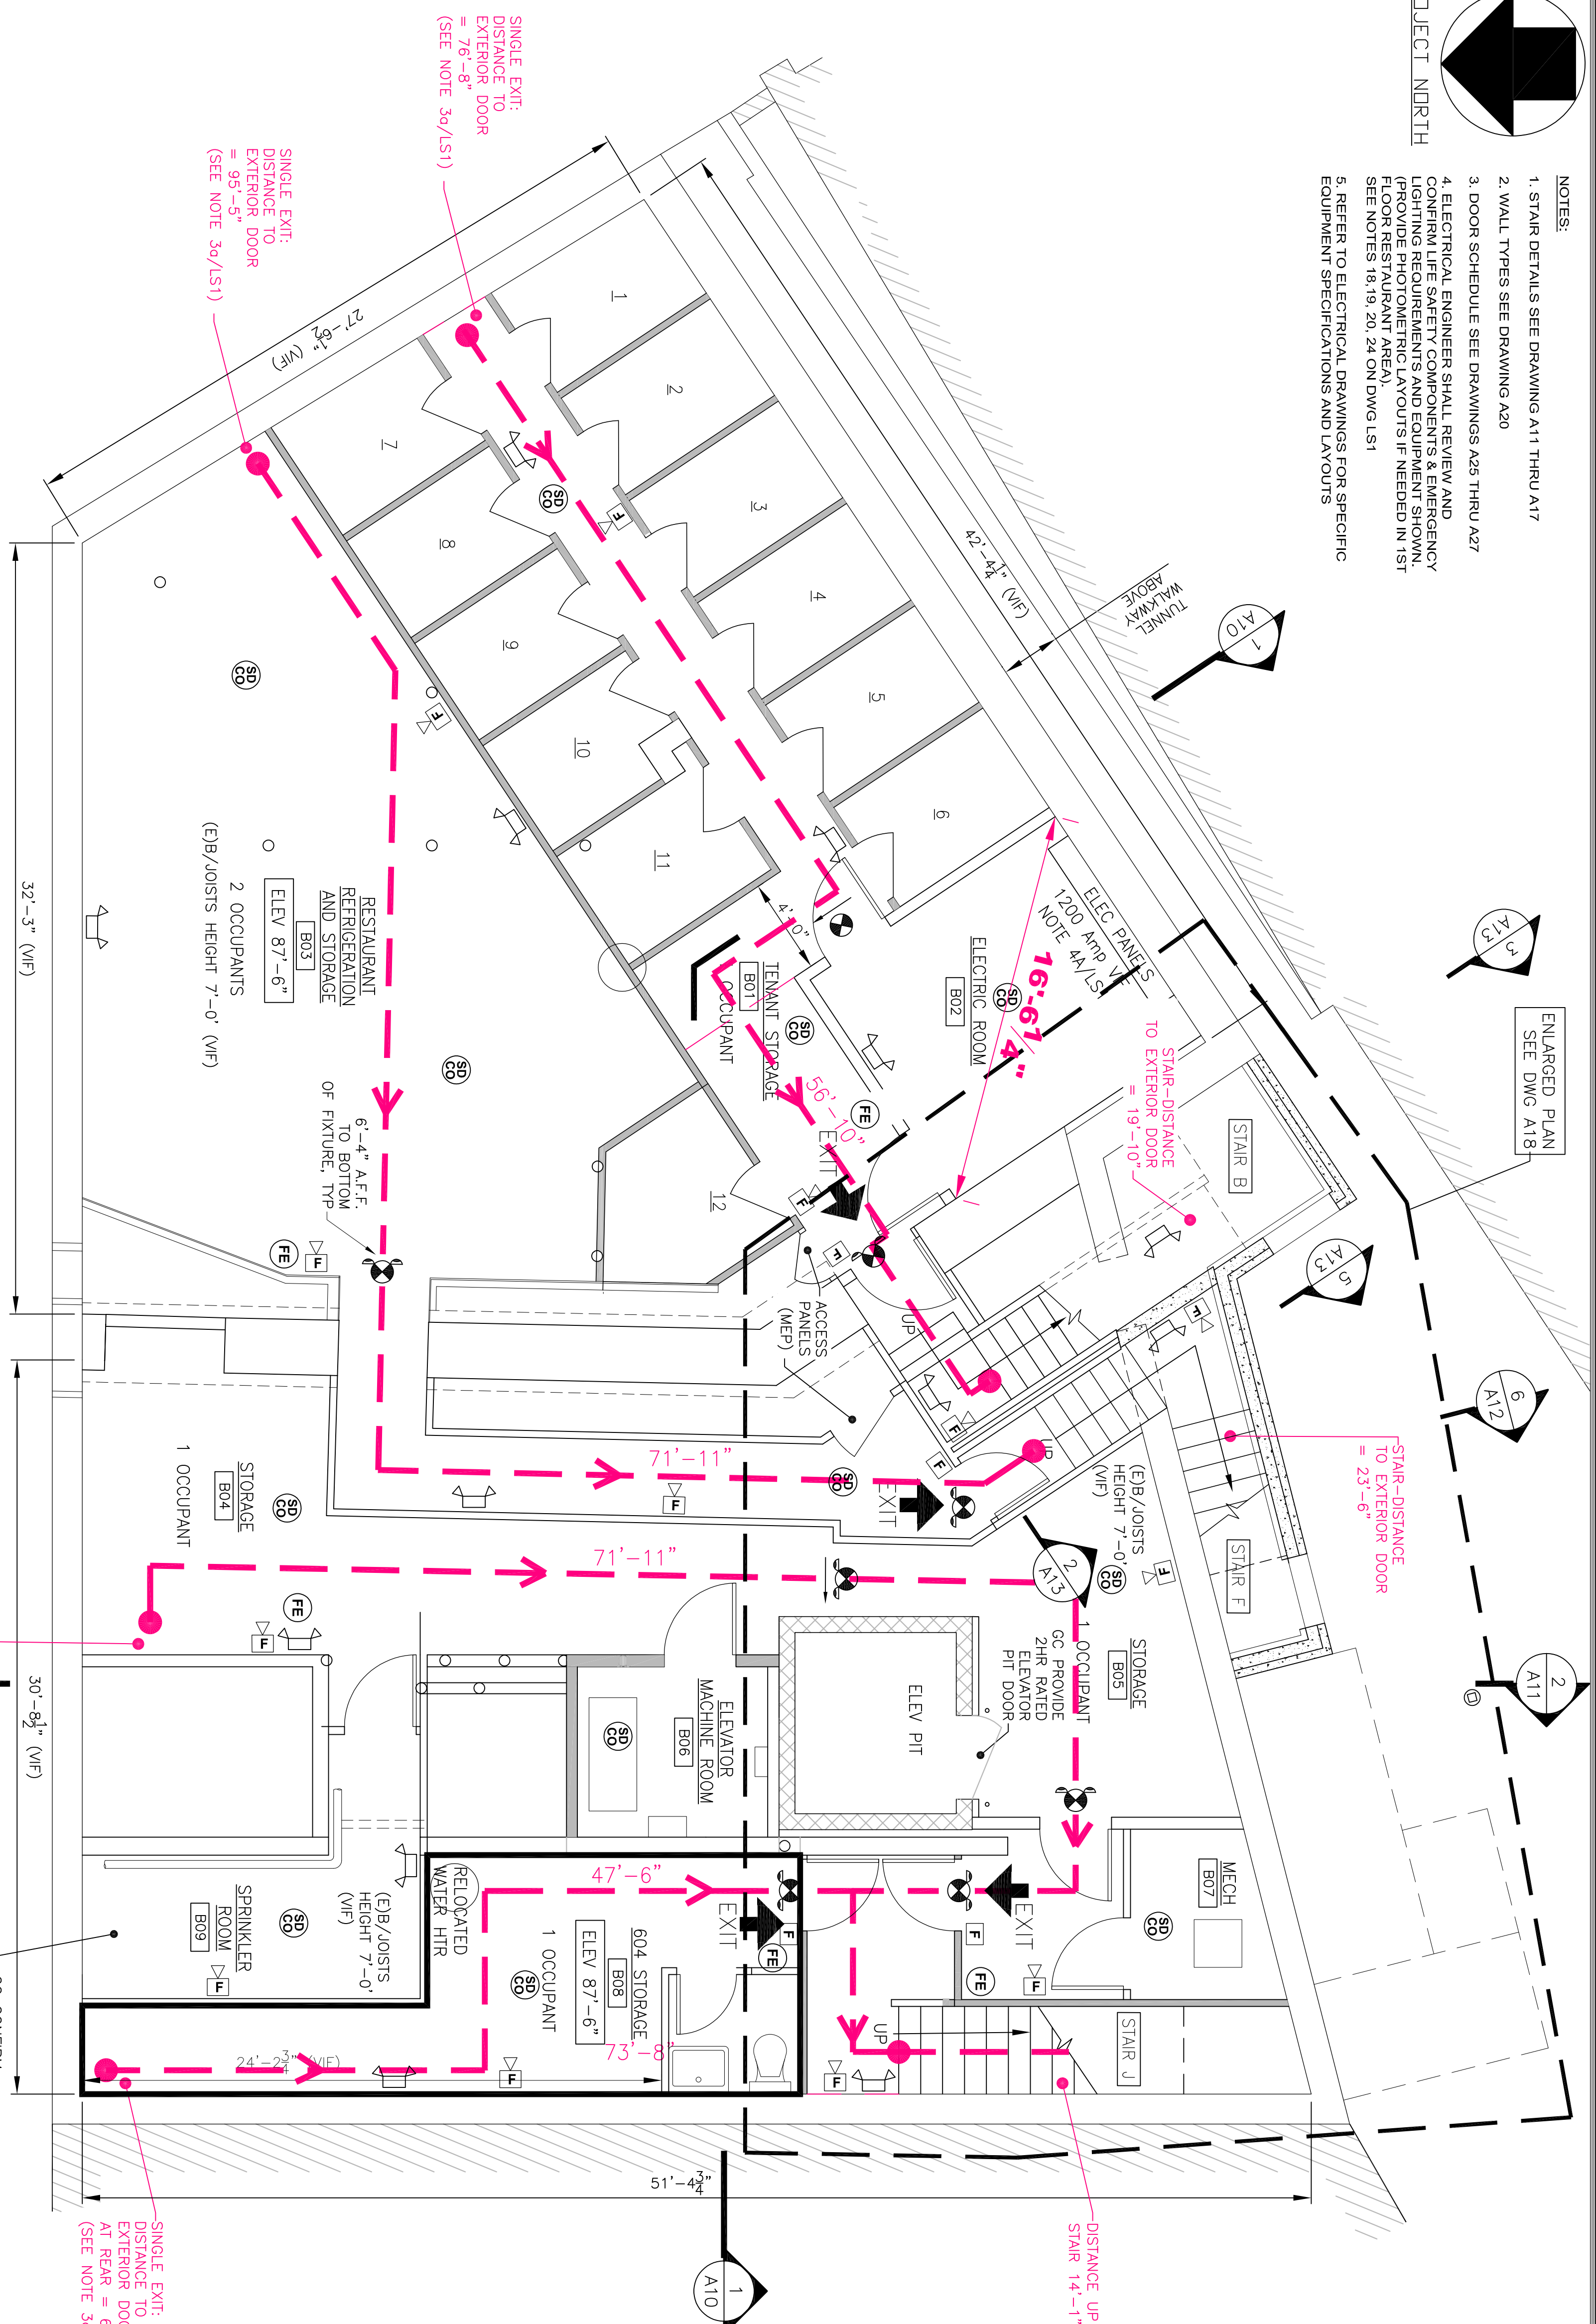


- RESTAURANT REFRIGERATION/ORDINARY STORAGE ROOMS B03 (Incl. Corridor)
- 801 S.F. = 500 SF/PERSON = 1 OCCUPANT
- ORDINARY STORAGE / MECHANICAL ROOMS B01 AND B02
- 814 S.F. = 500 SF/PERSON = 2 OCCUPANTS
- ORDINARY STORAGE / MECHANICAL ROOM B08
- 209 S.F. = 500 SF/PERSON = 1 OCCUPANT
- 604 ORDINARY STORAGE / MECHANICAL ROOM B04
- 500 SF/PERSON = 1 OCCUPANT

ENTIRE BUILDING FULLY SPRINKLERED PER NFPA 13

LEGEND

- (FT) EGRESS TRAVEL PATHS
- (FE) FIRE EXTINGUISHER
- EXTERIOR EMERGENCY LIGHT UNIT DUAL-LITE (LED) MODEL DYN 6 WITH WIRE GUARD COLOR BY OWNER
- SELF CONTAINED EMERGENCY LIGHT DUAL-LITE (LED) L225M-Q3L OR APPD EQUAL 25 WATTS FOR 90 MINUTES COLOR BY OWNER
- INTERIOR REMOTE HEAD EMERGENCY LIGHT UNIT DUAL-LITE (LED) MODEL OPBD 1203L COLOR BY OWNER
- EXTERIOR REMOTE HEAD EMERGENCY LIGHT UNIT DUAL-LITE (LED) MODEL OORD 1203L COLOR BY OWNER
- EXIT EMERGENCY LIGHT COMBINATION COLOR BY OWNER
- EXIT LIGHT ILLUMINATED (UNSWITCHED) DUAL-LITE LX-LR-W-E OR APPD EQUAL COLOR BY OWNER
- EXIT LIGHT ILLUMINATED (UNSWITCHED) [CHEVRON DIRECTIONAL ARROW]
- 30 MH/F FIRE ALARM AUDIOPUSUAL MOUNT 6-5\"/>

SHWARTZ BUILDING RENOVATIONS  
600-604 CONGRESS STREET  
PORTLAND, MAINE  
BASEMENT FLOOR - LIFE SAFETY PLAN

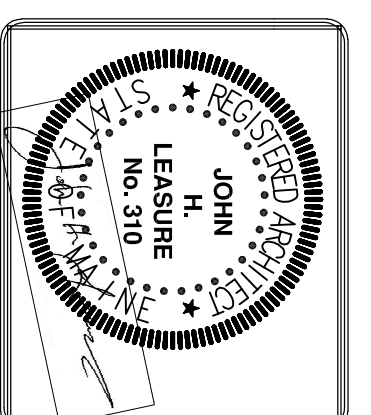

REV.	DATE	STATUS
.	3-30-17	STATE FIRE MARSHAL SUBMISSION
1	4-28-17	SUBMITTED FOR PERMITS

JOHN H. LEASURE ARCHITECT, INC.  
6 Q STREET  
SOUTH PORTLAND, MAINE 04106

