


PROJECT NORTH

- NOTES:
1. FOR RESTAURANT FURNITURE AND SEATING LAYOUT SEE DRAWING A28
 2. FOR PUBLIC RESTROOM PLANS AND ELEVATIONS SEE DRAWING A24
 3. FOR WALL TYPES SEE DRAWING A20
 4. STAIR DETAILS SEE DRAWING A11 THRU A17
 5. DOOR SCHEDULE SEE DRAWINGS A25 THRU A27
 6. ELECTRICAL ENGINEER SHALL REVIEW AND CONFIRM LIFE SAFETY COMPONENTS & EMERGENCY LIGHTING REQUIREMENTS AND EQUIPMENT SHOWN. PROVIDE PHOTOMETRIC LAYOUTS IF NEEDED IN 1ST FLOOR RESTAURANT AREA.
 7. REFER TO ELECTRICAL DRAWINGS FOR SPECIFIC EQUIPMENT SPECIFICATIONS AND LAYOUTS.
 8. GC SHALL CONFIRM TYPES AND LOCATIONS OF KNOX BOXES WITH CITY F.D. & H.P. DEPTS.

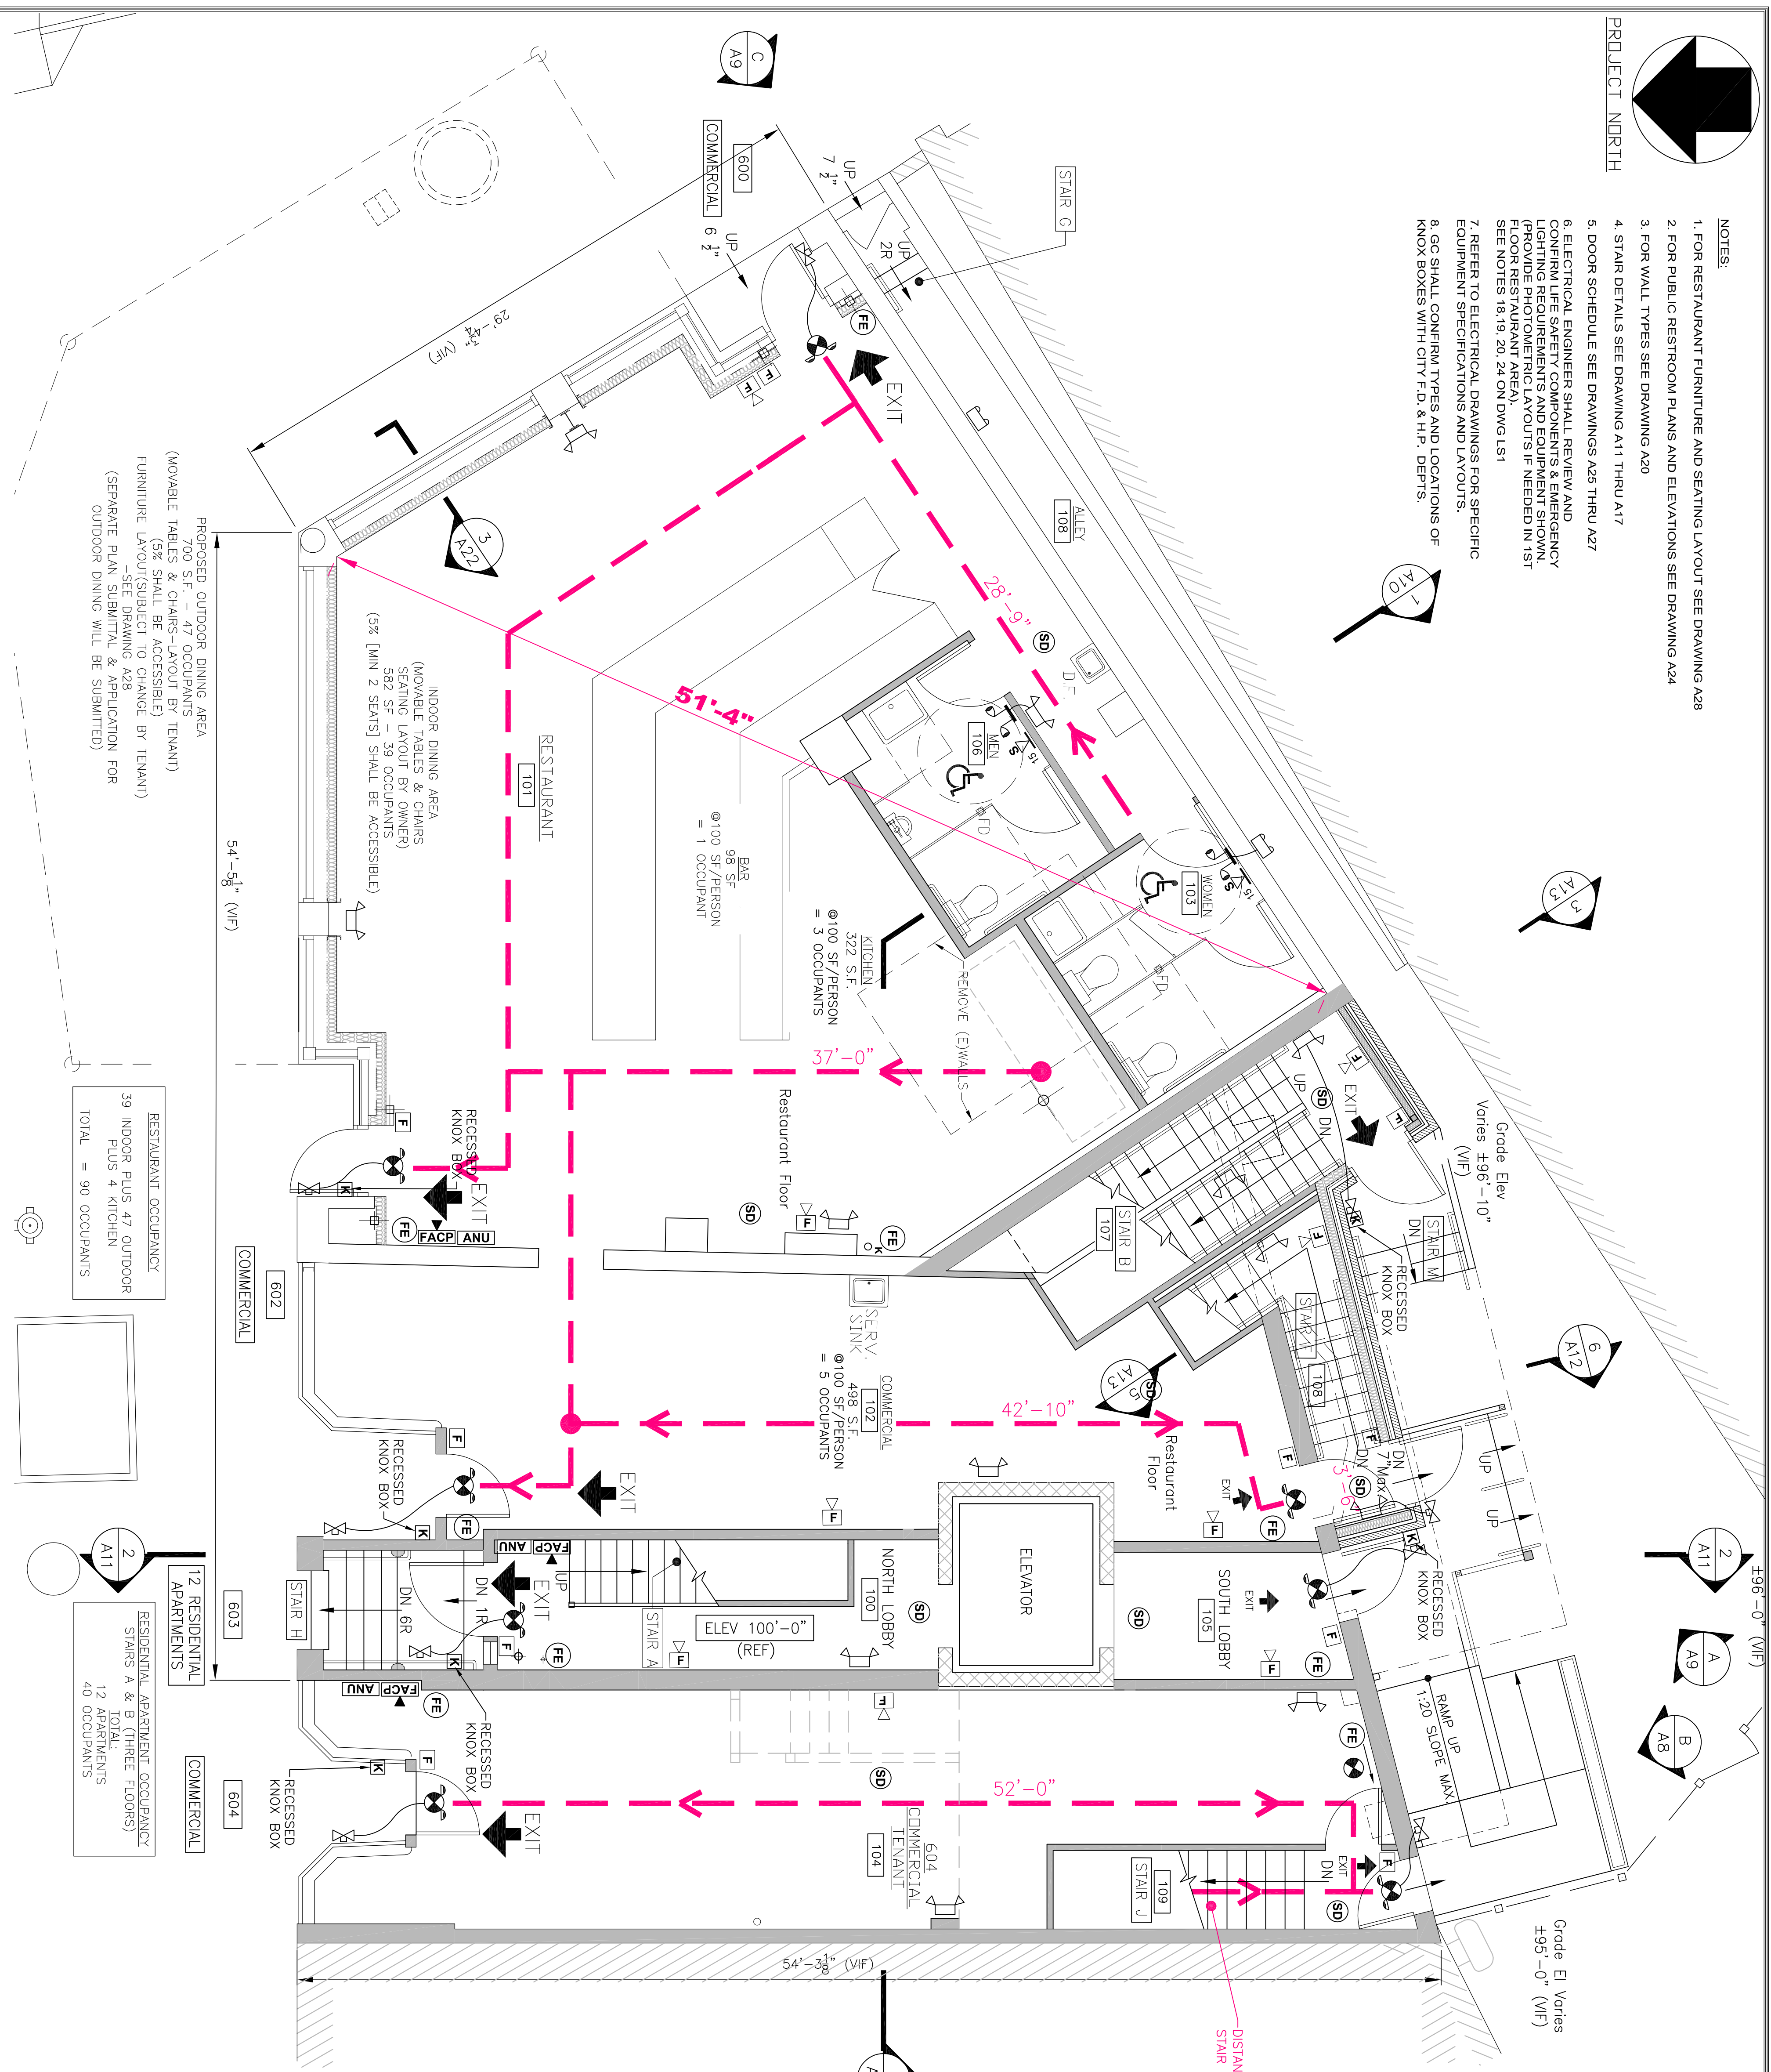


REFER TO ELECTRICAL DRAWINGS FOR EQUIPMENT SPECIFICATIONS AND LAYOUT

LEGEND

- (FT) EGRESS TRAVEL PATHS
- (FE) FIRE EXTINGUISHER
- (E) EXTERIOR EMERGENCY LIGHT UNIT (WET LOCATION LISTED) DUAL-LITE (LED) MODEL DVN1 6 WITH WIRE GUARD COLOR BY OWNER
- (E) SELF-CONTAINED EMERGENCY LIGHT WITH 2 HEADS (LED) U228K02L OR APPD EQUAL COLOR BY OWNER
- (E) INTERIOR REMOTE HEAD EMERGENCY LIGHT UNIT DUAL-LITE (LED) MODEL CPD1 1203L COLOR BY OWNER
- (E) EXTERIOR REMOTE HEAD EMERGENCY LIGHT UNIT (WET LOCATION LISTED) MODEL OSRD 1503L COLOR BY OWNER
- (E) EXIT / EMERGENCY LIGHT COMBINATION DUAL-LITE EVOLQR-D4H OR APPD EQUAL COLOR BY OWNER
- (E) EXIT LIGHT ILLUMINATED (UNSWITCHED) DUAL-LITE EVOLQR-D4H OR APPD EQUAL COLOR BY OWNER
- (E) EXIT LIGHT ILLUMINATED (UNSWITCHED) [OPTIONAL DIRECTIONAL, ARROW] COLOR BY OWNER
- (E) FIRE ALARM AUDIOVISUAL MOUNT 6'-8" AFF NUMBER INDICATES CANDELA RATING, MH - MINIMUM CL DENOTES CEILING MOUNTED NO DESIGNATION INDICATES 15sd
- (E) FIRE ALARM PULL STATION MOUNT AT 48" AFF
- (S) FIRE ALARM VISUAL STROBE MOUNT 6'-8" AFF. NUMBER INDICATES CANDELA RATING CL DENOTES CEILING MOUNTED SYSTEM CONNECTED SMOKE/ CARBON MONOXIDE DETECTOR PHOTOELECTRIC TYPE
- (SD) SYSTEM CONNECTED SMOKE/ CARBON MONOXIDE DETECTOR PHOTOELECTRIC TYPE
- (HD) SYSTEM CONNECTED FIXED TEMPERATURE HEAT DETECTOR
- (SD) SYSTEM CONNECTED FIXED TEMPERATURE HEAT DETECTOR PHOTOELECTRIC TYPE
- (CO) SYSTEM CONNECTED CARBON MONOXIDE DETECTOR
- (FACP) FIRE ALARM CONTROL PANEL WITH DEDICATED TELEPHONE JACK
- (ANU) FIRE ALARM ANNUNCIATOR PANEL
- (K) KNOX BOX FIRE DEPT EMERGENCY KEY HOLDER

FIRST FLOOR PLAN


1/4" = 1'-0"

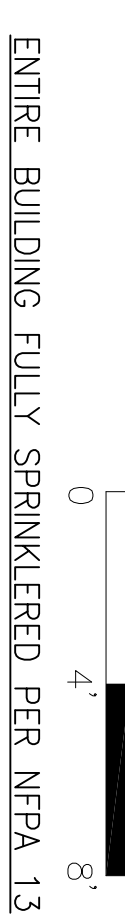

SHWARTZ BUILDING RENOVATIONS
 600-604 CONGRESS STREET
 PORTLAND, MAINE

FIRST FLOOR - LIFE SAFETY PLAN

REV.	DATE	STATUS
3	3-30-17	STATE FIRE MARSHAL SUBMISSION
1	4-28-17	SUBMITTED FOR PERMITS

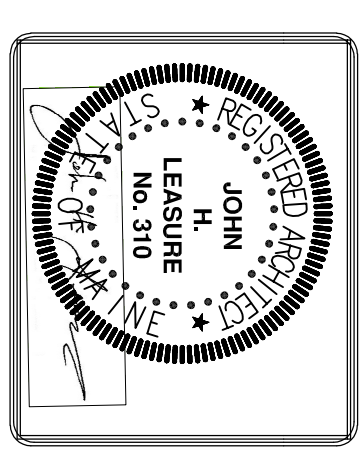

JOHN H. LEASURE ARCHITECT, INC.
 6 Q STREET
 SOUTH PORTLAND, MAINE 04106

