


612 Congress Ground Floor

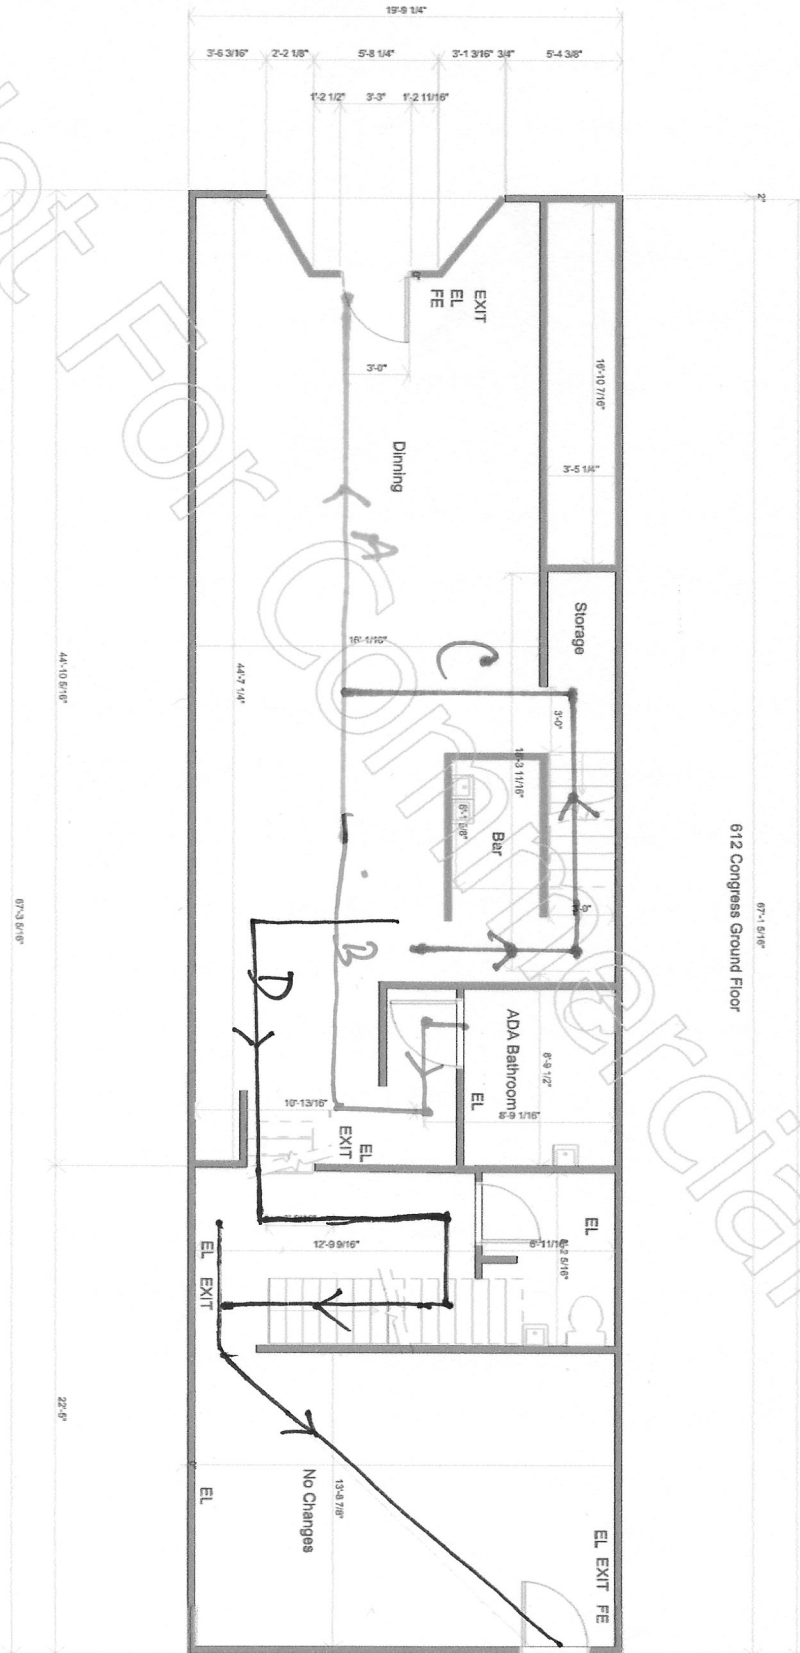

EXIT

All ceilings rated at 2 hour burn
 All exterior walls rated at 2 hour burn
 New interior walls at 1/2 hour burn

FE-5lb Type K Fire Extinguisher
 EXIT - Exit sign
 EL - Emergency lighting

Egress

Use