

NOTES:

1. NEW GUARDRAIL TYPES
 GR1 - WIDE FLANGE W12x22 GUARDRAIL FASTENED TO EXISTING W6 POSTS WHERE CANTILEVERED ENDS EXTEND MORE THAN 1'-0" BEYOND LAST POST. CONNECT TO EXISTING W6 POSTS USING W6x16 POSTS SET IN PLATE BY EXCAVATION & BACKFILL. SEE ELEVATION J5/SF501 UNLESS OTHERWISE NOTED.
 GR2 - SAME AS GUARDRAIL GR1 EXCEPT USE W12x30 BEAM. THIS SECTION IS INTENDED TO APPLY ONLY WHERE EXISTING DIAGONAL BRACING INTERFERES W/ W6 POSTS.
 GR3 - FLG-BEAM GUARDRAIL (100A) PER AISC100 SPECIFICATION. W60 ATTACHED TO W6x16 POSTS. POSTS MAY BE DRIVEN INTO EXISTING PAVEMENT/SOIL OR SET IN PLACE BY EXCAVATION & BACKFILL. SEE ELEVATION J5/SF501
 GR4 - WIDE FLANGE W12x22 GUARDRAIL FASTENED TO W6x16 POSTS ANCHORED TO EXISTING SLAB. SEE SECTION E1/SF501. THIS GUARDRAIL INCLUDES PEDESTRIAN PROTECTION IN ADDITION TO VEHICLE PROTECTION.
 GR5 - WIRE ROPE GUARDRAIL @ RAMP. PROVIDE 4 @ 5/16" & 6 @ 1/4" WIRE ROPE SHALL BE 6x19WRC EXTRA IMPROVED FLOW STEEL. WIRE ROPE & FITTINGS SHALL BE DRILLED HOLES AS SPECIFIED FOR COLUMN REPAIRING @ LOWER LEVELS OF COL. G5 & G6. SEE SECTION J14/SF501 & TYPICAL TERMINATION DETAIL E14/SF501.
 GR6 - SAME AS GR5 EXCEPT WIRE ROPE IS SECURED TO STEEL PLATES WELDED TO EXISTING COLUMNS. SEE SECTION N1/SF502 FOR TYPICAL DETAIL & SECTION J1/SF502 FOR DETAIL @ TERMINATION.
 GR9 - WIRE ROPE GUARDRAIL (100A) PER AISC100 SPECIFICATION. W60 ATTACHED TO W6x16 POSTS. POSTS MAY BE DRIVEN INTO EXISTING PAVEMENT/SOIL OR SET IN PLACE BY EXCAVATION & BACKFILL. SEE ELEVATION J5/SF501 UNLESS OTHERWISE NOTED.
2. DIMENSIONS & MEMBER SIZES ARE ESTIMATIONS BASED ON PREVIOUSLY PREPARED DOCUMENTS & FIELD MEASUREMENTS.
3. AT STAIRS INSTALL GENERAL POLYMERS EPO-FLEX PEDESTRIAN TOPPING SYSTEM AS FOLLOWS:
 A. PREPARE CONCRETE SURFACES BY ABRASIVE BLAST CLEANING TO ATTAIN A CONCRETE SURFACE PROFILE CSP 3-5 AS SPECIFIED BY THE INTERNATIONAL CONCRETE REPAIR AND RECONSTRUCTION CONCRETE REPAIR MANUAL. REMOVE ALL CRACKS AND OTHER DEFECTS AS RECOMMENDED BY THE MANUFACTURER.
 B. CLEAN STEEL RISERS AND NOSINGS BY WIRE BRUSH OR OTHER METHODS AS REQUIRED TO REMOVE RUST.
 C. COMPLY WITH OTHER SURFACE PREPARATION AND METHODS OF APPLICATION AS SPECIFIED BY THE MANUFACTURER.
 D. APPLY GENERAL POLYMERS 3579 PRIMER IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. ALLOW PRIMER TO BECOME TACKY BEFORE APPLYING FIRST BASE COAT.
 E. APPLY 2 COATS OF GENERAL POLYMERS 3555 EPO-FLEX HD EPOXY TO STAIR TREADS AND LANDING SURFACES. ALLOW CURING TIME BETWEEN COATS AS SPECIFIED BY THE MANUFACTURER. APPLY SECOND COAT TO ALL SURFACES. ALLOW CURING TIME BETWEEN COATS AS SPECIFIED BY THE MANUFACTURER. APPLY SECOND COAT TO ALL SURFACES. ALLOW CURING TIME BETWEEN COATS AS SPECIFIED BY THE MANUFACTURER. WET FILM THICKNESS OF 20 MILS. APPLY SECOND COAT TO A MINIMUM WET FILM THICKNESS OF 10 MILS.
 F. BROADCAST GENERAL POLYMERS 5310 GRAY SILICA SAND (30 MESH) ONTO STAIR TREADS AND LANDING SURFACES WHILE SURFACE IS WET FROM THE SECOND COAT OF EPO-FLEX HD EPOXY. APPLY AGGREGATE WITHIN 1 HOUR OF APPLICATION OF SECOND COAT OF EPO-FLEX HD EPOXY.
 G. ALLOW TO CURE 24 HOURS AND SWEEP OFF EXCESS AGGREGATE. SMOOTH HIGH SPOTS.
 H. APPLY GENERAL POLYMERS 4618 HI-SOLIDS POLYURETHANE SEAL COAT TO ALL STAIR TREADS, RISERS, AND LANDING SURFACES. ALLOW SEAL COAT TO CURE FOR 24 HOURS PRIOR TO OPENING TO TRAFFIC.

ISSUED FOR PERMITTING
07-18-07

CURRENT ISSUE STATUS:

| REV. | DESCRIPTION | DATE |
|------|-----------------------|---------|
| 0 | ISSUED FOR PERMITTING | 7-18-07 |

SM RT
 ARCHITECTURE ENGINEERING PLANNING

144 FIVE STREET P.O. BOX 618
 PORTLAND, MAINE 04104
 TEL. (207) 772-3946
 FAX. (207) 772-1070

PROJECT 1
110 FREE STREET
 LOCATION


PROJECT: SEVENTH LEVEL PARKING DECK PLAN

SHEET TITLE: PARKING DECK PLAN

SCALE: 3/32" = 1'-0" DATE: 7-02-07

PROJECT MANAGER: JLF
 JOB CHG./DRAWN: LWF
 A/E OF RECORD: MAC
 SMART CAD FILE: SF107-07087
 PRODUCT NO.: 07087

SHEET NO.
SF107

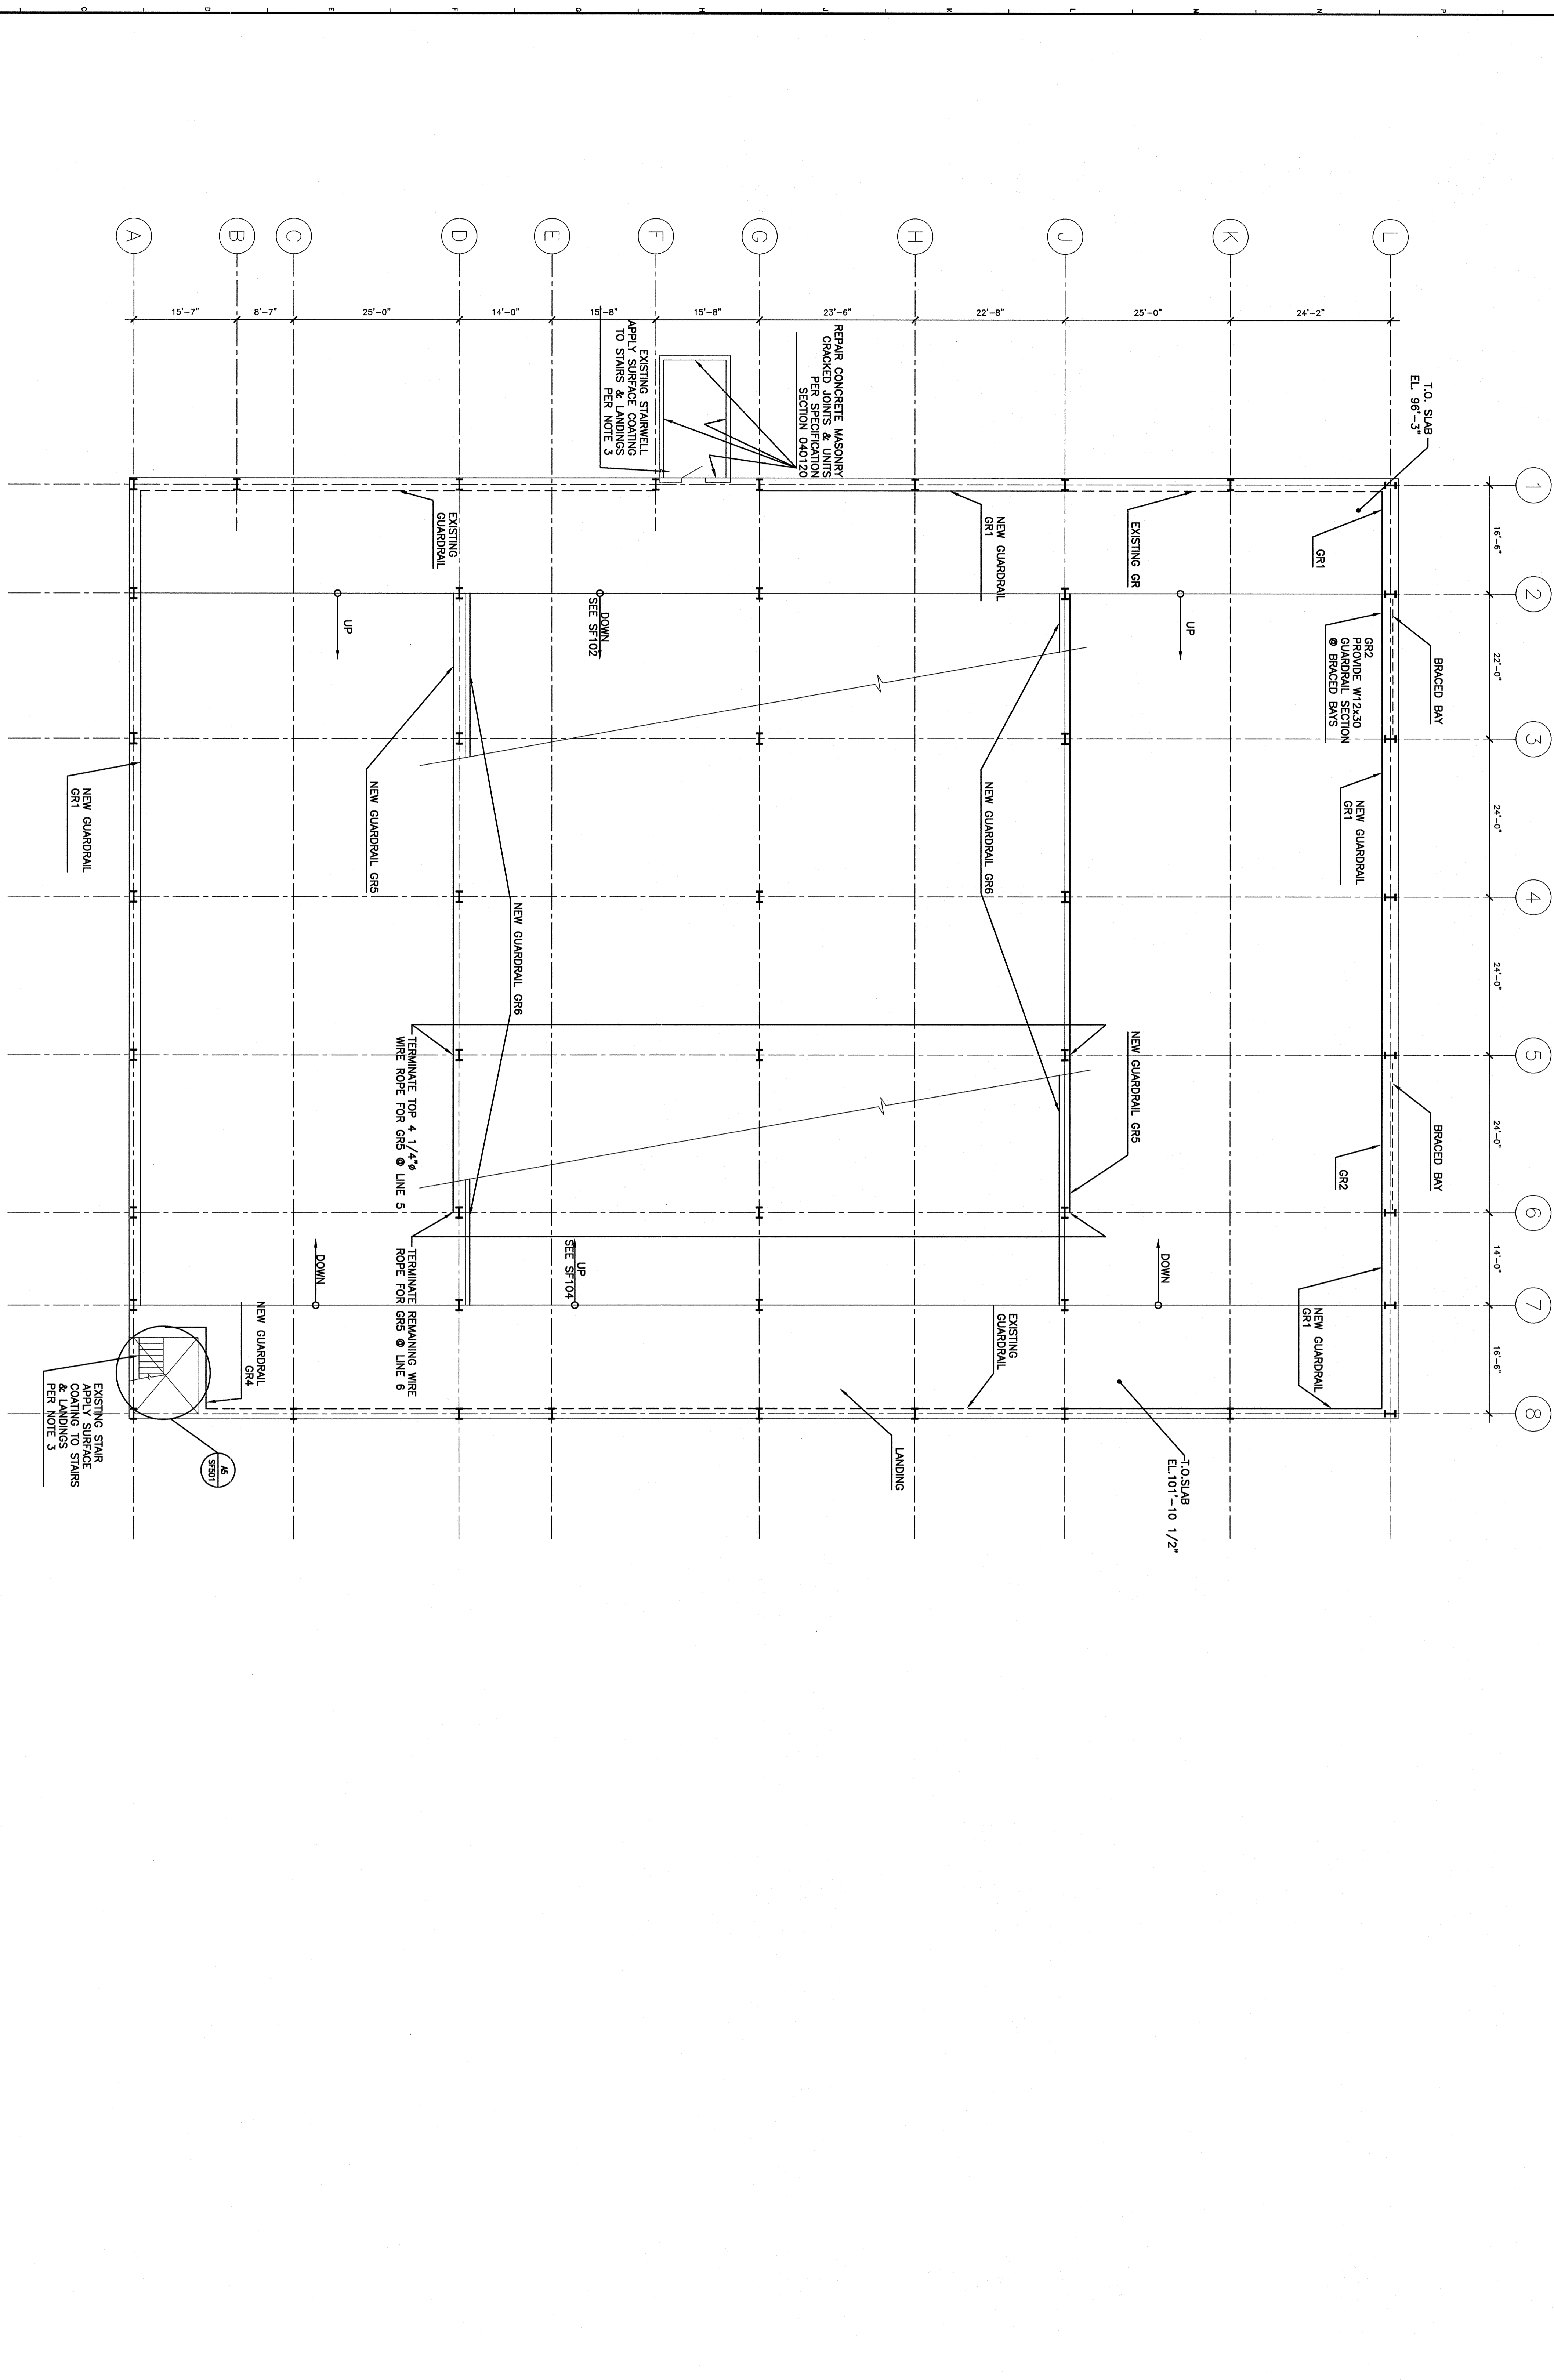

SLAB PLAN - 96'-3" TO EL. 101'-10 1/2"

| | |
|---------------|---|
| A1 | - |
| 3/32" = 1'-0" | |