


CITY OF PORTLAND  
 FIRE PREVENTION BUREAU  
 380 Congress Street, Portland, Maine 04101  
 fireprevention@portlandmaine.gov  
 (207) 874-8400

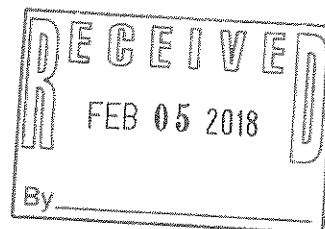

**NOTICE OF VIOLATION AND ORDER TO CORRECT**

JOHN QUIRK  
 4 SCHOONER RD  
 SCARBOROUGH ME 04074

January 16, 2018

<b>Location</b> 126 SPRING ST	<b>CBL</b> 039 D002001	<b>Inspection Date</b> 11/29/2017
<b>Inspector</b> Sean Donaghue	<b>Inspection Type</b> FP Routine Inspection	<b>Status</b> Failed

The City of Portland Fire Department inspected this property, and found the fire and life safety code violations listed below, which you are hereby ordered to correct. You must propose a date of completion to remedy each violation, a final date of completion, and a date of re-inspection.

**You must send this form to the Fire Prevention Bureau no later than 2/15/2018.**

Your failure to submit a plan of action by the date provided, or to correct any violation within the applicable time frame, may result in legal action against you, the imposition of civil penalties, and the pursuit of other legal remedies.

<b>Violation</b>	<b>Proposed Date of Completion</b>
<p><b>NFPA 101-7.2.4.3.1 FIRE BARRIER REQUIRES MAINTENANCE;</b> Fire barriers separating buildings or areas between which there are horizontal exits shall have a minimum 2-hour fire resistance rating, unless otherwise provided in 7.2.4.4.1, and shall provide a separation that is continuous to the finished grounded level.</p> <p>Basement hallway open to the backside of an interior wall of Unit 2, insulation visible, please close basement hallway in with properly rated sheetrock</p>	3/31/18
<p><b>NFPA 101- 31.3.1.1.1 VERTICAL OPENINGS NOT FIRE RATED;</b> Vertical openings shall be enclosed or protected in accordance with Section 8.6.</p> <p>Attic access in main stairwell top floor and in Unit 6 (common area and closet) needs to provide proper fire rating, currently fiberboard</p>	3/31/18
<p><b>NFPA 101- 7.2.1.8.1 FIRE DOORS MUST BE SELF- OR AUTO-CLOSING;</b> A door leaf normally required to be kept closed shall not be secured in the open position at any time and shall be self-closing or automatic-closing in accordance with 7.2.1.8.2, unless otherwise permitted by 7.2.1.8.3.</p> <p>Basement door must be properly rated fire door and must self close. A tag displaying the fire rating must be visible.</p>	— / — / — (Done)
<p><b>NFPA 101- 7.1.8 STAIR GAURDS MUST BE REPAIRED;</b> Guards in accordance with 7.2.2.4 shall be provided at the open sides of means of egress that exceed 30 inches above the floor or the finished ground level below.</p> <p>Bollisters on 3rd floor missing. Owner requested notation of Windham Millwork in this violation for possible assistance in securing matching replacements to existing bollisters</p>	<del>2/15/18</del> (Done)
<p><b>NFPA 70 MISSING BOX COVERS;</b> Refer to NFPA 70, National Electrical Code, on standards for missing box covers.</p> <p>Basement at the base of stairs</p>	— / — / — Done

Violation	Proposed Date of Completion
<b>NFPA 54 UNPROTECTED OUTSIDE GAS LINE;</b> See NFPA 54 regarding requirements for outdoor unprotected gas lines. Separation from Spring St traffic only width of sidewalk, please install bollards to protect gas main into building.	<u>2 / 16 / 18</u>
<b>FINAL DATE OF COMPLETED VIOLATION(S)</b>	<u>3 / 31 / 18</u>
<b>FIRE PREVENTION BUREAU RE-INSPECTION OF COMPLETED VIOLATION(S)</b>	<u>4 / 2 / 18</u>

The Bureau reserves the right to reject or modify any proposed plan of action, and may require evidence of sufficient financial and technical capacity to complete the proposed plan. Please contact the Bureau with any questions.

**VIOLATOR CERTIFICATION**

*I agree to remedy the violations listed within the timeframes provided. If I require additional time to comply, I understand that I must contact the Fire Prevention Bureau prior to the deadline to request an extension, which is entirely within the Bureau's discretion to grant or deny.*

*I further understand that it is my responsibility to schedule a reinspection of my property once the violations have been remedied to do so. My failure to schedule a reinspection shall be deemed an admission that the violations have not been remedied.*

*If I fail to comply with this agreement, I understand that I am liable for penalties pursuant to the City of Portland Code of Ordinances §§ 1-15 and 10-25, and 30-A M.R.S. § 4452 and may be subject to further legal action.*

1/30/18  
Date

John D. Zurb  
Responsible Party

\_\_\_\_\_  
Date

\_\_\_\_\_  
Responsible Party

**SEEN AND AGREED**

2/6/18  
Date

CAPT. [Signature]  
Fire Prevention Bureau