


| SYMBOL LEGEND |        |            |   |
|---------------|--------|------------|---|
| ITEM NO.      | SYMBOL | QTY. TOTAL | DESCRIPTION   |
| 1             | ○      | 121        | STANDARD BASE   |
| 2             | ⊠      | 8          | INTELLIGENT ZONE MODULE (HCP) - 4" SQUARE                 |
| 3             | ⊠      | 23         | MONITOR MODULE (MODEL 345) - WIRELESS BACK BOX            |
| 4             | ⊠      | 29         | PULL STATION (MODEL 310) - WIRELESS BACK BOX              |
| 5             | ⊠      | 119        | SMOKE DETECTOR (MODEL 302) - WIRELESS BACK BOX            |
| 6             | ⊠      | 2          | CARBON MONOXIDE DETECTOR (MODEL 350) - WIRELESS BACK BOX  |
| 7             | ⊠      | 8          | WP HORN/STROBE (AS-75-R-WP) - MOUNTS ON WPBBS             |
| 8             | ⊠      | 240        | LOW FREQUENCY HORN (MODEL 520W) - WIRELESS BACK BOX       |
| 9             | ⊠      | 113        | SPEAKER/STROBE (SEFH-MC-R) - 4" SQUARE W/ EXTENSION       |
| 10            | ⊠      | 8          | STROBE (ZR-MC-R) - 4" SQUARE OR SINGLE GANG               |
| 11            | ⊠      | 8          | HIGH CANDELA STROBE (ZR-HMC-R) - 4" SQUARE OR SINGLE GANG |
| 12            | ⊠      | 20         | WATER FLOW SWITCH (F.B.O)                                 |
| 13            | ⊠      | 1          | WIRED REMOTE ANN & MICROPHONE (SSD-C)                     |
| 14            | ⊠      | 1          | FIRE ALARM TERMINAL CABINET                               |
| 15            | ⊠      | 2          | WIRELESS ANNUNCIATOR (WRA-3)                              |
| 16            | ⊠      | 1          | FIRE ALARM CONTROL PANEL                                  |
| 17            | ⊠      | 8          | DESIGNATED HEARING IMPAIRED                               |

**GENERAL NOTES**

- \* INSTALLATION METHODS SHALL COMPLY WITH NFPA 72 AND THE NATIONAL ELECTRIC CODE
- \* DEVICE ADDRESSES ARE NOT SHOWN AND SHALL BE RECORDED IN THE FIELD THROUGHOUT INSTALLATION.
- \* INITIATING DEVICES IN COMMON AREAS AND SOUNDERS WITHIN GUEST SUITES SHALL BE WIRELESS.
- \* ELEVATOR RECALL & SPRINKLER MONITOR MODULES SHALL BE PERMITTED TO BE WIRED IF WIRELESS SIGNAL IS INSUFFICIENT AND WIRED OPTION PRACTICAL.
- \* LOCATIONS OF WIRELESS REPEATER(S) IS NOT SHOWN ON THE DRAWINGS. FIELD TECHNICIAN SHALL RECORD ON JOB SITE PLANS TO INCLUDE IN AS BUILT DOCUMENTS. SMOKE DETECTOR SHALL BE INSTALLED ABOVE ANY WIRELESS REPEATER.

- KEYED NOTES**
- ⚠ REPLACE EXISTING HORN/STROBE WITH NEW WEATHERPROOF DEVICE. UTILIZE EXISTING WIRING IF ACCEPTABLE BY THE NEC. EXTEND CONDUIT WHERE NECESSARY FOR NEW LOCATION(S).
  - ⚠ COORDINATE LOCATION OF WIRELESS ANNUNCIATOR WITH MAINTENANCE DIRECTOR AT TIME OF INSTALLATION
  - ⚠ DISPATCH PROCEDURE ON CO DETECTION TO BE VERIFIED WITH LOCAL FIRE DEPARTMENT
  - ⚠ SPEAKER/STROBE MAY BE RELOCATED TO CEILING MOUNT WITH APPROVAL FROM OWNER. SPACING SHALL BE VERIFIED BY ENGINEER
  - ⚠ FIELD VERIFY EXACT QUANTITY OF MONITOR MODULES & INSTALL AS NEEDED. TAMPER SWITCHES SHALL REMAIN CHAINED & LOCKED UNTIL SPRINKLER CONTRACTOR HAS INSTALLED SWITCHES CAPABLE OF BEING ELECTRONICALLY MONITORED.
  - ⚠ GARAGE LEVEL ELEVATOR LOBBY SPEAKER/STROBES SHALL BE TIED TO LOWER LEVEL ACTIVATION
  - ⚠ LOCATE WIRELESS ANNUNCIATOR & WIRED ANNUNCIATOR WITH REMOTE MICROPHONE ADJACENT TO EACH OTHER. EQUIPMENT IS TO BE LOCATED IN CLEAR VIEW OF THE MAIN ENTRANCE FOR FIRE DEPARTMENT ACCESS, BUT UNOBTUSIVE TO HOTEL STAFF.
  - ⚠ TIE WIRELESS MONITOR MODULE TO HOOD SUPPRESSION SYSTEM. RECORD FINAL LOCATION OF MODULE ON AS BUILT DOCUMENTATION
  - ⚠ INSTALL MODULES WITH PROVISIONS FOR TAMPER SWITCH TIE IN. EXISTING SWITCHES NOT COMPATIBLE WITH FIRE ALARM.
  - ⚠ HCP MODULES FOR HEARING IMPAIRED GUEST ROOM STROBES. MODULE SHALL BE LOCATED IN MAIDS CLOSET AND STROBE WIRING (1 PR.#4 FOR EACH ROOM) IS TO BE CONCEALED IN HALLWAY MOLDINGS
  - ⚠ INSTALL LISTED 24VDC POWER SUPPLY FOR HCP MODULES. POWER SUPPLY IS TO BE MINIMUM 1.5A AND CAN SERVE BOTH HCP MODULES PER FLOOR

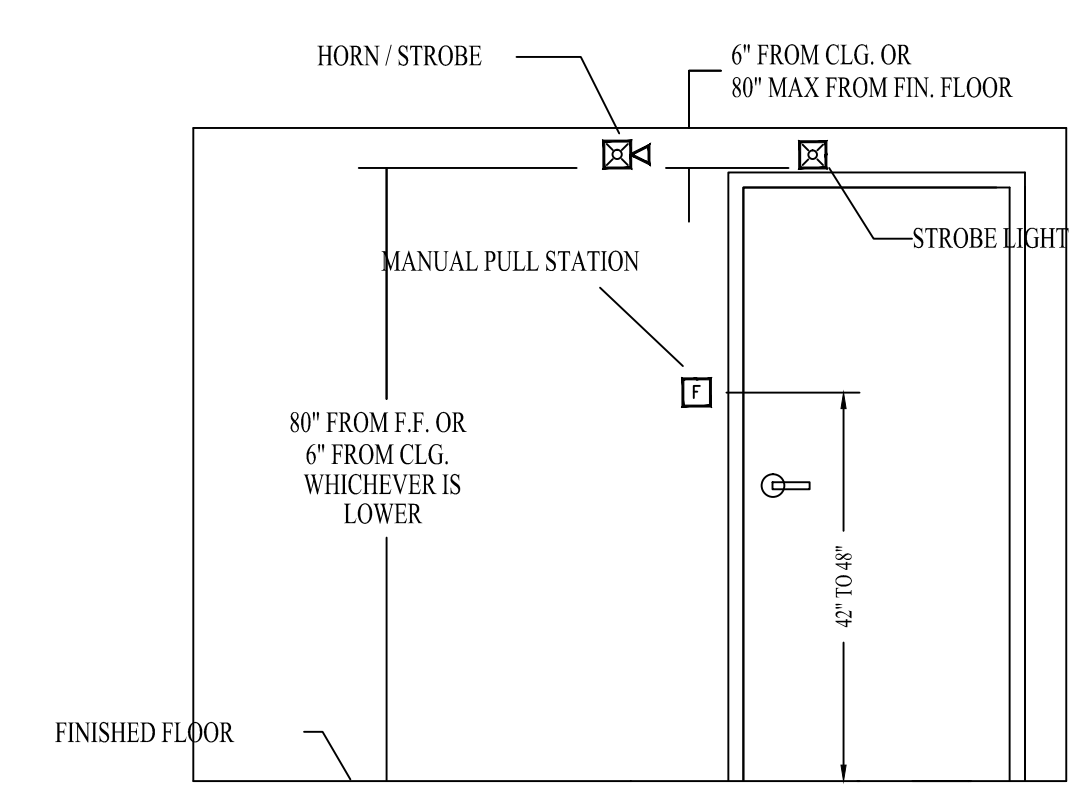

DEVICE ELEVATION DETAIL  
NOT TO SCALE



FIRE ALARM SYSTEM LAYOUT - GROUND LEVEL  
SCALE: 1/8" = 1'

| GENERAL NOTES | DATE    | REVISIONS                     | REQUIRED APPROVALS                                   | HOLIDAY INN<br>BY THE BAY<br>88 SPRING ST<br>PORTLAND, ME                                     | FIRE ALARM SYSTEM<br>GROUND LEVEL<br>PLANS & DETAILS |
|---------------|---------|-------------------------------|--|---|--|
|               | 2-19-16 | SUBMITTED FOR APPROVAL BY PFD | OWNER<br>STATE FIRE MARSHAL<br>LOCAL FIRE DEPARTMENT |   | DWG. NO.<br>FA-4                                     |
|               |         |                               | DRAWN BY CRM   | CONTRACT WITH: OWNER  | JOB NUMBER<br>3062                                   |
|               |         |                               | CHECKED BY BWB                                       | <b>EASTERN FIRE SERVICES, INC.</b><br>AUBURN/LEWISTON INDUSTRIAL AIRPARK, AUBURN, MAINE 04210 | SCALE<br>AS SHOWN                                    |
|               |         |                               | CONTRACTOR LICENSE #                                 |   | DATE<br>1/14/16                                      |