




PROPOSED PROJECT VIEW

DOOR SCHEDULE									
DOOR #	FROM	TO	SIZE	DOOR MATERIAL	DOOR TYPE	DOOR RATING	FRAME	HARDWARE SET	NOTES
101	OUTSIDE	OFFICE	9'-0" X 7'-0"	GLAZED	FR	-	AL	01	1,2,3
102	OFFICE	OUTSIDE	3'-0" X 7'-0"	GLAZED	A	-	WOOD	01	1,2,3
103	OFFICE	TOILET	3'-0" X 7'-0"	WOOD	PD	-	WOOD	02	1,3

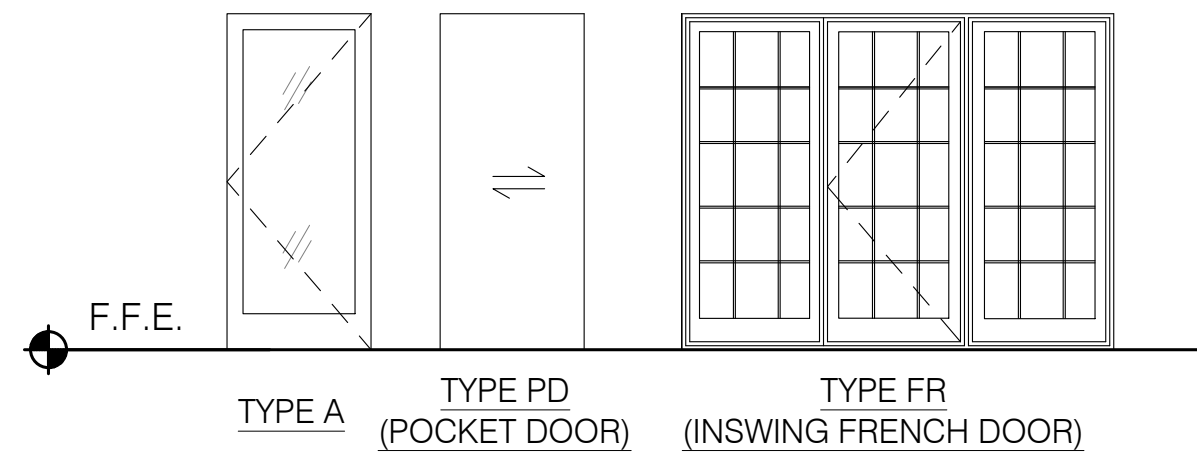

GENERAL DOOR SCHEDULE NOTES:

- COORDINATE DOOR HARDWARE FINISHES AND DESIGNS WITH OWNER.
- GLAZING TO BE TEMPERED SAFETY GLASS.
- FIELD VERIFY SIZE OF EXISTING OPENING.

HARDWARE SETS:

- 01 EXIT DOOR: (3) CLEAR OFFSET HINGES, CLOSER, STRIKE, LATCH ASSEMBLY, LOCKSET, ADA THRESHOLD, DOOR PULL, PANIC BAR EXIT.
- 02 BATHROOM POCKET DOOR: ALUMINUM TRACK, TRACK HANGER, DOOR GUIDE, PRIVACY LATCH.

GRAPHIC DESCRIPTION		DESCRIPTION			
		<ol style="list-style-type: none"> 5/8" TYPE "X" GYPSUM BOARD FASTENED IN ACCORDANCE WITH UL ASSEMBLY. 2X4 WOOD STUDS @ 16" O.C. 5/8" GYPSUM BOARD FASTENED IN ACCORDANCE WITH UL ASSEMBLY. 			
		NOTES: <ul style="list-style-type: none"> PROVIDE MOISTURE RESISTANT GWB AT BATHROOMS. 			
TYPE	FIRE RATING	UL NUMBER	STC RATING	R-VALUE	
W1	N/A	N/A	N/A	N/A	

GRAPHIC DESCRIPTION		DESCRIPTION			
		<ol style="list-style-type: none"> EXISTING STRUCTURAL BRICK MASONRY 2" HIGH DENSITY SPRAY FOAM INSULATION FRICTION FIT BETWEEN STUDS R-19 UNFACED FIBERGLASS INSULATION BATTS MEASURING 3" THK. 2X4 WOOD STUDS @ 16" O.C. 5/8" TYPE "X" GYPSUM BOARD FASTENED IN ACCORDANCE WITH UL ASSEMBLY. 			
		NOTES: <ul style="list-style-type: none"> PROVIDE MOISTURE RESISTANT GWB AT BATHROOMS. 			
TYPE	FIRE RATING	UL NUMBER	STC RATING	R-VALUE	
W2	1HR	-	N/A	22.498	

GRAPHIC DESCRIPTION		DESCRIPTION			
		<ol style="list-style-type: none"> EXISTING ASPHALT ARCHITECTURAL SHINGLES EXISTING ROOFING UNDERLAYMENT EXISTING SHEATHING. EXISTING WOOD JOISTS 4" XPS INSULATION (R-20) TO THE UNDERSIDE OF TRUSS WITH TAPED JOINTS FASTENED TO TRUSS. 1"X3" FURRING. 5/8" GYPSUM BOARD (PAINTED) FASTENED TO FURRING 			
TYPE	FIRE RATING	UL NUMBER	STC RATING	R-VALUE	
R1	N/A	N/A	N/A	20	