NOTES:
1. VERIFY EXACT LOCATION OF MECHANICAL EQUIPMENT PRIOR TO ROUGH-IN.
2. PROVIDE A WEATHERPROOF, GFIC RECEPTACLE AT EF-1 AND SF-1. CIRCUIT TO PANEL HP1 #33.

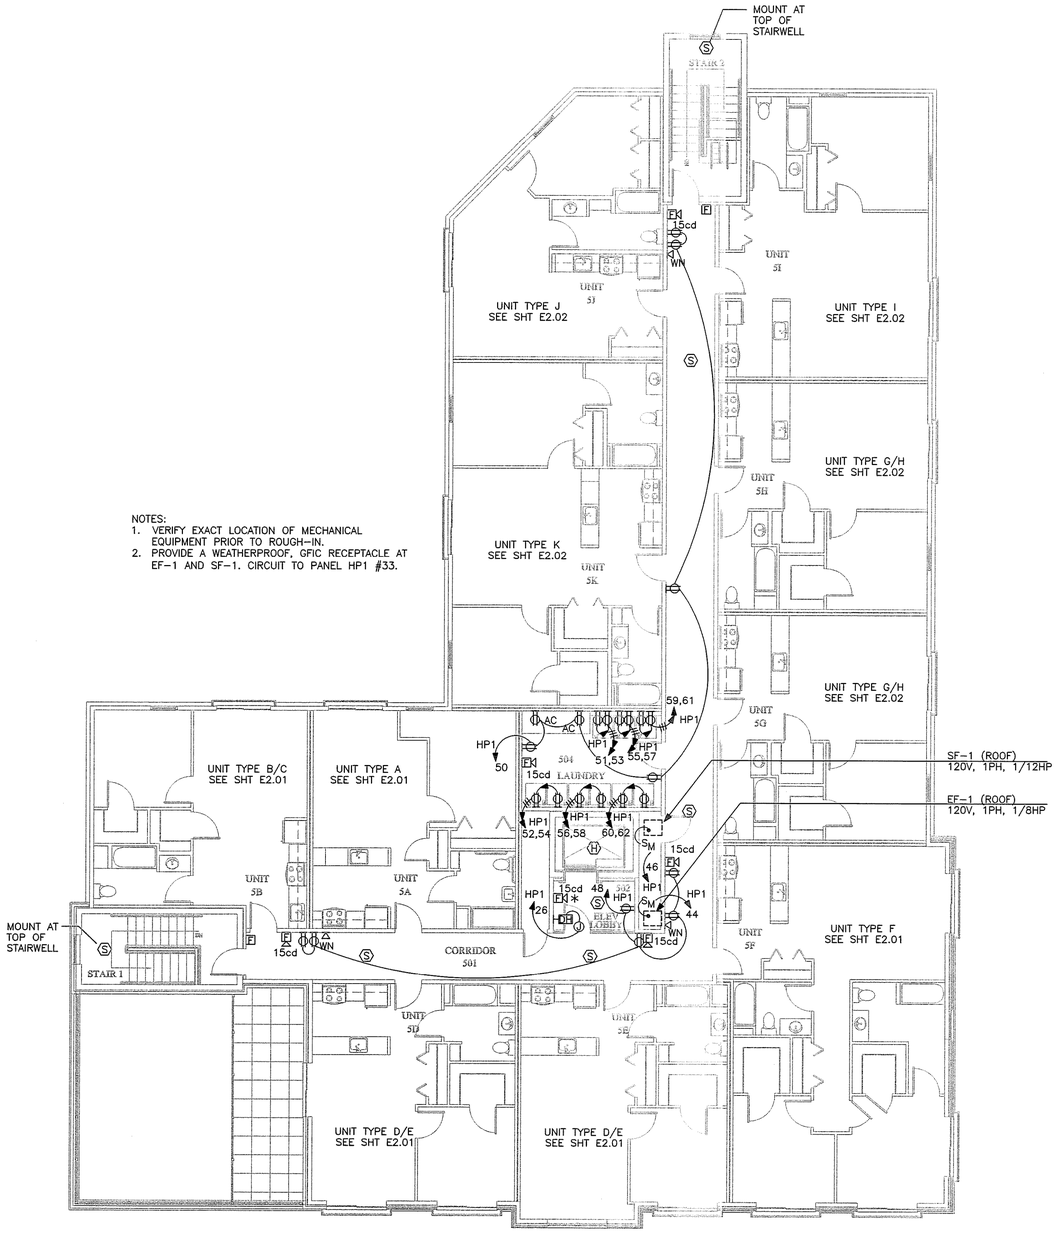

FIFTH FLOOR POWER PLAN
1/8" = 1'-0"

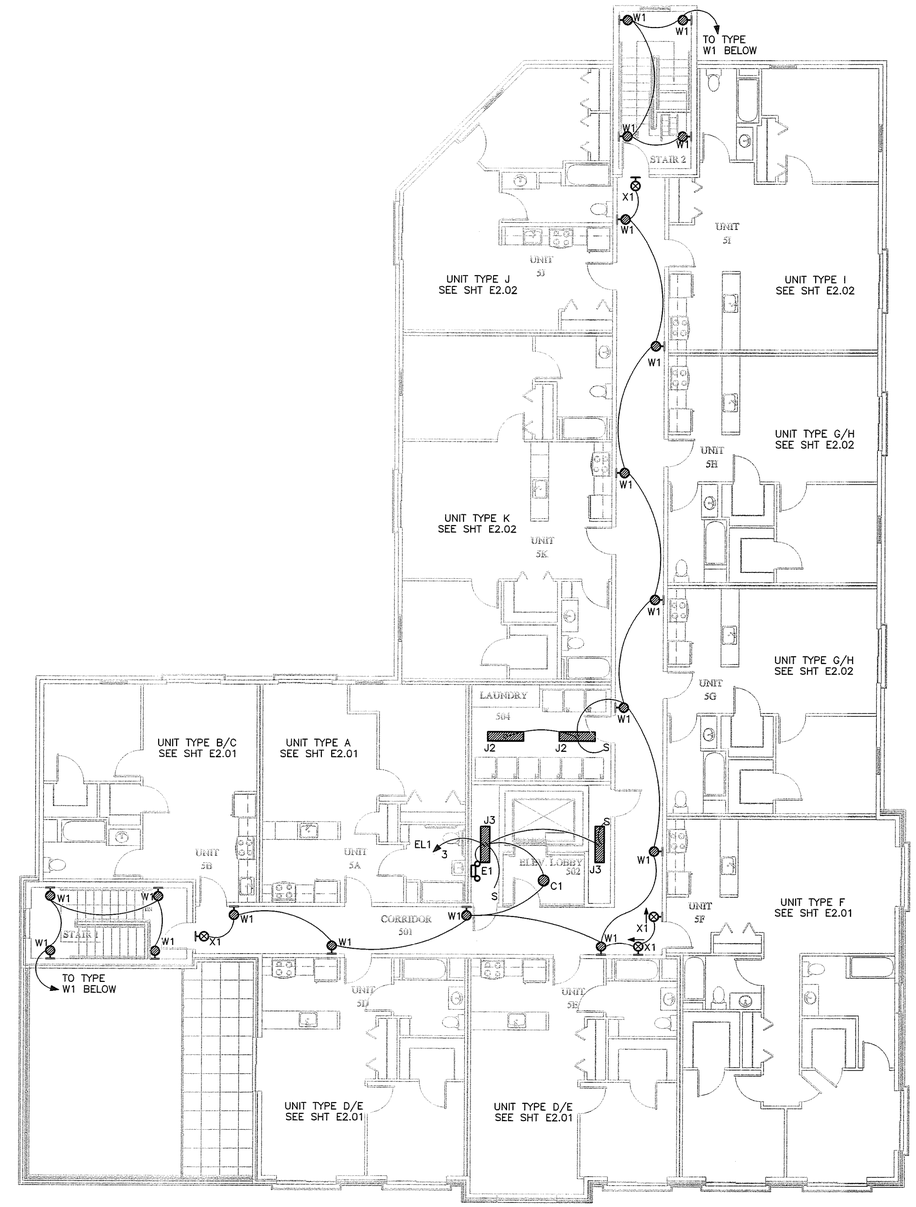

FIFTH FLOOR LIGHTING PLAN
1/8" = 1'-0"

STATE OF MAINE
LAWRENCE E. BARTLETT
No. 7928
LICENSED
PROFESSIONAL ENGINEER
Lawrence E. Bartlett

OWNER:

ARCHETYPE, P.A.
ARCHITECTS
48 Union Wharf Portland, Maine 04101
(207) 772-6022 Fax (207) 772-4056

Project: 53 DANFORTH STREET
53 DANFORTH STREET
PORTLAND, ME

Scale 1/8" = 1'-0"

Date 15 JULY 2008

100% CONST DOCS

FIFTH FL POWER & LIGHTING PLANS

E1.05