


PROJECT NAME & OWNER

Mixed Use Development

York & High Street
 Portland, ME 04102

OWNER ADDRESS

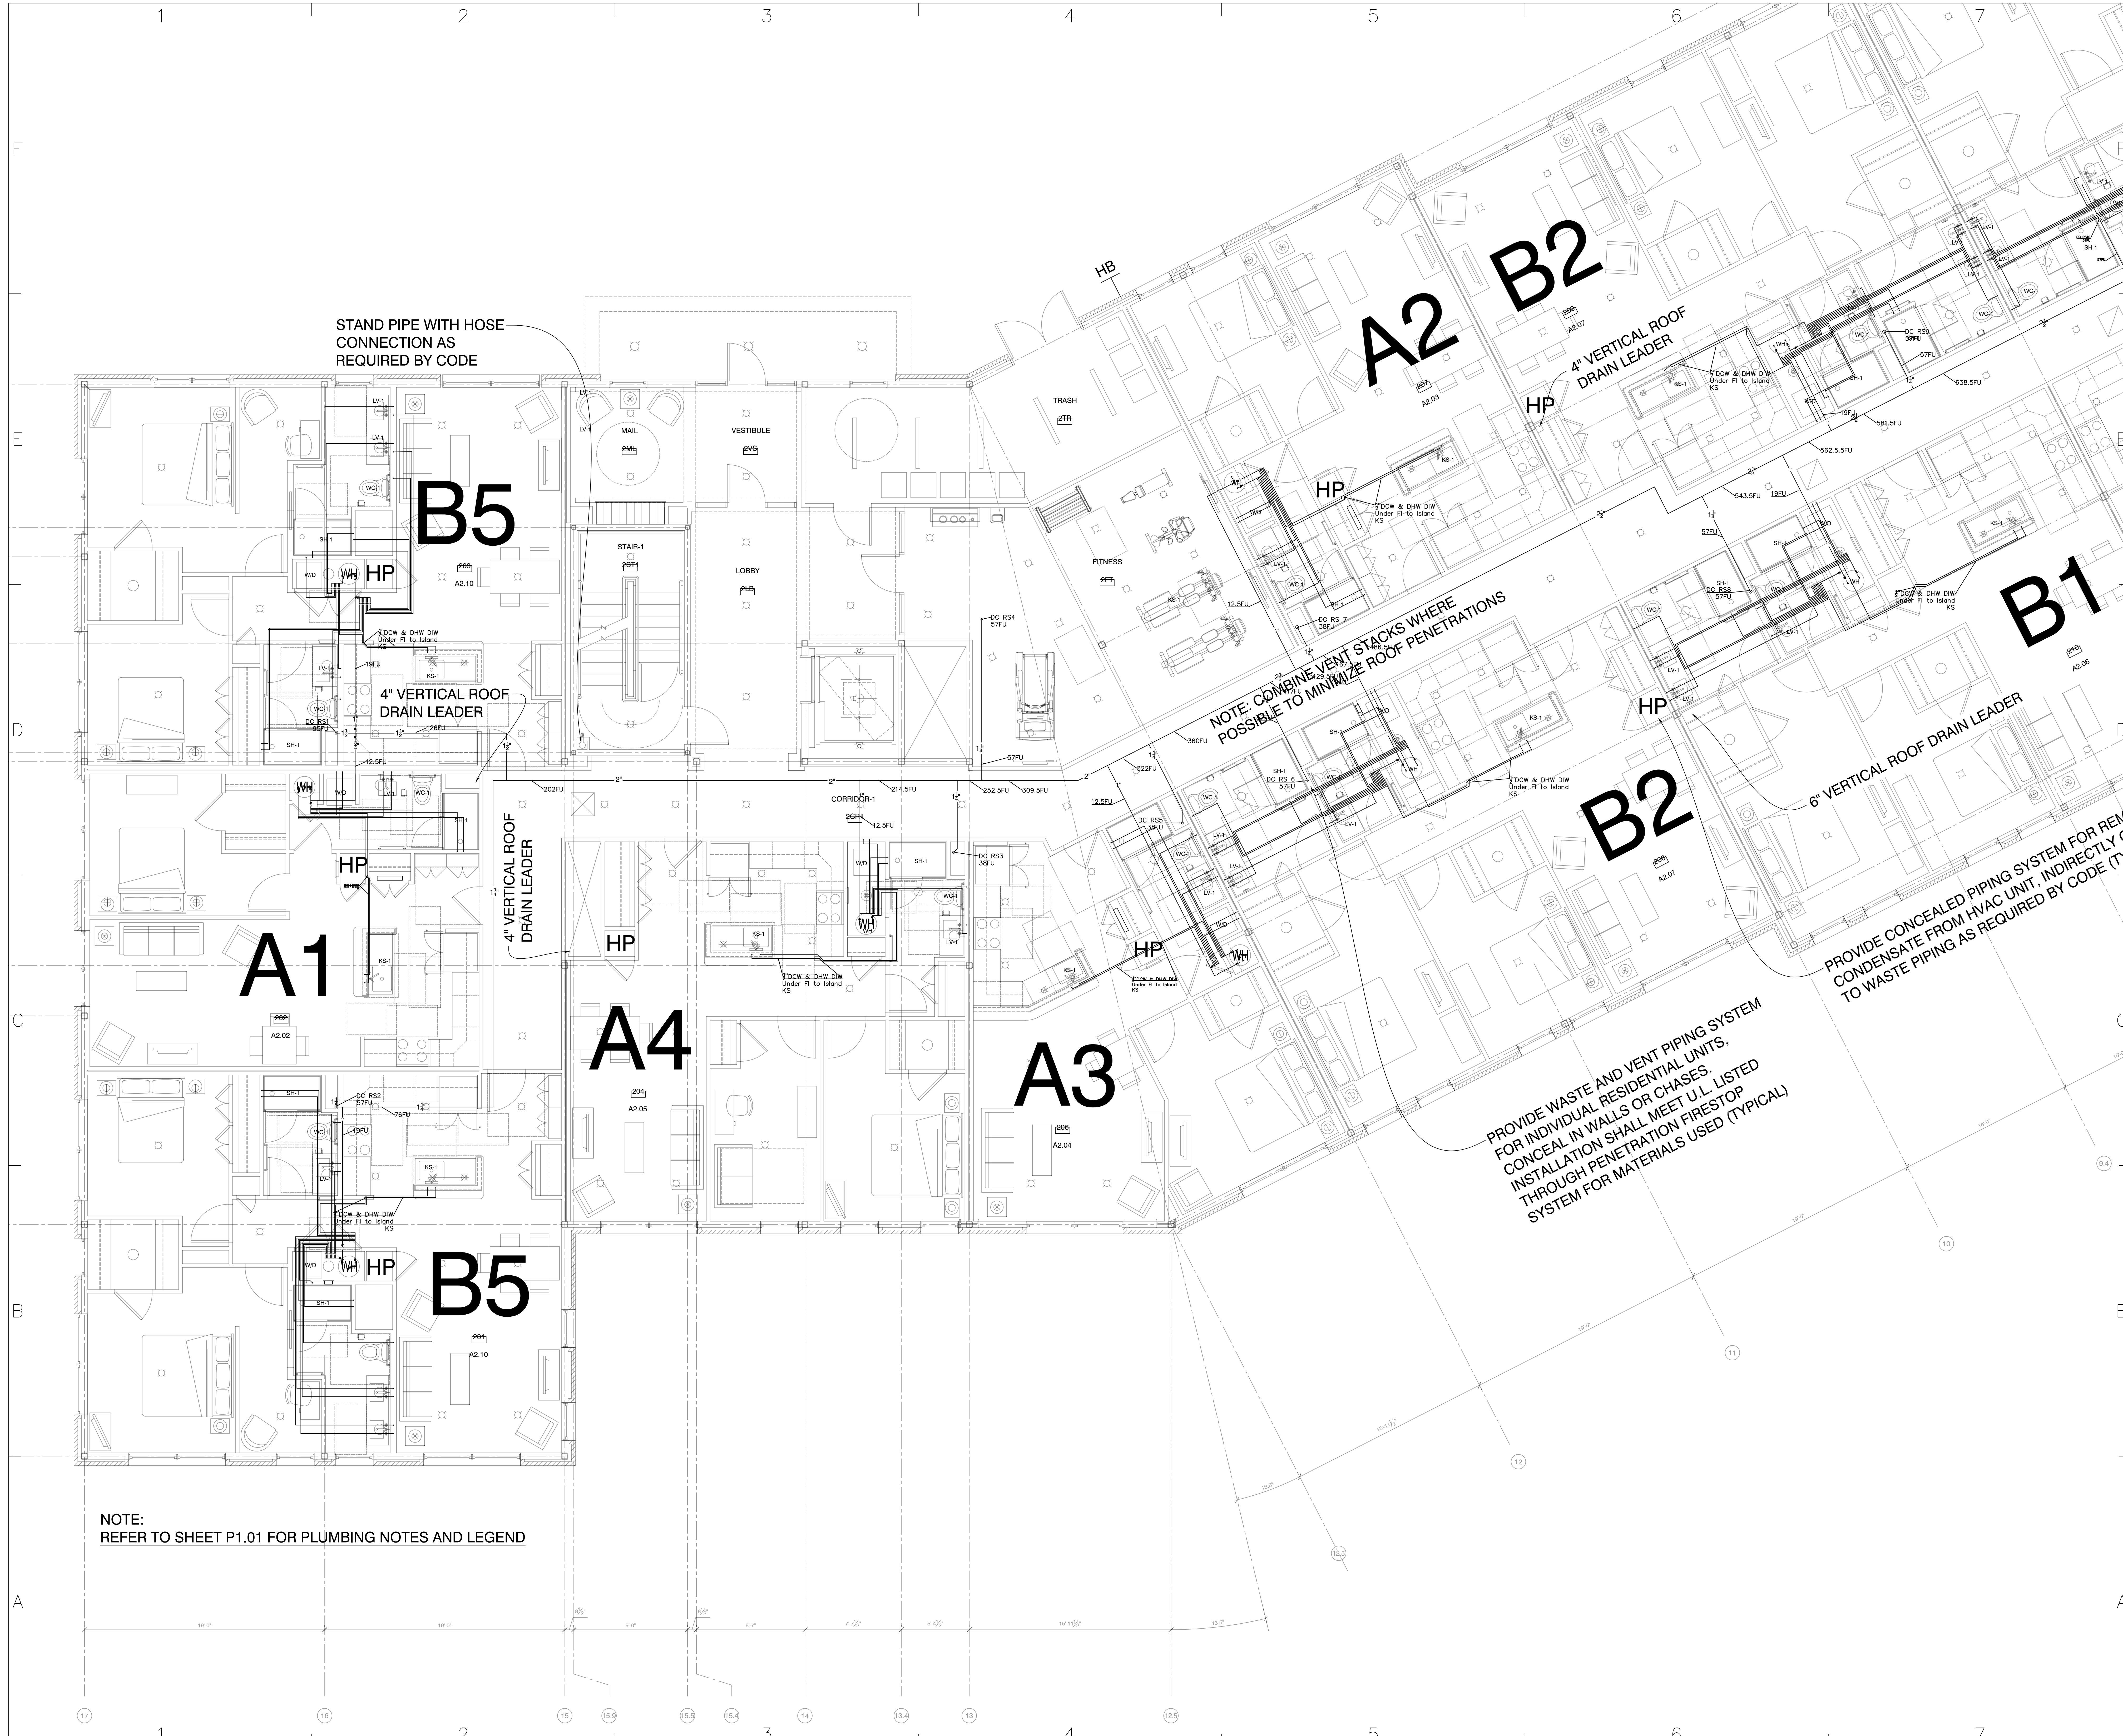

STAND PIPE WITH HOSE CONNECTION AS REQUIRED BY CODE

NOTE: COMBINE VENT STACKS WHERE POSSIBLE TO MINIMIZE ROOF PENETRATIONS

PROVIDE WASTE AND VENT PIPING SYSTEM FOR INDIVIDUAL RESIDENTIAL UNITS. CONCEAL IN WALLS OR CHASES. INSTALLATION SHALL MEET U.L. LISTED THROUGH PENETRATION FIRESTOP SYSTEM FOR MATERIALS USED (TYPICAL)

PROVIDE CONCEALED PIPING SYSTEM FOR REMOVE CONDENSATE FROM HVAC UNIT, INDIRECTLY CONNECT TO WASTE PIPING AS REQUIRED BY CODE (TYPICAL)

NOTE:
 REFER TO SHEET P1.01 FOR PLUMBING NOTES AND LEGEND

REVISION	DATE	DESCRIPTION

PROJECT NO: 1605
 DCD DWG FILE: RM P1.02 Second Level Plumbing Plan 07-13-16.dwg
 DRAWN BY: RS
 CHK'D BY: WFS
 COPYRIGHT:

SHEET TITLE
2nd Floor Domestic

P1.02B
 SHEET 1 OF 1