
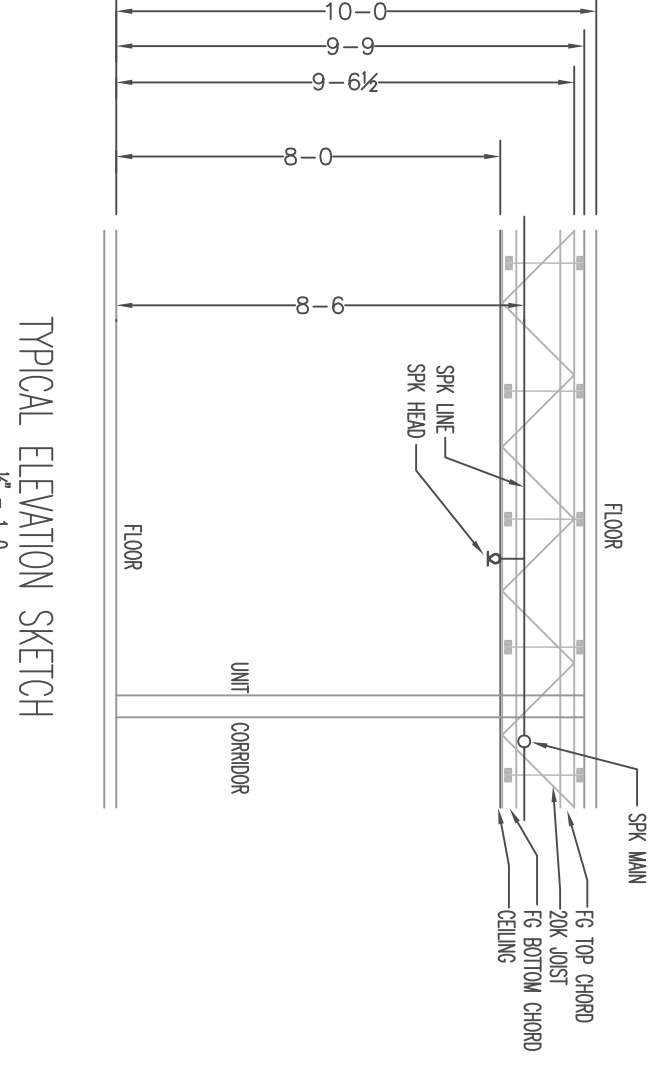


NOTE: SEE S. 500 ON S.H. 100K OF SHEET 7
 UNIT CEILING HEIGHTS ARE AS SHOWN ON S.H. 100K OF SHEET 7
 SPRINKLERS ARE SET FROM CEILING HEIGHTS AS SHOWN ON S.H. 100K OF SHEET 7
 FIRE PROTECTION SYMBOLS ARE AS SHOWN ON S.H. 100K OF SHEET 7
 SEE S. 100K ON S.H. 100K OF SHEET 7



UNIT CEILING HEIGHTS ARE AS SHOWN ON S.H. 100K OF SHEET 7
 COMMON AREA CEILING HEIGHTS ARE AS SHOWN ON S.H. 100K OF SHEET 7
 SEE S. 100K ON S.H. 100K OF SHEET 7
 SPRINKLERS ARE SET FROM CEILING HEIGHTS AS SHOWN ON S.H. 100K OF SHEET 7

2ND LEVEL PLAN

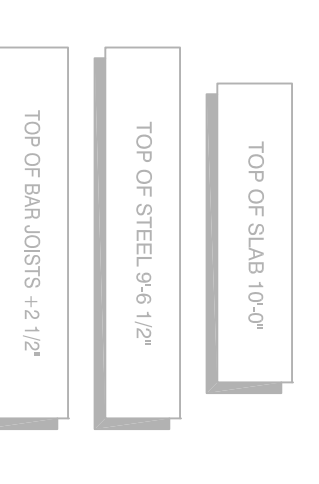

PLANS PREPARED BY:
 BRIAN BENNETT
 NICET LEVEL 3 CERT. #075934

THESE PLANS ARE SUBJECT TO MINOR
 DEVIATIONS, DUE TO COORDINATION AND/OR
 FIELD CONDITIONS, NOT AFFECTING SCOPE OF
 WORK OR CODE COMPLIANCE.

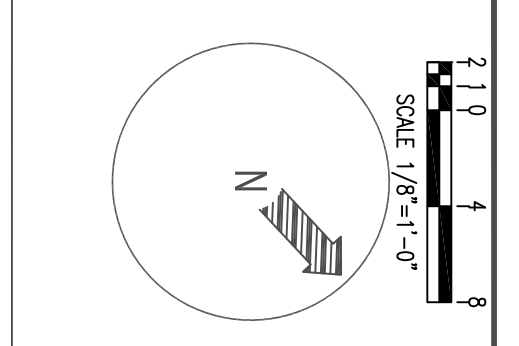

Hampshire
 FIRE PROTECTION
 8 NORTH WENTWORTH AVENUE, LONDONDERRY, NH 03053
 PH: (603) 432-8221 FAX: (603) 434-3194
 WEBSITE: HAMPSHIRE.FIRE.COM
 MASS VERMONT CERTIFIED

WATER SUPPLY DATA

Static pressure	100	psi
Residual pressure	90	psi
Location	1007	SPN
Elevation	310.00'	
Date	2/13/16	Time 10:AM
Information by	Pauline Winer Dept. Maine Dept.	

SPRINKLERS

Total This Sheet	237
Description	FROM THIS JOB SEE SHEET 1
Quantity	237
Material	RELIABLE ESTATE CONCEALED PEND (1/2\"/>

Sheet 5, 3rd Level

Drawing	4830CHE
Contract No.	4830CHE
Drawn By	BENNETT
Scale	1/8\"/>
Date	02/17/16
Approved by	Pauline Winer Dept.
Checked by	ME SPNCO

Project:
 York Street
 101 York Street
 Portland, ME 04101

Contract with:
 Openbee Construction
 11 Corporate Drive
 Bethel, NH 03220

FIRE PROTECTION ENGINEERS STAMP