

DISPLAY THIS CARD ON PRINCIPAL FRONTAGE OF WORK



CITY OF PORTLAND

BUILDING PERMIT

This is to certify that Fire Safe Equipment
of PO Box 1355, Auburn, ME 04211

For installation at 101 YORK ST
El Ravo

Job ID: 2011-11-2700-FAFS


CBL: 040- C-022-001

has permission to install hood suppression system

provided that the person or persons, firm or corporation accepting this permit shall comply with all of the provisions of the Statues of Maine and of the Ordinances of the City of Portland regulating the construction, maintenance and use of the buildings and structures, and of the application on file in the department.

Notification of inspection and written permission procured before this building or part thereof is lathed or otherwise closed-in. 48 HOUR NOTICE IS REQUIRED.

A final inspection must be completed by owner before this building or part thereof is occupied. If a certificate of occupancy is required, it must be


Fire Prevention Officer

(58)

Code Enforcement Officer / Plan Reviewer

**THIS CARD MUST BE POSTED ON THE STREET SIDE OF THE PROPERTY
PENALTY FOR REMOVING THIS CARD**

BUILDING PERMIT INSPECTION PROCEDURES

Please call 874-8703 or 874-8693 (ONLY)

or email: buildinginspections@portlandmaine.gov

With the issuance of this permit, the owner, builder or their designee is required to provide adequate notice to the city of Portland Inspections Services for the following inspections. Appointments must be requested 48 to 72 hours in advance of the required inspection. The inspection date will need to be confirmed by this office.

- **Please read the conditions of approval that is attached to this permit!! Contact this office if you have any questions.**
- **Permits expire in 6 months. If the project is not started or ceases for 6 months.**
- **If the inspection requirements are not followed as stated below additional fees may be incurred due to the issuance of a "Stop Work Order" and subsequent release to continue.**

Final Fire

The project cannot move to the next phase prior to the required inspection and approval to continue, REGARDLESS OF THE NOTICE OF CIRCUMSTANCES.

IF THE PERMIT REQUIRES A CERTIFICATE OF OCCUPANCY, IT MUST BE PAID FOR AND ISSUED TO THE OWNER OR DESIGNEE BEFORE THE SPACE MAY BE OCCUPIED.



PORTLAND MAINE

Strengthening a Remarkable City, Building a Community for Life • www.portlandmaine.gov

Director of Planning and Urban Development
Penny St. Louis

Job ID: 2011-11-2700-FAFS
install hood suppression system

For installation at:
101 YORK ST
El Rayo

CBL: 040- C-022-001

Conditions of Approval:

Fire

Hood suppression system shall comply with NFPA 17A, 96, and UL 300. Activation of the suppression system shall activate the fire alarm system if available. A letter of compliance will be required at the time of final inspection stating: the date the system was tested for operation, fuel gas shut off, and fire alarm connection if applicable. The Class K fire extinguisher and proper signage should be located at the suppression system pull station.



CITY OF PORTLAND, MAINE

Department of Building Inspections

Original Receipt

Oct. 27 2011

Received from Joe H. H.

Location of Work 101 York St

Cost of Construction \$ _____ Building Fee: _____

Permit Fee \$ _____ Site Fee: _____

Certificate of Occupancy Fee: _____

Total: _____

Building (1L) _____ Plumbing (1S) _____ Electrical (1E) _____ Site Plan (U2) _____

Other Final Building Approval

CBL: 040 C 092 001

Check #: 11328 **Total Collected \$** 10.00

**No work is to be started until permit issued.
Please keep original receipt for your records.**

Taken by: [Signature]

WHITE - Applicant's Copy
YELLOW - Office Copy
PINK - Permit Copy

B-3/B-1

2011-11-2700



Non-Water-Based Fire Suppression System Permit

If you or the property owner owes real estate or property taxes or user charges on any property within the city, payment arrangements must be made before permits of any kind are accepted.

Installation address: 101 York Street CBL: 040 C02200/

Exact location: (within structure) 101 York Street, Portland, Me

Type of occupancy(s) (NFPA & ICC): Restaurant

Building owner: _____

Managing Supervisor: Ability Equipment License No: _____

Supervisor phone: 207-283-8008 E-mail: _____

Installing contractor: Foreage Equipment License No: _____

Contractor phone: 207-684-7535 E-mail: dchambers@fire-safe.com

The suppression work to be done will be: New: Renovation: Addition to existing system:

This is an amendment to an existing permit: Yes: NO Permit no: _____

System Type: Wet Chemical

NFPA Standard: 96 Edition: _____

*Non-NFPA systems are not approved for use within the City of Portland.

Download a new copy of this document from www.portlandmaine.gov/fire for every submittal. Attach all working documents as required on electronic PDF's in addition to full sized plans.

COST OF WORK: \$2300^u

PERMIT FEE: \$40
(\$10 PER \$1,000 + \$30 FOR THE FIRST \$1,000)

RECEIVED

OCT 25 2011

Dept. of Building Inspections
City of Portland Maine


RECEIVED 11-17-11

Submit all information to the Building Inspections Department, 389 Congress Street, Room 315, Portland, Maine 04101.

Prior to acceptance of any fire protection system, a complete commissioning and acceptance test must be coordinated with all fire system contractors and the Fire Department, and proper documentation of such test(s) provided.

All installation(s) must comply with NFPA and the Fire Department Technical Standard(s).

Applicant signature: Joe Hatch Date: 10/25/11

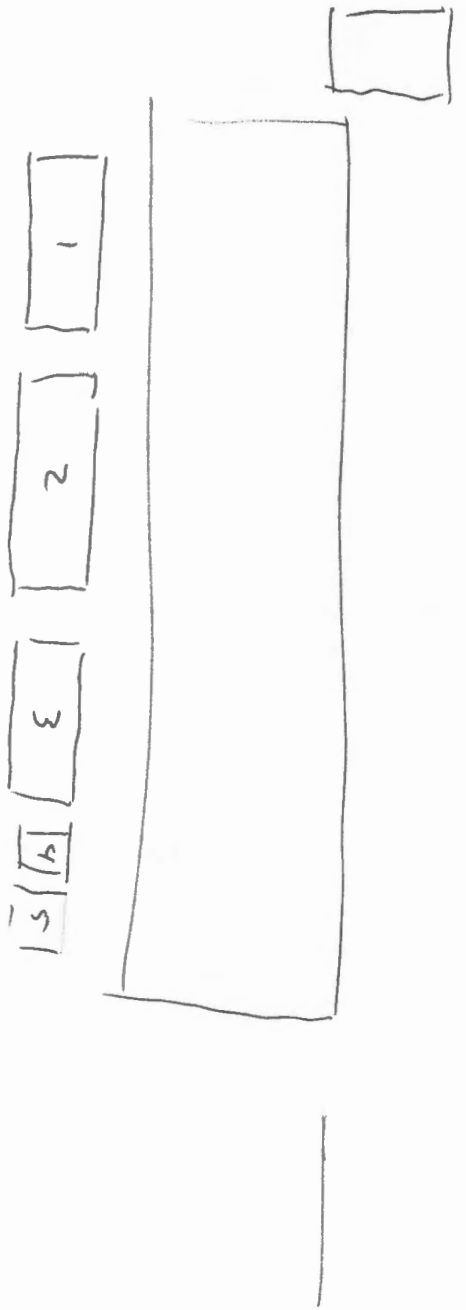

1 - G Burner + Grill

2 - TILT SKILLET

3 Char Broiler

4 Fry

5 Fry