


NOTE: JOIST MANUFACTURER MAY REQUEST GIRDER JOIST LOAD PROFILES IF DESIGNATION SHOWN ON THESE DRAWINGS CANNOT BE ACHIEVED

MARK	DESIGNATION
C1	HSS 6x6x5/8"
C2	HSS 6x6x1/2"
C3	HSS 6x6x3/8"
C4	HSS 6x6x5/16"
C5	HSS 6x6x1/4"
C6	HSS 6x6x3/16"
C7	HSS 10x6x1/4"

TOP OF SLAB 124'-0"
 TOP OF STEEL 123'-4" U.N.O.
 TOP OF JOISTS +5"
 TOP OF GIRDERS +2 1/2"

FLOOR COMPOSITION: 3" OF 3,000 PSI NORMAL WEIGHT CONCRETE ON 1" 24 GA. GALV. FORMDECK. REINFORCE CONCRETE WITH 6x6-W2.1X2.1 WWM LOCATED 1" DOWN FROM TOP OF SLAB.

REIN. 5" CONC. DECK W/ 3" VLI16 COMPOSITE DECK

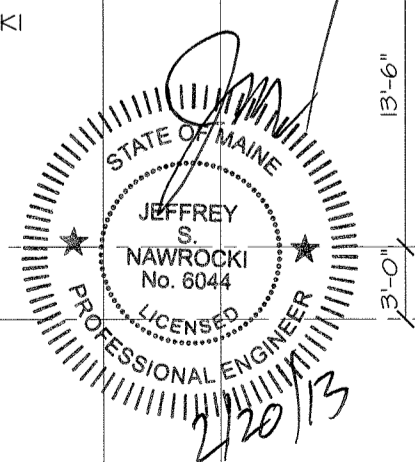

REVISION SCHEDULE	
DATE	REVISION DESCRIPTION
01-30-13	UPDATE FLOOR FRAMING AND REVISE TITLE BLOCK
02-16-13	UPDATE FLOOR FRAMING PER LATESAL FRAMING CHANGES
02-20-13	PERMIT

COPECHED
 CONSTRUCTION CORPORATION
 11 CORPORATE DRIVE, BELMONT NH 03220
 PHONE (603) 327-9090 FAX (603) 327-9191

THIRD FLOOR FRAMING PLAN

PROJECT: COMMERCIAL & MAPLE STREET MIXED USE DEVELOPMENT PORTLAND, ME.

DATE: 02-20-13
 SCALE: 1/8" = 1'-0"
 DRAWN BY: E.L.
 SHEET: