


Project Name PORTLAND ME - MARRIOTT COURTYARD - 321 COMMERCIAL STREET - CONSTRUCTION MATERIALS TESTING  
 Client J.B. BROWN & SONS  
 Material Type STRUCTURAL FILL  
 Material Source GSG - PHINNEY PIT


Project Number 08-0494.2  
 Lab ID 16607G  
 Date Received 3/13/2013  
 Date Completed 3/14/2013  
 Tested By JUSTIN BISSON

<u>STANDARD</u> <u>DESIGNATION (mm/μm)</u>	<u>SIEVE SIZE</u>	<u>AMOUNT PASSING (%)</u>	<u>STRUCTURAL FILL</u> <u>SPECIFICATIONS (%)</u>
150 mm	6"	100	
125 mm	5"	100	
100 mm	4"	97	100 †
75 mm	3"	95	90 - 100
50 mm	2"	90	
38.1 mm	1-1/2"	86	
25.0 mm	1"	82	
19.0 mm	3/4"	78	
12.5 mm	1/2"	72	
6.3 mm	1/4"	64	25 - 90
4.75 mm	No. 4	62	
2.00 mm	No. 10	54	
850 μm	No. 20	38	
425 μm	No. 40	19	0 - 30
250 μm	No. 60	10	
150 μm	No. 100	6	
75 μm	No. 200	3.2	0.0 - 5.0

† SAMPLE DOES NOT MEET SPECIFICATION

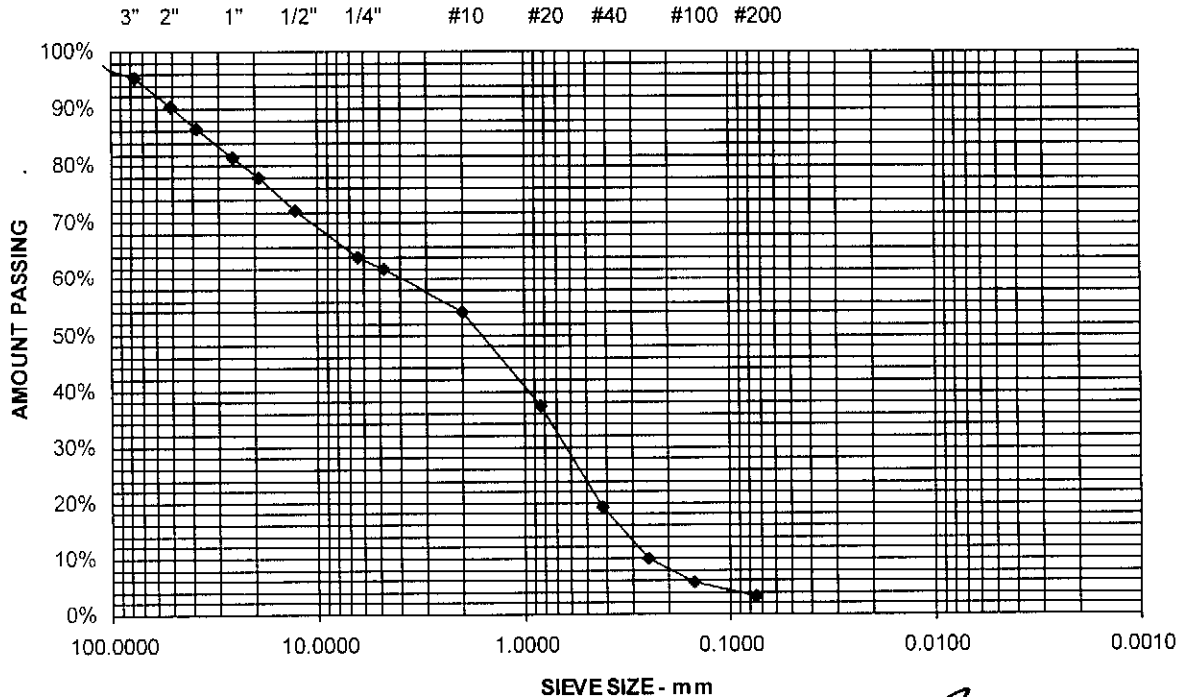

Comments

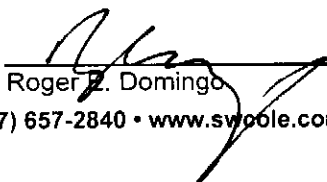  
 Roger E. Domingo