


Report of Moisture-Density

Method ASTM D-1557 MODIFIED Procedure C

Project Name	PORTLAND ME - MARRIOTT COURTYARD - 321 COMMERCIAL STREET - CONSTRUCTION MATERIALS TESTING	Project Number	08-0494.2
Client	J.B. BROWN & SONS	Lab ID	16652G
Material Type	STRUCTURAL FILL	Date Received	3/27/2013
Material Source	GSG - PHINNEY PIT	Date Completed	3/28/2013
		Tested By	JUSTIN BISSON

Moisture-Density Relationship Curve

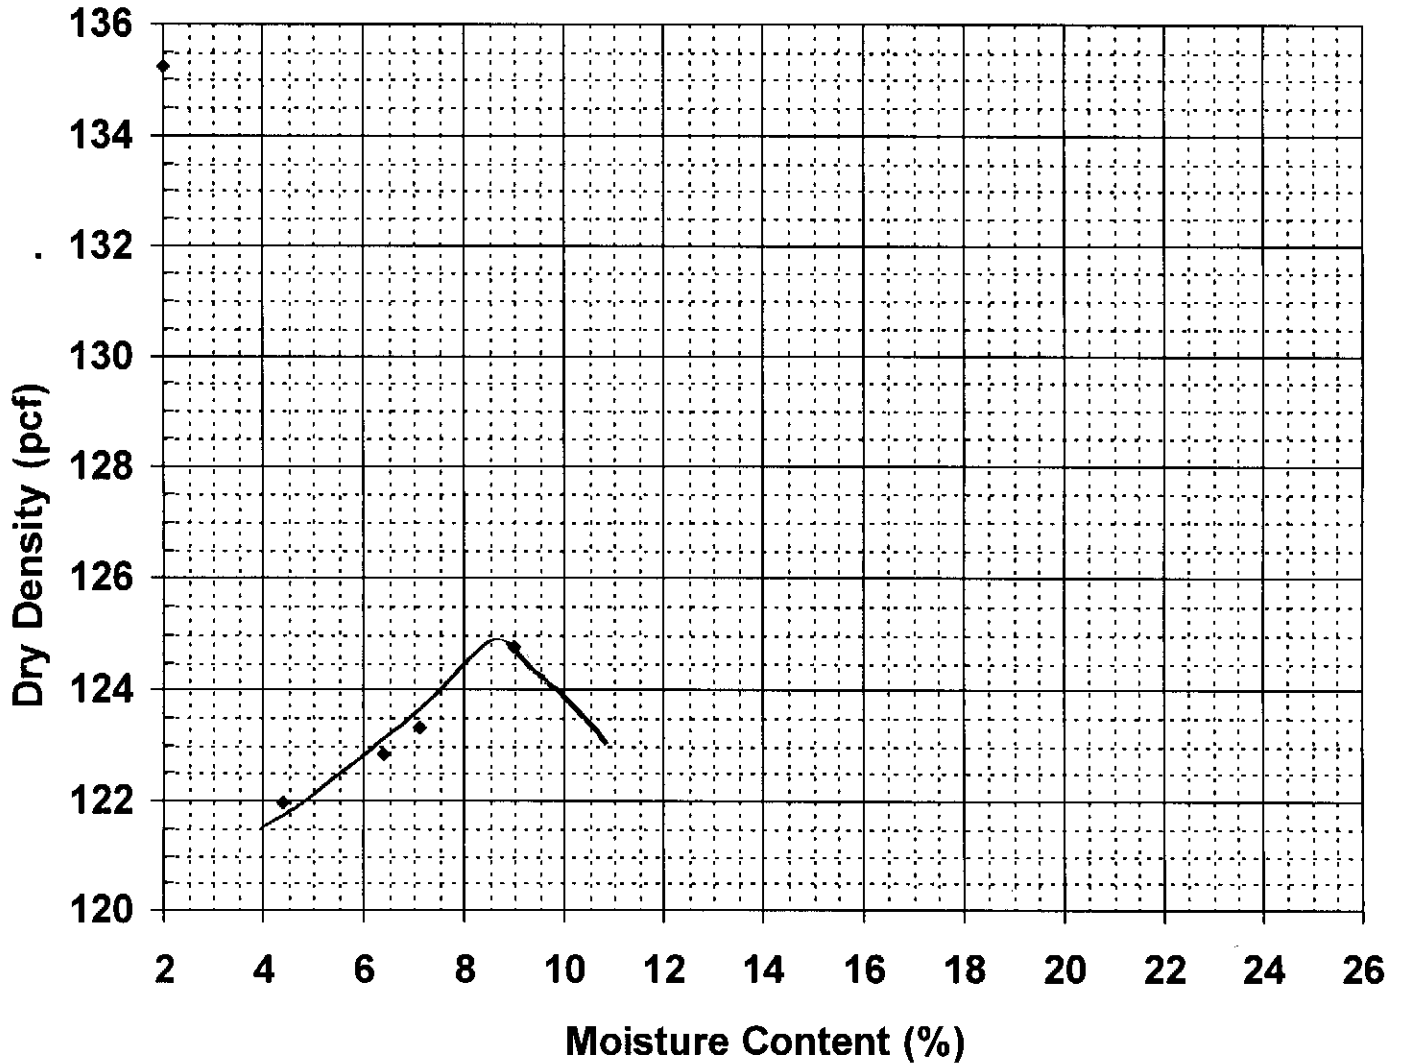

Maximum Dry Density (pcf) 125
 Optimum Moisture Content (%) 8.7
 Percent Oversized 23.0%

Corrected Dry Density (pcf) **131.2**
Corrected Moisture Content (%) **7.2**

Comments


 Roger E. Domingo