


3rd Floor Fire Sprinkler Plan
1/8" = 1'-0"


Sprinkler Head Schedule

Symbol	Count	Thread	K-Factor	Description	Note
○	36	1/2"	5.6	RELIABLE F1FR-56, 155' WHITE RECESSED PENDENT	RA1414
○	33	3/4"	8.0	RELIABLE F1FR WHITE OR EXTENDED COVERAGE RECESSED PENDENT	RA4842
○	80	1/2"	4.2	RELIABLE F1FR WHITE OR RECESSED PENDENT	RA1413
○	1	1/2"	5.6	RELIABLE F1FR-56, 155' BRASS UPRIGHT	RA1425

150 = Total Number of Heads this floor

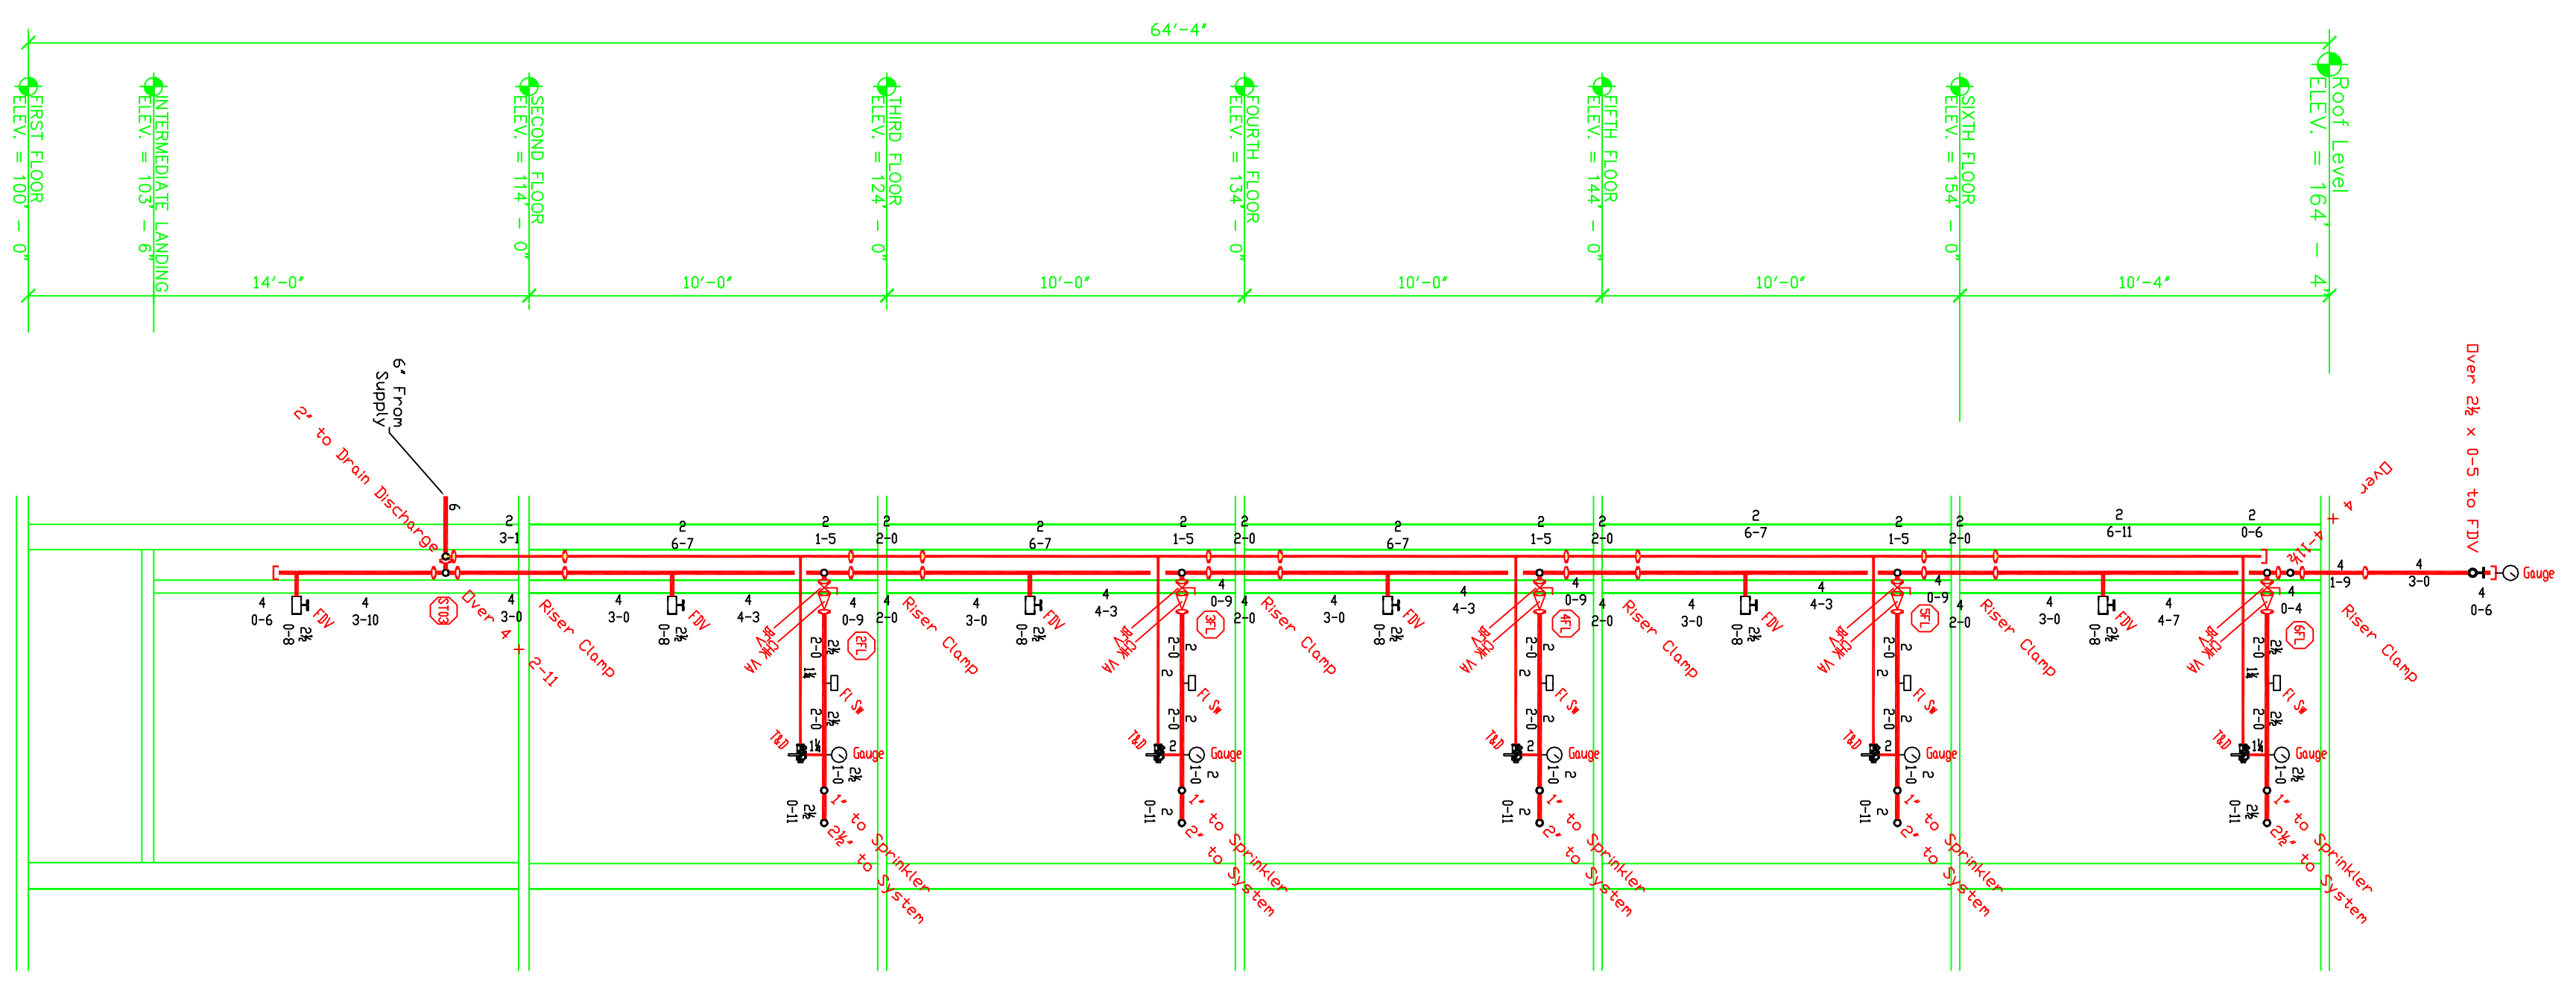

Stair "B" Standpipe Detail
1/4" = 1'-0"





6 NORTH WENTWORTH AVENUE, LONDONDERRY, NH 03053
 PH: (603) 432-8281 FAX: (603) 434-3194
 WEBSTY: HAMPSHIRE.COM
 MASS LICENSE # 0000000000 VERMONT CERTIFIED

WATER SUPPLY DATA		SPRINKLERS		DRAWING INFORMATION															
State Pressure	108 psi	Total This Sheet		Project	Marrriott Courtyard Hotel														
Residual Pressure	102 psi	Description	3rd Floor Fire Sprinkler Plan	Contract	321 Commercial Street Portland ME 04101														
Flow	157 gpm			Drawn By	RTW														
Elevation	0'			Scale	As Noted														
Date	Mar 11 2013 10:06 AM			Date	05-25-13														
Information	Portland Water			Approved By	Portland ME														
				Revisions	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr><td>1</td><td></td></tr> <tr><td>2</td><td></td></tr> <tr><td>3</td><td></td></tr> <tr><td>4</td><td></td></tr> <tr><td>5</td><td></td></tr> <tr><td>6</td><td></td></tr> <tr><td>7</td><td></td></tr> </table>	1		2		3		4		5		6		7	
1																			
2																			
3																			
4																			
5																			
6																			
7																			

Project: Marrriott Courtyard Hotel
321 Commercial Street
Portland ME 04101

Contract with:
Opesche Construction
11 Corporate Drive
Bethmont NH 03220

FIRE PROTECTION ENGINEER STAMP