

... Fire Protection by Computer Design

Hampshire Fire Protection
8 N Wentworth Ave
Londonderry, NH 03053
603-432-8221

Job Name : Courtyard by Marriott Area #5 Calc 5th Floor Guestroom
Building : 6 of 8
Location : Portland ME
System : Area #5
Contract : 4396CME
Data File : 5th Floor Area #5 Guest Room Calc.WXF

HYDRAULIC CALCULATIONS
for

Project name: Courtyard by Marriott
Location: Portland ME
Drawing no: 6 of 8
Date: 6-5-13

Design

Remote area number: Area #5
Remote area location: 5th Floor Guest Room
Occupancy classification: Light Hazard
Density: .10 - Gpm/SqFt
Area of application: Room Design - SqFt
Coverage per sprinkler: Varies - SqFt
Type of sprinklers calculated: QR Recessed Pendent
No. of sprinklers calculated: 4
In-rack demand: - GPM
Hose streams: 100 - GPM
Total water required (including hose streams): 173.75 - GPM @ 81.79 - Psi
Type of system: Wet
Volume of dry or preaction system: N/A - Gal

Water supply information

Date: 5-11-13
Location: Commercial St & Maple St
Source: Portland Water

Name of contractor: Hampshire Fire
Address: N Wentworth Ave Londonderry NH 03053
Phone number: 603-432-8221

Name of designer: E Vance Wooten
Authority having jurisdiction: Portland

Notes: (Include peaking information or gridded systems here.) Room design method with sprinklers in remote room plus sprinklers in adjoining rooms not protected by self closing fire rated doors.


Water Supply Curve C

Hampshire Fire Protection
Courtyard by Marriott Area #5 Calc 5th Floor Guestroom

Page 2
Date 6-4-13

City Water Supply:
C1 - Static Pressure : 108
C2 - Residual Pressure: 102
C2 - Residual Flow : 1537

Demand:
D1 - Elevation : 22.521
D2 - System Flow : 73.745
D2 - System Pressure : 81.791
Hose (Demand) : 100
D3 - System Demand : 173.745
Safety Margin : 26.103

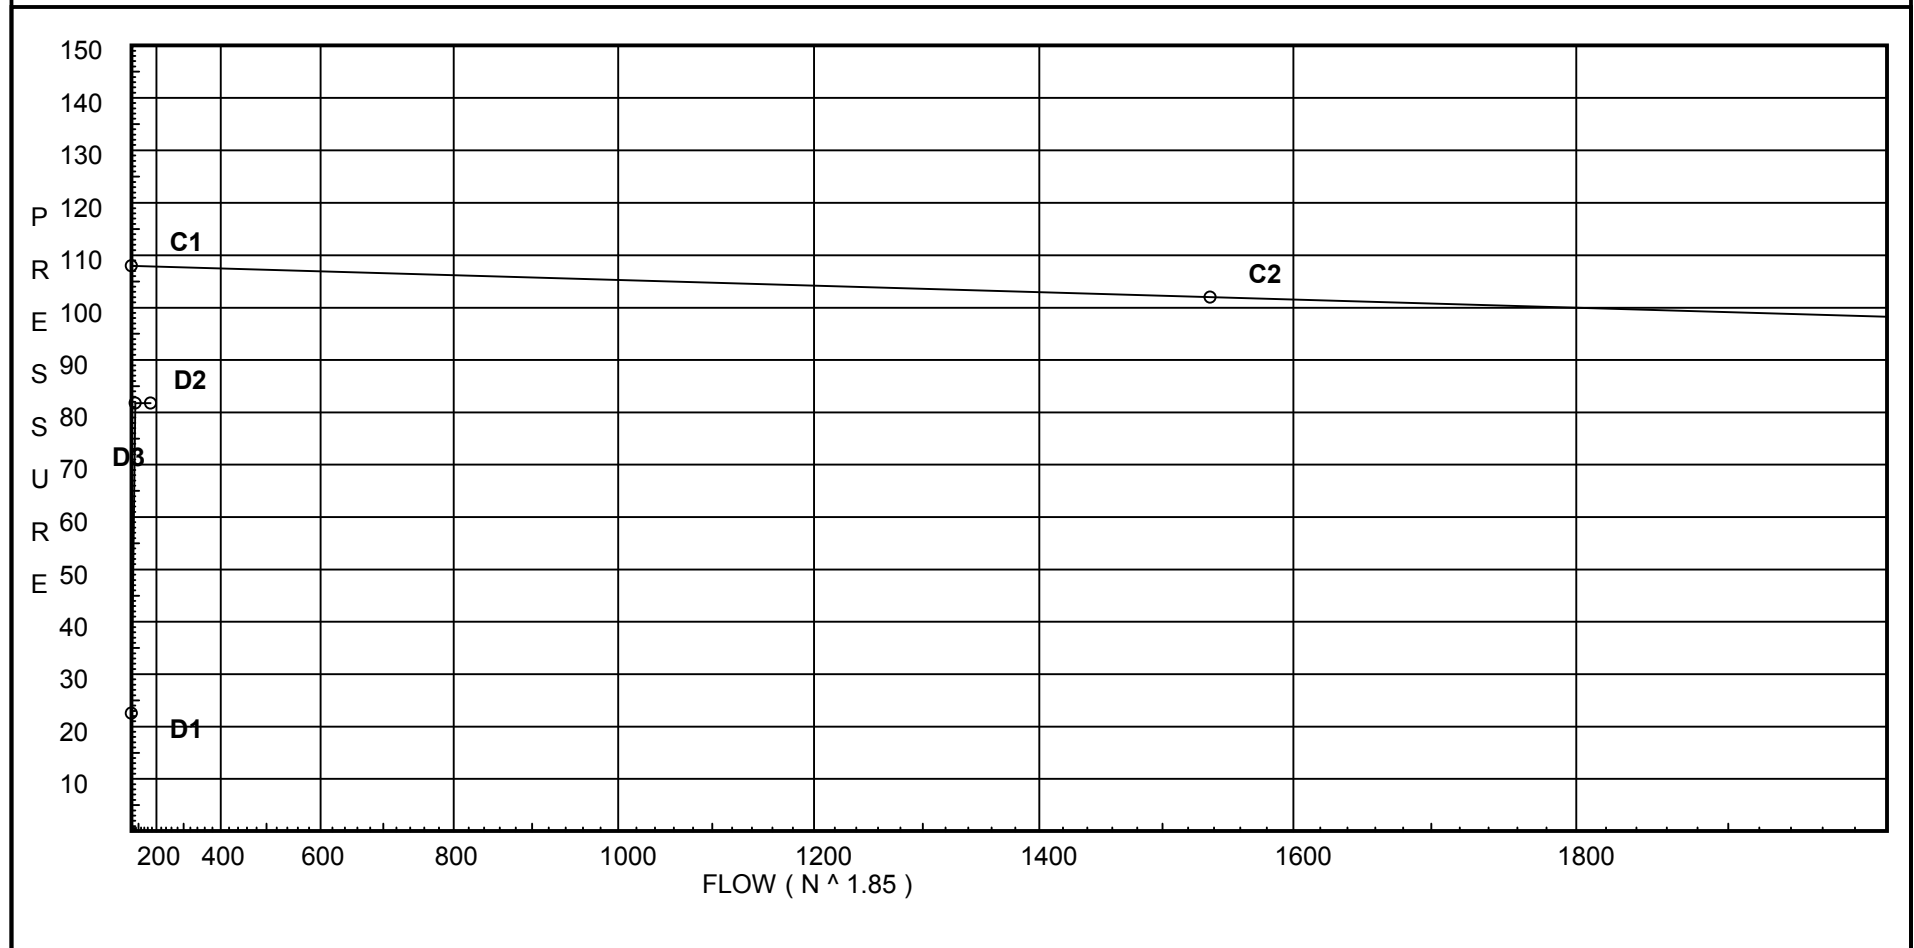

Fittings Used Summary

Hampshire Fire Protection
 Courtyard by Marriott Area #5 Calc 5th Floor Guestroom

Page 3
 Date 6-4-13

Fitting Legend

Abbrev.	Name	1/2	3/4	1	1 1/4	1 1/2	2	2 1/2	3	3 1/2	4	5	6	8	10	12	14	16	18	20	24
B	NFPA 13 Butterfly Valve	0	0	0	0	0	6	7	10	0	12	9	10	12	19	21	0	0	0	0	0
E	NFPA 13 90' Standard Elbow	1	2	2	3	4	5	6	7	8	10	12	14	18	22	27	35	40	45	50	61
G	NFPA 13 Gate Valve	0	0	0	0	0	1	1	1	1	2	2	3	4	5	6	7	8	10	11	13
S	NFPA 13 Swing Check	0	0	5	7	9	11	14	16	19	22	27	32	45	55	65					
T	NFPA 13 90' Flow thru Tee	3	4	5	6	8	10	12	15	17	20	25	30	35	50	60	71	81	91	101	121
V	90' Ell Firelock #001	0	0	0	0	0	3.5	4.3	5	0	6.8	8.5	10	13	0	0	0	0	0	0	0
X	90'Tee-BranchFirelock002	0	0	0	0	0	8.5	10.8	13	0	16	21	25	33	0	0	0	0	0	0	0

Units Summary

Diameter Units	Inches
Length Units	Feet
Flow Units	US Gallons per Minute
Pressure Units	Pounds per Square Inch

Note: Fitting Legend provides equivalent pipe lengths for fittings types of various diameters. Equivalent lengths shown are standard for actual diameters of Sched 40 pipe and CFactors of 120 except as noted with *. The fittings marked with a * show equivalent lengths values supplied by manufacturers based on specific pipe diameters and CFactors and they require no adjustment. All values for fittings not marked with a * will be adjusted in the calculation for CFactors of other than 120 and diameters other than Sched 40 per NFPA.

Pressure / Flow Summary - STANDARD

Hampshire Fire Protection
 Courtyard by Marriott Area #5 Calc 5th Floor Guestroom

Page 4
 Date 6-4-13

Node No.	Elevation	K-Fact	Pt Actual	Pn	Flow Actual	Density	Area	Press Req.
501	52.0	4.2	16.38	na	17.0	0.1	170	7.0
502	52.0	4.2	17.15	na	17.4	0.1	170	7.0
503	52.0	4.2	21.79	na	19.6	0.1	150	7.0
504	52.0	4.2	22.1	na	19.75	0.1	150	7.0
521	52.75		16.32	na				
522	52.75		17.41	na				
523	52.75		22.72	na				
524	52.75		23.84	na				
626	52.75		39.11	na				
622	52.75		39.44	na				
623	52.75		40.09	na				
624	52.75		40.58	na				
627	52.75		41.06	na				
628	52.75		43.42	na				
5FL	52.25		53.83	na				
4FL	42.25		58.18	na				
3FL	32.25		62.53	na				
2FL	22.25		66.87	na				
ST03	11.67		71.51	na				
ST02	11.67		71.53	na				
1FL	11.67		71.53	na	50.0			
TOR	11.67		71.54	na				
BOR	2.0		75.75	na				
SPG	2.0		80.76	na				
TEST	0.0		81.79	na	50.0			

The maximum velocity is 27.38 and it occurs in the pipe between nodes 524 and 626

Final Calculations - Hazen-Williams - 2007

Hampshire Fire Protection
 Courtyard by Marriott Area #5 Calc 5th Floor Guestroom

Page 5
 Date 6-4-13

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv. Ln.	Pipe Ftg's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
501 to 521	17.00 17.0	1.049 120.0 0.0964	1E 2.0 0.0 0.0	0.750 2.000 2.750	16.383 -0.325 0.265		K Factor = 4.20 Vel = 6.31		
	0.0 17.00				16.323		K Factor = 4.21		
502 to 522	17.40 17.4	1.049 120.0 0.1005	1T 5.0 0.0 0.0	0.750 5.000 5.750	17.154 -0.325 0.578		K Factor = 4.20 Vel = 6.46		
	0.0 17.40				17.407		K Factor = 4.17		
503 to 523	19.60 19.6	1.049 120.0 0.1254	1E 2.0 1T 5.0 0.0	3.000 7.000 10.000	21.786 -0.325 1.254		K Factor = 4.20 Vel = 7.28		
	0.0 19.60				22.715		K Factor = 4.11		
504 to 524	19.75 19.75	1.049 120.0 0.1271	2E 4.0 1T 5.0 0.0	7.210 9.000 16.210	22.104 -0.325 2.060		K Factor = 4.20 Vel = 7.33		
	0.0 19.75				23.839		K Factor = 4.05		
521 to 522	17.00 17.0	1.049 120.0 0.0964	0.0 0.0 0.0	11.250 0.0 11.250	16.323 0.0 1.084		Vel = 6.31		
522 to 523	17.40 34.4	1.049 120.0 0.3548	2E 4.0 0.0 0.0	10.960 4.000 14.960	17.407 0.0 5.308		Vel = 12.77		
523 to 524	19.60 54.0	1.049 120.0 0.8175	0.0 0.0 0.0	1.375 0.0 1.375	22.715 0.0 1.124		Vel = 20.05		
524 to 626	19.75 73.75	1.049 120.0 1.4548	1T 5.0 0.0 0.0	5.500 5.000 10.500	23.839 0.0 15.275		Vel = 27.38		
626 to 622	0.0 73.75	2.157 120.0 0.0434	0.0 0.0 0.0	7.580 0.0 7.580	39.114 0.0 0.329		Vel = 6.48		
622 to 623	0.0 73.75	2.157 120.0 0.0435	0.0 0.0 0.0	14.880 0.0 14.880	39.443 0.0 0.647		Vel = 6.48		
623 to 624	0.0 73.75	2.157 120.0 0.0435	0.0 0.0 0.0	11.250 0.0 11.250	40.090 0.0 0.489		Vel = 6.48		
624 to 627	0.0 73.75	2.157 120.0 0.0434	0.0 0.0 0.0	11.170 0.0 11.170	40.579 0.0 0.485		Vel = 6.48		
627 to 628	0.0 73.75	2.157 120.0 0.0435	1V 4.307 0.0 0.0	49.960 4.307 54.267	41.064 0.0 2.359		Vel = 6.48		
628 to 5FL	0.0 73.75	2.157 120.0 0.0435	4V 17.229 1X 10.461 1T 12.307	173.630 60.918 234.548	43.423 0.217 10.193		Vel = 6.48		

Final Calculations - Hazen-Williams

Hampshire Fire Protection
 Courtyard by Marriott Area #5 Calc 5th Floor Guestroom

Page 6
 Date 6-4-13

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv.	Ln.	Pipe Ftng's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
			1S	13.537						
			1B	7.384						
5FL to 4FL	0.0 73.75	4.26 120.0 0.0016		0.0	10.000 0.0	53.833 4.331			Vel = 1.66	
4FL to 3FL	0.0 73.75	4.26 120.0 0.0016		0.0	10.000 0.0	58.180 4.331			Vel = 1.66	
3FL to 2FL	0.0 73.75	4.26 120.0 0.0016		0.0	10.000 0.0	62.527 4.331			Vel = 1.66	
2FL to ST03	0.0 73.75	4.26 120.0 0.0016	2V	17.907	19.500 17.907	66.874 4.582			Vel = 1.66	
ST03 to ST02	0.0 73.75	6.357 120.0 0.0002	1X 1B	31.433 12.573	9.500 44.006	71.515 0.0			Vel = 0.75	
ST02 to 1FL	0.0 73.75	6.357 120.0 0.0002		0.0	24.790 0.0	71.527 0.0			Vel = 0.75	
1FL to TOR	49.99 123.74	6.357 120.0 0.0006	1V	12.573	1.540 12.573	71.532 0.0		Qa = 50	Vel = 1.25	
TOR to BOR	0.0 123.74	6.357 120.0 0.0006	1X	31.433	9.670 31.433	71.541 4.188			Vel = 1.25	
BOR to SPG	0.0 123.74	6.357 120.0 0.0006	1V	12.573	2.000 12.573	75.753 5.000		** Fixed Loss = 5	Vel = 1.25	
SPG to TEST	0.0 123.74	6.16 140.0 0.0005	3E 1T 1G	60.252 43.037 4.304	210.000 107.593 317.593	80.762 0.866 0.163			Vel = 1.33	
	50.00 173.74						81.791		Qa = 50.00 K Factor = 19.21	