

... Fire Protection by Computer Design

Hampshire Fire Protection
8 N Wentworth Ave
Londonderry, NH 03053
603-432-8221

Job Name : Courtyard by Marriott Area #6 Calc 5th Floor Corridor
Building : 6 of 8
Location : Portland ME
System : Area #6
Contract : 4396CME
Data File : 5th Floor Area #6 Corridor Calc.WXF

HYDRAULIC CALCULATIONS
for

Project name: Courtyard by Marriott

Location: Portland ME

Drawing no: 6 of 8

Date: 6-5-13

Design

Remote area number: Area #6

Remote area location: 5th Floor Corridor

Occupancy classification: Light Hazard

Density: .10 - Gpm/SqFt

Area of application: Room Design - SqFt

Coverage per sprinkler: Varies - SqFt

Type of sprinklers calculated: QR Recessed Pendent

No. of sprinklers calculated: 5

In-rack demand: - GPM

Hose streams: 100 - GPM

Total water required (including hose streams): 175.97 - GPM @ 49.73 - Psi

Type of system: Wet

Volume of dry or preaction system: N/A - Gal

Water supply information

Date: 5-11-13

Location: Commercial St & Maple St

Source: Portland Water

Name of contractor: Hampshire Fire

Address: N Wentworth Ave Londonderry NH 03053

Phone number: 603-432-8221

Name of designer: E Vance Wooten

Authority having jurisdiction: Portland

Notes: (Include peaking information or gridded systems here.) Room design method
for corridor with self closing fire doors - 5 Heads


Water Supply Curve C

Hampshire Fire Protection
Courtyard by Marriott Area #6 Calc 5th Floor Corridor

Page 2
Date 6-4-13

City Water Supply:
C1 - Static Pressure : 108
C2 - Residual Pressure: 102
C2 - Residual Flow : 1537

Demand:
D1 - Elevation : 22.521
D2 - System Flow : 75.974
D2 - System Pressure : 49.731
Hose (Demand) : 100
D3 - System Demand : 175.974
Safety Margin : 58.160

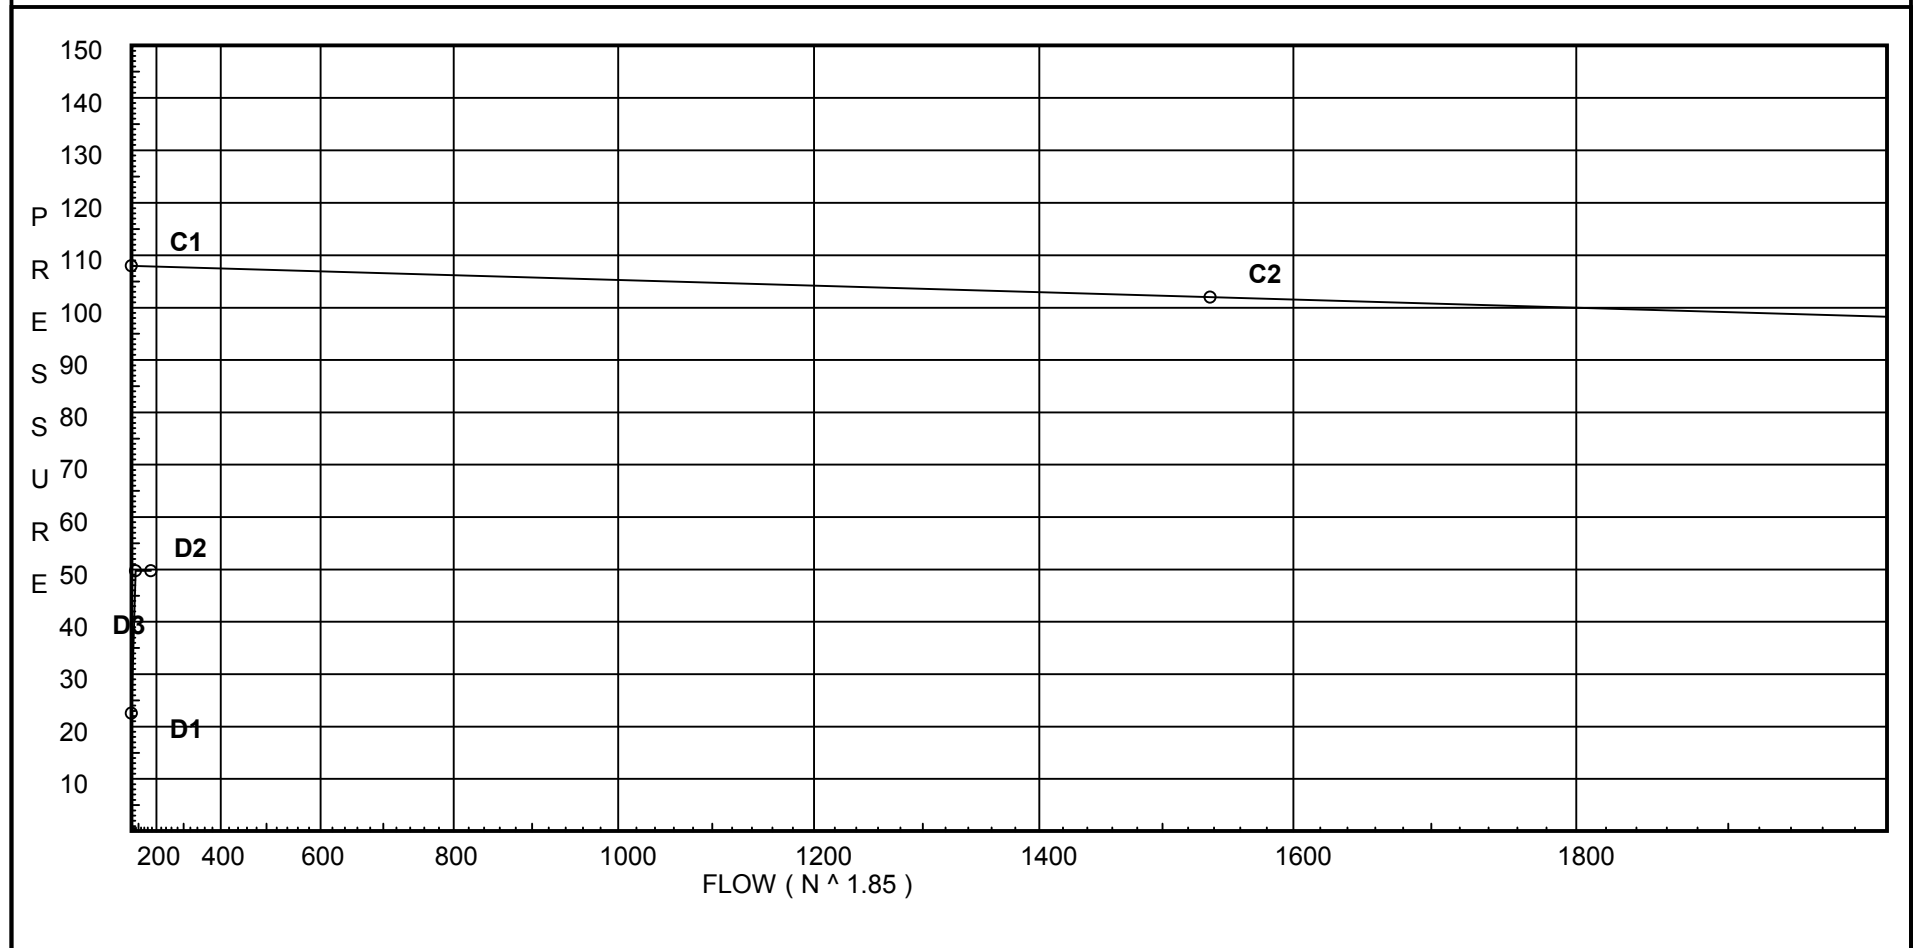

Fittings Used Summary

Hampshire Fire Protection
 Courtyard by Marriott Area #6 Calc 5th Floor Corridor

Page 3
 Date 6-4-13

Fitting Legend

Abbrev.	Name	1/2	3/4	1	1 1/4	1 1/2	2	2 1/2	3	3 1/2	4	5	6	8	10	12	14	16	18	20	24
B	NFPA 13 Butterfly Valve	0	0	0	0	0	6	7	10	0	12	9	10	12	19	21	0	0	0	0	0
E	NFPA 13 90' Standard Elbow	1	2	2	3	4	5	6	7	8	10	12	14	18	22	27	35	40	45	50	61
G	NFPA 13 Gate Valve	0	0	0	0	0	1	1	1	1	2	2	3	4	5	6	7	8	10	11	13
S	NFPA 13 Swing Check	0	0	5	7	9	11	14	16	19	22	27	32	45	55	65					
T	NFPA 13 90' Flow thru Tee	3	4	5	6	8	10	12	15	17	20	25	30	35	50	60	71	81	91	101	121
V	90' Ell Firelock #001	0	0	0	0	0	3.5	4.3	5	0	6.8	8.5	10	13	0	0	0	0	0	0	0
X	90'Tee-BranchFirelock002	0	0	0	0	0	8.5	10.8	13	0	16	21	25	33	0	0	0	0	0	0	0

Units Summary

Diameter Units	Inches
Length Units	Feet
Flow Units	US Gallons per Minute
Pressure Units	Pounds per Square Inch

Note: Fitting Legend provides equivalent pipe lengths for fittings types of various diameters. Equivalent lengths shown are standard for actual diameters of Sched 40 pipe and CFactors of 120 except as noted with *. The fittings marked with a * show equivalent lengths values supplied by manufacturers based on specific pipe diameters and CFactors and they require no adjustment. All values for fittings not marked with a * will be adjusted in the calculation for CFactors of other than 120 and diameters other than Sched 40 per NFPA.

Pressure / Flow Summary - STANDARD

Hampshire Fire Protection
 Courtyard by Marriott Area #6 Calc 5th Floor Corridor

Page 4
 Date 6-4-13

Node No.	Elevation	K-Fact	Pt Actual	Pn	Flow Actual	Density	Area	Press Req.
625	52.75		8.11	na				
601	52.0	5.6	7.17	na	15.0	0.1	150	7.0
602	52.0	5.6	7.2	na	15.02	0.1	150	7.0
603	52.0	5.6	7.31	na	15.14	0.1	150	7.0
604	52.0	5.6	7.49	na	15.33	0.1	150	7.0
605	52.0	5.6	7.65	na	15.48	0.1	150	7.0
621	52.75		7.6	na				
626	52.75		7.61	na				
622	52.75		7.62	na				
623	52.75		7.75	na				
624	52.75		7.94	na				
627	52.75		8.28	na				
628	52.75		10.77	na				
5FL	52.25		21.76	na				
4FL	42.25		26.11	na				
3FL	32.25		30.46	na				
2FL	22.25		34.8	na				
ST03	11.67		39.45	na				
ST02	11.67		39.46	na				
1FL	11.67		39.47	na	50.0			
TOR	11.67		39.47	na				
BOR	2.0		43.69	na				
SPG	2.0		48.7	na				
TEST	0.0		49.73	na	50.0			

The maximum velocity is 6.67 and it occurs in the pipe between nodes 627 and 628

Final Calculations - Hazen-Williams - 2007

Hampshire Fire Protection
 Courtyard by Marriott Area #6 Calc 5th Floor Corridor

Page 5
 Date 6-4-13

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv.	Ln.	Pipe Ftng's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
625 to 627	15.48 15.48	1.38 120.0 0.0213	1T	6.0 0.0 0.0	1.790 6.000 7.790	8.114 0.0 0.166				Vel = 3.32
	0.0 15.48						8.280			K Factor = 5.38
601 to 621	15.00 15.0	1.049 120.0 0.0764	1E 1T	2.0 5.0 0.0	2.790 7.000 9.790	7.175 -0.325 0.748				K Factor = 5.60 Vel = 5.57
	0.0 15.00						7.598			K Factor = 5.44
602 to 622	15.02 15.02	1.049 120.0 0.0766	1E 1T	2.0 5.0 0.0	2.790 7.000 9.790	7.198 -0.325 0.750				K Factor = 5.60 Vel = 5.58
	0.0 15.02						7.623			K Factor = 5.44
603 to 623	15.14 15.14	1.049 120.0 0.0777	1E 1T	2.0 5.0 0.0	2.790 7.000 9.790	7.310 -0.325 0.761				K Factor = 5.60 Vel = 5.62
	0.0 15.14						7.746			K Factor = 5.44
604 to 624	15.33 15.33	1.049 120.0 0.0795	1E 1T	2.0 5.0 0.0	2.790 7.000 9.790	7.490 -0.325 0.778				K Factor = 5.60 Vel = 5.69
	0.0 15.33						7.943			K Factor = 5.44
605 to 625	15.48 15.48	1.049 120.0 0.0811	1E 1T	2.0 5.0 0.0	2.790 7.000 9.790	7.645 -0.325 0.794				K Factor = 5.60 Vel = 5.75
	0.0 15.48						8.114			K Factor = 5.43
621 to 626	15.00 15.0	2.157 120.0 0.0023		0.0 0.0 0.0	3.420 0.0 3.420	7.598 0.0 0.008				Vel = 1.32
626 to 622	0.0 15.0	2.157 120.0 0.0022		0.0 0.0 0.0	7.580 0.0 7.580	7.606 0.0 0.017				Vel = 1.32
622 to 623	15.02 30.02	2.157 120.0 0.0083		0.0 0.0 0.0	14.880 0.0 14.880	7.623 0.0 0.123				Vel = 2.64
623 to 624	15.14 45.16	2.157 120.0 0.0175		0.0 0.0 0.0	11.250 0.0 11.250	7.746 0.0 0.197				Vel = 3.97
624 to 627	15.33 60.49	2.157 120.0 0.0302		0.0 0.0 0.0	11.170 0.0 11.170	7.943 0.0 0.337				Vel = 5.31
627 to 628	15.48 75.97	2.157 120.0 0.0459	1V	4.307 0.0 0.0	49.960 4.307 54.267	8.280 0.0 2.492				Vel = 6.67

Final Calculations - Hazen-Williams

Hampshire Fire Protection
 Courtyard by Marriott Area #6 Calc 5th Floor Corridor

Page 6
 Date 6-4-13

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv.	Ln.	Pipe Ftg's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
628 to 5FL	0.0 75.97	2.157 120.0 0.0459	4V 1X 1T 1S 1B	17.229 10.461 12.307 13.537 7.384	173.630 60.918 234.548	10.772 0.217 10.771		Vel = 6.67		
5FL to 4FL	0.0 75.97	4.26 120.0 0.0016		0.0 0.0 0.0	10.000 0.0 10.000	21.760 4.331 0.016		Vel = 1.71		
4FL to 3FL	0.0 75.97	4.26 120.0 0.0017		0.0 0.0 0.0	10.000 0.0 10.000	26.107 4.331 0.017		Vel = 1.71		
3FL to 2FL	0.0 75.97	4.26 120.0 0.0017		0.0 0.0 0.0	10.000 0.0 10.000	30.455 4.331 0.017		Vel = 1.71		
2FL to ST03	0.0 75.97	4.26 120.0 0.0017	2V	17.907 0.0 0.0	19.500 17.907 37.407	34.803 4.582 0.062		Vel = 1.71		
ST03 to ST02	0.0 75.97	6.357 120.0 0.0002	1X 1B	31.433 12.573 0.0	9.500 44.006 53.506	39.447 0.0 0.013		Vel = 0.77		
ST02 to 1FL	0.0 75.97	6.357 120.0 0.0002		0.0 0.0 0.0	24.790 0.0 24.790	39.460 0.0 0.006		Vel = 0.77		
1FL to TOR	50.00 125.97	6.357 120.0 0.0006	1V	12.573 0.0 0.0	1.540 12.573 14.113	39.466 0.0 0.008		Qa = 50 Vel = 1.27		
TOR to BOR	0.0 125.97	6.357 120.0 0.0006	1X	31.433 0.0 0.0	9.670 31.433 41.103	39.474 4.188 0.026		Vel = 1.27		
BOR to SPG	0.0 125.97	6.357 120.0 0.0005	1V	12.573 0.0 0.0	2.000 12.573 14.573	43.688 5.000 0.008		** Fixed Loss = 5 Vel = 1.27		
SPG to TEST	0.0 125.97	6.16 140.0 0.0005	3E 1T 1G	60.252 43.037 4.304	210.000 107.593 317.593	48.696 0.866 0.169		Vel = 1.36		
	50.00 175.97					49.731		Qa = 50.00 K Factor = 24.95		