

... Fire Protection by Computer Design

Hampshire Fire Protection
8 N Wentworth Ave
Londonderry, NH 03053
603-432-8221

Job Name : Courtyard by Marriott Area #8 Calc 6th Floor Corridor
Building : 7 of 8
Location : Portland ME
System : Area #8
Contract : 4396CME
Data File : 6th Floor Area #8 Corridor Calc.WXF

HYDRAULIC CALCULATIONS
for

Project name: Courtyard by Marriott

Location: Portland ME

Drawing no: 7 of 8

Date: 6-5-13

Design

Remote area number: Area #8

Remote area location: 6th Floor Corridor

Occupancy classification: Light Hazard

Density: .10 - Gpm/SqFt

Area of application: Room Design - SqFt

Coverage per sprinkler: Varies - SqFt

Type of sprinklers calculated: QR Recessed Pendent

No. of sprinklers calculated: 5

In-rack demand: - GPM

Hose streams: 100 - GPM

Total water required (including hose streams): 176.17 - GPM @ 46.71 - Psi

Type of system: Wet

Volume of dry or preaction system: N/A - Gal

Water supply information

Date: 5-11-13

Location: Commercial St & Maple St

Source: Portland Water

Name of contractor: Hampshire Fire

Address: N Wentworth Ave Londonderry NH 03053

Phone number: 603-432-8221

Name of designer: E Vance Wooten

Authority having jurisdiction: Portland

Notes: (Include peaking information or gridded systems here.) Room design method
for corridor with self closing fire doors - 5 Heads


Water Supply Curve C

Hampshire Fire Protection
Courtyard by Marriott Area #8 Calc 6th Floor Corridor

Page 2
Date 6-4-13

City Water Supply:
C1 - Static Pressure : 108
C2 - Residual Pressure: 102
C2 - Residual Flow : 1537

Demand:
D1 - Elevation : 26.852
D2 - System Flow : 76.171
D2 - System Pressure : 46.708
Hose (Demand) : 100
D3 - System Demand : 176.171
Safety Margin : 61.183

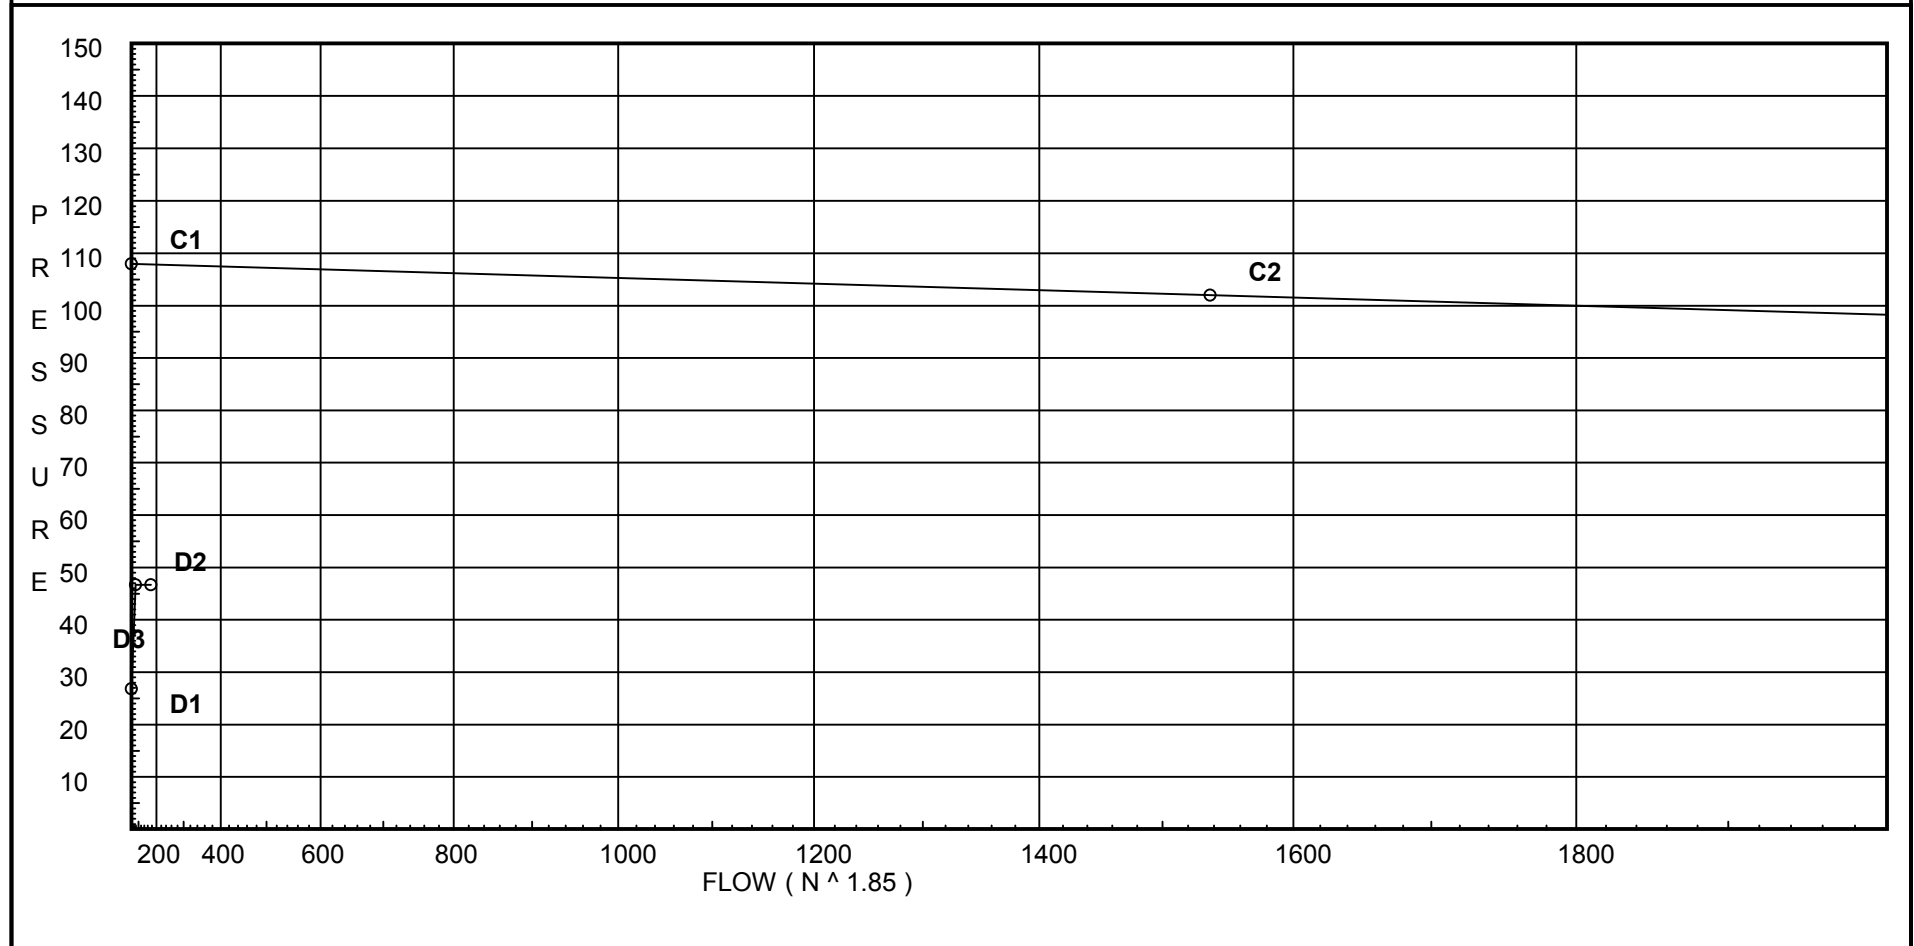

Fittings Used Summary

Hampshire Fire Protection
 Courtyard by Marriott Area #8 Calc 6th Floor Corridor

Page 3
 Date 6-4-13

Fitting Legend

Abbrev.	Name	1/2	3/4	1	1 1/4	1 1/2	2	2 1/2	3	3 1/2	4	5	6	8	10	12	14	16	18	20	24
B	NFPA 13 Butterfly Valve	0	0	0	0	0	6	7	10	0	12	9	10	12	19	21	0	0	0	0	0
E	NFPA 13 90' Standard Elbow	1	2	2	3	4	5	6	7	8	10	12	14	18	22	27	35	40	45	50	61
G	NFPA 13 Gate Valve	0	0	0	0	0	1	1	1	1	2	2	3	4	5	6	7	8	10	11	13
S	NFPA 13 Swing Check	0	0	5	7	9	11	14	16	19	22	27	32	45	55	65					
T	NFPA 13 90' Flow thru Tee	3	4	5	6	8	10	12	15	17	20	25	30	35	50	60	71	81	91	101	121
V	90' Ell Firelock #001	0	0	0	0	0	3.5	4.3	5	0	6.8	8.5	10	13	0	0	0	0	0	0	0
X	90'Tee-BranchFirelock002	0	0	0	0	0	8.5	10.8	13	0	16	21	25	33	0	0	0	0	0	0	0

Units Summary

Diameter Units	Inches
Length Units	Feet
Flow Units	US Gallons per Minute
Pressure Units	Pounds per Square Inch

Note: Fitting Legend provides equivalent pipe lengths for fittings types of various diameters. Equivalent lengths shown are standard for actual diameters of Sched 40 pipe and CFactors of 120 except as noted with *. The fittings marked with a * show equivalent lengths values supplied by manufacturers based on specific pipe diameters and CFactors and they require no adjustment. All values for fittings not marked with a * will be adjusted in the calculation for CFactors of other than 120 and diameters other than Sched 40 per NFPA.

Pressure / Flow Summary - STANDARD

Hampshire Fire Protection
 Courtyard by Marriott Area #8 Calc 6th Floor Corridor

Page 4
 Date 6-4-13

Node No.	Elevation	K-Fact	Pt Actual	Pn	Flow Actual	Density	Area	Press Req.
801	62.0	5.6	7.17	na	15.0	0.1	150	7.0
802	62.0	5.6	7.2	na	15.02	0.1	150	7.0
803	62.0	5.6	7.27	na	15.1	0.1	150	7.0
804	62.0	5.6	7.48	na	15.32	0.1	150	7.0
805	62.0	5.6	7.89	na	15.73	0.1	150	7.0
821	62.58		7.64	na				
822	62.58		7.67	na				
823	62.58		7.75	na				
824	62.58		7.98	na				
825	62.58		8.43	na				
733	62.58		9.88	na				
6FL	62.58		14.24	na				
5FL	52.25		18.74	na				
4FL	42.25		23.08	na				
3FL	32.25		27.43	na				
2FL	22.25		31.78	na				
ST03	11.67		36.42	na				
ST02	11.67		36.44	na				
1FL	11.67		36.44	na	50.0			
TOR	11.67		36.45	na				
BOR	2.0		40.66	na				
SPG	2.0		45.67	na				
TEST	0.0		46.71	na	50.0			

The maximum velocity is 6.69 and it occurs in the pipe between nodes 825 and 733

Final Calculations - Hazen-Williams - 2007

Hampshire Fire Protection
 Courtyard by Marriott Area #8 Calc 6th Floor Corridor

Page 5
 Date 6-4-13

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv. Ln.	Pipe Ftg's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
801 to 821	15.00 15.0	1.049 120.0 0.0763	1E 2.0 1T 5.0 0.0	2.420 7.000 9.420	7.175 -0.251 0.719		K Factor = 5.60 Vel = 5.57		
	0.0 15.00					7.643	K Factor = 5.43		
802 to 822	15.02 15.02	1.049 120.0 0.0765	1E 2.0 1T 5.0 0.0	2.420 7.000 9.420	7.196 -0.251 0.721		K Factor = 5.60 Vel = 5.58		
	0.0 15.02					7.666	K Factor = 5.42		
803 to 823	15.10 15.1	1.049 120.0 0.0774	1E 2.0 1T 5.0 0.0	2.420 7.000 9.420	7.271 -0.251 0.729		K Factor = 5.60 Vel = 5.61		
	0.0 15.10					7.749	K Factor = 5.42		
804 to 824	15.32 15.32	1.049 120.0 0.0794	1E 2.0 1T 5.0 0.0	2.420 7.000 9.420	7.480 -0.251 0.748		K Factor = 5.60 Vel = 5.69		
	0.0 15.32					7.977	K Factor = 5.42		
805 to 825	15.73 15.73	1.049 120.0 0.0834	1E 2.0 1T 5.0 0.0	2.420 7.000 9.420	7.893 -0.251 0.786		K Factor = 5.60 Vel = 5.84		
	0.0 15.73					8.428	K Factor = 5.42		
821 to 822	15.00 15.0	2.157 120.0 0.0023	0.0 0.0 0.0	10.000 0.0 10.000	7.643 0.0 0.023		Vel = 1.32		
822 to 823	15.02 30.02	2.157 120.0 0.0083	0.0 0.0 0.0	10.000 0.0 10.000	7.666 0.0 0.083		Vel = 2.64		
823 to 824	15.10 45.12	2.157 120.0 0.0175	0.0 0.0 0.0	13.040 0.0 13.040	7.749 0.0 0.228		Vel = 3.96		
824 to 825	15.32 60.44	2.157 120.0 0.0301	0.0 0.0 0.0	15.000 0.0 15.000	7.977 0.0 0.451		Vel = 5.31		
825 to 733	15.73 76.17	2.157 120.0 0.0462	1V 4.307 0.0 0.0	27.130 4.307 31.437	8.428 0.0 1.451		Vel = 6.69		
733 to 6FL	0.0 76.17	2.635 120.0 0.0174	4V 23.613 1X 14.827 1T 16.474 1S 19.22 1B 9.61	167.000 83.744 250.744	9.879 0.0 4.365		Vel = 4.48		
6FL to 5FL	0.0 76.17	4.26 120.0 0.0016	0.0 0.0 0.0	10.330 0.0 10.330	14.244 4.474 0.017		Vel = 1.71		

Final Calculations - Hazen-Williams

Hampshire Fire Protection
 Courtyard by Marriott Area #8 Calc 6th Floor Corridor

Page 6
 Date 6-4-13

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv.	Ln.	Pipe Ftng's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
5FL	0.0	4.26		0.0	10.000	18.735				
to		120.0		0.0	0.0	4.331				
4FL	76.17	0.0017		0.0	10.000	0.017		Vel =	1.71	
4FL	0.0	4.26		0.0	10.000	23.083				
to		120.0		0.0	0.0	4.331				
3FL	76.17	0.0017		0.0	10.000	0.017		Vel =	1.71	
3FL	0.0	4.26		0.0	10.000	27.431				
to		120.0		0.0	0.0	4.331				
2FL	76.17	0.0017		0.0	10.000	0.017		Vel =	1.71	
2FL	0.0	4.26	2V	17.907	19.500	31.779				
to		120.0		0.0	17.907	4.582				
ST03	76.17	0.0017		0.0	37.407	0.063		Vel =	1.71	
ST03	0.0	6.357	1X	31.433	9.500	36.424				
to		120.0	1B	12.573	44.006	0.0				
ST02	76.17	0.0002		0.0	53.506	0.012		Vel =	0.77	
ST02	0.0	6.357		0.0	24.790	36.436				
to		120.0		0.0	0.0	0.0				
1FL	76.17	0.0002		0.0	24.790	0.006		Vel =	0.77	
1FL	50.00	6.357	1V	12.573	1.540	36.442		Qa =	50	
to		120.0		0.0	12.573	0.0				
TOR	126.17	0.0006		0.0	14.113	0.009		Vel =	1.28	
TOR	0.0	6.357	1X	31.433	9.670	36.451				
to		120.0		0.0	31.433	4.188				
BOR	126.17	0.0006		0.0	41.103	0.025		Vel =	1.28	
BOR	0.0	6.357	1V	12.573	2.000	40.664				
to		120.0		0.0	12.573	5.000		** Fixed Loss =	5	
SPG	126.17	0.0006		0.0	14.573	0.009		Vel =	1.28	
SPG	0.0	6.16	3E	60.252	210.000	45.673				
to		140.0	1T	43.037	107.593	0.866				
TEST	126.17	0.0005	1G	4.304	317.593	0.169		Vel =	1.36	
	50.00							Qa =	50.00	
	176.17					46.708		K Factor =	25.78	